

NFPA® 285

Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Non-Load-Bearing Wall Assemblies Containing Combustible Components

2012 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471
An International Codes and Standards Organization



Become a
Member

Subscribe
to the



Register for
Seminars, Webinars,
and Online Courses

Visit the
NFPA Catalog

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® DOCUMENTS
NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA DOCUMENTS

NFPA® codes, standards, recommended practices, and guides (“NFPA Documents”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Documents.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Documents. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Documents available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Documents. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA DOCUMENTS

ADDITIONAL NOTICES AND DISCLAIMERS

Updating of NFPA Documents

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Documents”) should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments. An official NFPA Document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed below.

Interpretations of NFPA Documents

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Document. The users of NFPA Documents bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Documents.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Document may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Documents should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Documents are copyrighted by the NFPA. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Documents for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Documents, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Documents and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02169-7471; email: stds_admin@nfpa.org

For more information about NFPA, visit the NFPA website at www.nfpa.org.

Copyright © 2012 National Fire Protection Association®. All Rights Reserved.

NFPA® 285

Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Non-Load-Bearing Wall Assemblies Containing Combustible Components

2012 Edition

This edition of NFPA 285, *Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Non-Load-Bearing Wall Assemblies Containing Combustible Components*, was prepared by the Technical Committee on Fire Tests. It was issued by the Standards Council on December 13, 2011, with an effective date of January 2, 2012, and supersedes all previous editions.

This edition of NFPA 285 was approved as an American National Standard on January 2, 2012.

Origin and Development of NFPA 285

The 1998 edition was the first for this standard. It established a test method, developed through a consensus process, for determining the flammability characteristics of exterior non-load-bearing wall assemblies or panels. The Committee's intention was to establish a standard that could be adopted or referenced by other applicable documents, such as the model building codes. The standard was introduced to regulate and address the introduction of combustible materials into exterior walls of all construction types.

The 2006 edition included a complete editorial rewrite for compliance with the *Manual of Style for NFPA Technical Committee Documents*. Further organizational and editorial changes were made to improve the application of the test method, and the scope and purpose of the document were revised to clarify the document's intent. Technical changes addressed details about the test specimen, documentation of the fire test, and testing instrumentation. Historical information describing the development of NFPA 285 was also added as annex material.

The 2012 edition includes organizational, editorial, and technical changes that address clarifications and corrections of both requirements and figures. The changes provide consistency throughout the document and update the standard to reflect current construction and testing practices. Technical changes include new requirements, acceptance criteria, and diagrams for thermocouple locations for new types of wall systems.

Technical Committee on Fire Tests

William E. Fitch, *Chair*

Phyrefish Enterprises, Inc., FL [SE]

Farid Alfawakhiri, American Iron and Steel Institute, IL [M]

Barry L. Badders, Jr., Southwest Research Institute, TX [RT]

Jesse J. Beitel, Hughes Associates, Inc., MD [SE]

Gordon H. Damant, Inter-City Testing & Consulting Corp. of California, CA [SE]

Marcelo M. Hirschler, GBH International, CA [SE]

Alfred J. Hogan, Winter Haven, FL [E]

Rep. International Fire Marshals Association

Mohammed M. Khan, FM Global, MA [I]

William E. Koffel, Koffel Associates, Inc., MD [SE]

Michael E. Luna, Intertek Testing Services, TX [RT]

Andre W. Marshall, University of Maryland, MD [SE]

Rodney A. McPhee, Canadian Wood Council, Canada [M]

Kathleen A. Newman, Firetect, CA [M]

David T. Sheppard, U.S. Bureau of Alcohol, Tobacco, Firearms & Explosives, MD [RT]

Dwayne E. Sloan, Underwriters Laboratories Inc., NC [RT]

Kuma Sumathipala, American Forest & Paper Association, DC [M]

T. Hugh Talley, Hugh Talley Company, TN [M]

Rep. Upholstered Furniture Action Council

Rick Thornberry, The Code Consortium, Inc., CA [SE]

Robert A. Wessel, Gypsum Association, MD [M]

Alternates

Scott W. Adams, Park City Fire Service District, UT [E]
(Alt. to A. J. Hogan)

Richard J. Davis, FM Global, MA [I]
(Alt. to M. M. Khan)

David M. Ewan, Southwest Research Institute, TX [RT]
(Alt. to B. L. Badders, Jr.)

Sam W. Francis, American Wood Council, PA [M]
(Alt. to K. Sumathipala)

Richard G. Gann, National Institute of Standards & Technology, MD [RT]
(Voting Alt. to NIST Rep.)

Paul A. Hough, Armstrong World Industries, Inc., PA [M]
(Voting Alt. to Armstrong Rep.)

James K. Lathrop, Koffel Associates, Inc., CT [SE]
(Alt. to W. E. Koffel)

James A. Milke, University of Maryland, MD [SE]
(Alt. to A. W. Marshall)

Arthur J. Parker, Hughes Associates, Inc., MD [SE]
(Alt. to J. J. Beitel)

Ineke Van Zeeland, Canadian Wood Council, Canada [M]
(Alt. to R. A. McPhee)

Robert J. Wills, American Iron and Steel Institute, AL [M]
(Alt. to F. Alfawakhiri)

Joe Ziolkowski, American Furniture Manufacturers Association, NC [M]
(Alt. to T. H. Talley)

Nonvoting

Robert H. Barker, American Fiber Manufacturers Association, VA [M]

Rohit Khanna, U.S. Consumer Product Safety Commission, MD [C]

Tracy L. Golinveaux, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on fire testing procedures, for reviewing existing fire test standards and recommending appropriate action to NFPA, for recommending the application of and advising on the interpretation of acceptable test standards for fire problems of concern to NFPA technical committees and members, and for acting in a liaison capacity between NFPA and the committees of other organizations writing fire test standards. This Committee does not cover fire tests that are used to evaluate extinguishing agents, devices, or systems.

Contents

Chapter 1 Administration	285- 4	Chapter 6 Instrumentation	285- 9
1.1 Scope	285- 4	6.1 Temperature Measurements	285- 9
1.2 Purpose	285- 4	6.2 Gas Flow Meters	285- 9
1.3 Application	285- 4	6.3 Thermocouples	285- 9
Chapter 2 Referenced Publications	285- 4	Chapter 7 Calibration Procedure	285- 9
2.1 General	285- 4	7.1 Calibration Test Procedure	285- 9
2.2 NFPA Publications	285- 4	7.2 Frequency of Calibration	285-17
2.3 Other Publications	285- 4	Chapter 8 Fire Test Procedure	285-17
2.4 References for Extracts in Mandatory Sections	285- 4	8.1 Fire Test Procedure	285-17
Chapter 3 Definitions	285- 5	Chapter 9 Data Collection and Observation	285-18
3.1 General	285- 5	9.1 Duration	285-18
3.2 NFPA Official Definitions	285- 5	9.2 Data Recording	285-18
3.3 General Definitions	285- 5	9.3 Ambient Conditions	285-18
Chapter 4 Test Facility and Apparatus	285- 5	9.4 Visual Observations	285-18
4.1 Test Facility	285- 5	9.5 Determination of Extent and Depth of Damage	285-18
4.2 Test Apparatus	285- 5	Chapter 10 Conditions of Acceptance	285-18
4.3 Movable Test Frame	285- 6	10.1 Test Specimen	285-18
4.4 Burners	285- 6	10.2 Performance Criteria	285-18
Chapter 5 Test Specimens	285- 8	Chapter 11 Report	285-20
5.1 Location of Test Specimens	285- 8	11.1 Fire Test Report	285-20
5.2 Specimen Mounting	285- 8	Annex A Explanatory Material	285-20
5.3 Size of Test Specimen	285- 8	Annex B Informational References	285-23
5.4 Position of Test Specimen	285- 9	Index	285-24
5.5 Window Opening	285- 9		
5.6 Securing Test Specimen to Test Apparatus	285- 9		
5.7 Construction Details of Test Specimen	285- 9		
5.8 Curing Period	285- 9		

NFPA 285

Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Non-Load-Bearing Wall Assemblies Containing Combustible Components

2012 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading "Important Notices and Disclaimers Concerning NFPA Documents." They can also be obtained on request from NFPA or viewed at www.nfpa.org/disclaimers.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

Changes other than editorial are indicated by a vertical rule beside the paragraph, table, or figure in which the change occurred. These rules are included as an aid to the user in identifying changes from the previous edition. Where one or more complete paragraphs have been deleted, the deletion is indicated by a bullet (•) between the paragraphs that remain.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in mandatory sections of the document are given in Chapter 2 and those for extracts in informational sections are given in Annex B. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex B.

Chapter 1 Administration

1.1* Scope.

1.1.1* This standard provides a test method for determining the fire propagation characteristics of exterior non-load-bearing wall assemblies and panels used as components of curtain wall assemblies, that are constructed using combustible materials or that incorporate combustible components, and that are intended to be installed on buildings required to have exterior walls of non-combustible construction.

1.1.2* The fire propagation characteristics are determined for post-flashover fires of interior origin.

1.2 Purpose. The purpose of this standard is to provide a standardized fire test procedure for evaluating the suitability of exterior non-load-bearing wall assemblies and panels used as components of curtain wall assemblies that are constructed using combustible materials or that incorporate combustible components for installation on buildings where the exterior walls are required to be noncombustible.

1.3 Application.

1.3.1 This standard shall be used to evaluate the fire propagation characteristics of exterior non-load-bearing wall assemblies and panels used as components of curtain wall assemblies that are constructed using combustible materials or that incorporate combustible components within the wall assemblies as specified in the following:

- (1) The ability of the wall assembly to resist flame propagation over the exterior face of the wall assembly
- (2) The ability of the wall assembly to resist vertical flame propagation within the combustible components from one story to the next
- (3) The ability of the wall assembly to resist vertical flame propagation over the interior surface of the wall assembly from one story to the next
- (4) The ability of the wall assembly to resist lateral flame propagation from the compartment of fire origin to adjacent compartments or spaces

1.3.2 The application of this standard to actual field installations of exterior non-load-bearing wall assemblies and panels used as components of curtain wall assemblies shall not limit the use of the methods and materials employed to seal the gap between the edge of the second floor slab and the interior surface of the test specimen during the test, provided approved sealing methods and materials are used in the field.

1.3.3 This standard requires both visual observations made by laboratory personnel conducting the test and temperature data recorded during the test.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 259, *Standard Test Method for Potential Heat of Building Materials*, 2008 edition.

2.3 Other Publications.

2.3.1 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM C 1396/C 1396M, *Specification for Gypsum Board*, 2006a.

ASTM E 84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, 2009a.

ASTM E 136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*, 2009.

2.3.2 UL Publication. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062-2096.

ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*, 2008.

2.3.3 Other Publication.

Merriam-Webster's *Collegiate Dictionary*, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 90A, *Standard for the Installation of Air-Conditioning and Ventilating Systems*, 2012 edition.

NFPA 5000®, *Building Construction and Safety Code*®, 2012 edition.



Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.4 Shall. Indicates a mandatory requirement.

3.2.5 Should. Indicates a recommendation or that which is advised but not required.

3.2.6 Standard. A document, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and which is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions shall be located in an appendix or annex, footnote, or fine-print note and are not to be considered a part of the requirements of a standard.

3.3 General Definitions.

3.3.1 Combustible Insulation. Combustible material used as insulation.

3.3.2 Combustible (Material). A material that, in the form in which it is used and under the conditions anticipated, will ignite and burn; a material that does not meet the definition of noncombustible or limited-combustible. [5000, 2012]

3.3.3* Exterior Wallcovering. A material or assembly of materials applied on the exterior side of exterior walls for the purpose of providing a weather-resisting barrier or insulation or for aesthetics.

3.3.4 Limited-Combustible (Material). Refers to a building construction material not complying with the definition of noncombustible material that, in the form in which it is used, has a potential heat value not exceeding 3500 Btu/lb (8141 kJ/kg), when tested in accordance with NFPA 259, *Standard Test Method for Potential Heat of Building Materials*, and that includes either of the following: (1) materials having a structural base of noncombustible material, with a surfacing not exceeding a thickness of $\frac{1}{8}$ in. (3.2 mm) that has a flame spread index not greater than 50; or (2) materials, in the form and thickness used, having neither a flame spread index greater than 25 nor evidence of continued progressive combustion, and of such composition that surfaces that would be exposed by cutting through the material on any plane would have neither a flame spread index greater than 25

nor evidence of continued progressive combustion when tested in accordance with ASTM E 84, *Standard Test Method of Surface Burning Characteristics of Building Materials*, or ANSI/UL 723 *Standard for Test for Surface Burning Characteristics of Building Materials*. [90A, 2012]

3.3.5 Noncombustible Material. A material that, in the form in which it is used and under the conditions anticipated, will not ignite, burn, support combustion, or release flammable vapors when subjected to fire or heat. Materials that are reported as passing ASTM E 136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*, shall be considered noncombustible materials.

3.3.6 Test Specimen. The exterior non-load-bearing wall assembly to be tested in accordance with this fire test method.

Chapter 4 Test Facility and Apparatus

4.1 Test Facility.

4.1.1 The test apparatus described in Section 4.2 shall be located inside a test facility.

4.1.2 The test facility shall have minimum dimensions of 30 ft wide \times 30 ft deep \times 23 ft high (9.1 m \times 9.1 m \times 7.0 m).

4.1.3 The test facility shall have provisions for supplying combustion makeup air taken from the outside during the test.

4.1.4 The test facility shall be constructed to allow for the exhaust of the combustion by-products during the test while not inducing an airflow on the exterior face of the test specimen.

4.1.5 The test facility shall protect the test apparatus and test specimen from exposure to wind and precipitation.

4.2 Test Apparatus.

4.2.1 The test apparatus shall consist of a two-story structure having a height of 15 ft 8 in. \pm 1 in. (4.8 m \pm 25 mm) with a test room on each story.

4.2.2 Each test room shall have unfinished inside dimensions of 10 ft \pm 0.5 in. wide \times 10 ft \pm 0.5 in. deep (3.05 m \pm 13 mm \times 3.05 m \pm 13 mm) with an unfinished floor-to-ceiling height of 7 ft \pm 0.5 in. (2.13 m \pm 13 mm).

4.2.3* The test apparatus shall be constructed in accordance with Figure 4.2.3.

4.2.4 The slabs shall be constructed of reinforced concrete.

4.2.5 The upper two slabs shall be supported by steel columns designed to support the loads, and the columns shall not be located inside the test rooms.

4.2.6 The thickness of the concrete slabs shall be as follows:

- (1) The first-story slab shall be not less than 6 in. (152 mm) thick.
- (2) The second-story slab shall be 8 in. \pm 0.5 in. (203 mm \pm 13 mm) thick.
- (3) The top slab shall be not less than 6 in. (152 mm) thick.

4.2.7 The three permanent walls (one rear wall and two side walls) that form each test room shall be constructed of nominal 8 in. (203 mm) concrete block or equivalent construction.

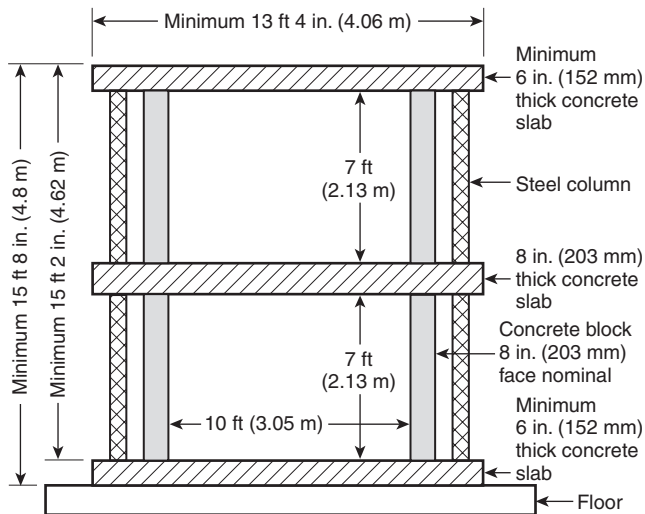


FIGURE 4.2.3 Front View of Test Apparatus Structure (not to scale). For exact dimensions, see 4.2.1 through 4.2.7.

4.2.8 The interior surfaces of the first-story test room shall be protected as follows:

- (1) The walls and ceiling shall be covered with one layer of nominal $\frac{5}{8}$ in. (16 mm) thick Type X gypsum wallboard conforming to ASTM C 1396/C 1396M, *Specification for Gypsum Board*, and one layer of nominal 1.5 in. (38 mm) thick nominal 8 lb/ft³ (128 kg/m³) density ceramic fiber insulation on the interior face.
- (2) The slab shall be covered with two layers of nominal $\frac{5}{8}$ in. (16 mm) thick gypsum wallboard.

4.2.9 Insulation shall not be required in the second-story test room.

4.2.10 Each story shall have one access opening approximately 3.5 ft wide \times 6.75 ft high (1.1 m \times 2.1 m).

4.2.11 The first-story access opening shall be located in one of the side walls, and the second-story access opening shall be located in the rear wall of the test room.

4.2.12 The access door opening for the first-story test room shall be capable of being closed during the fire test.

4.2.13 Additional access openings shall be permitted in the second-story test room walls for instrumentation and video recording.

4.3 Movable Test Frame.

4.3.1 The movable test frame shall comply with 4.3.1.1 through 4.3.1.3.

4.3.1.1 The frame shall be designed such that the nominal 4 in. \times 4 in. \times $\frac{3}{16}$ in. (102 mm \times 102 mm \times 5 mm) angles meet at the top of the respective floor lines on the test apparatus.

4.3.1.2 The frame shall be constructed to prevent racking or movement of the wall assembly during movement of the frame and fastening of the frame to the test apparatus.

4.3.1.3 The frame shown in Figure 4.3.1.3 shall be used to determine the minimum size of the wall assembly.

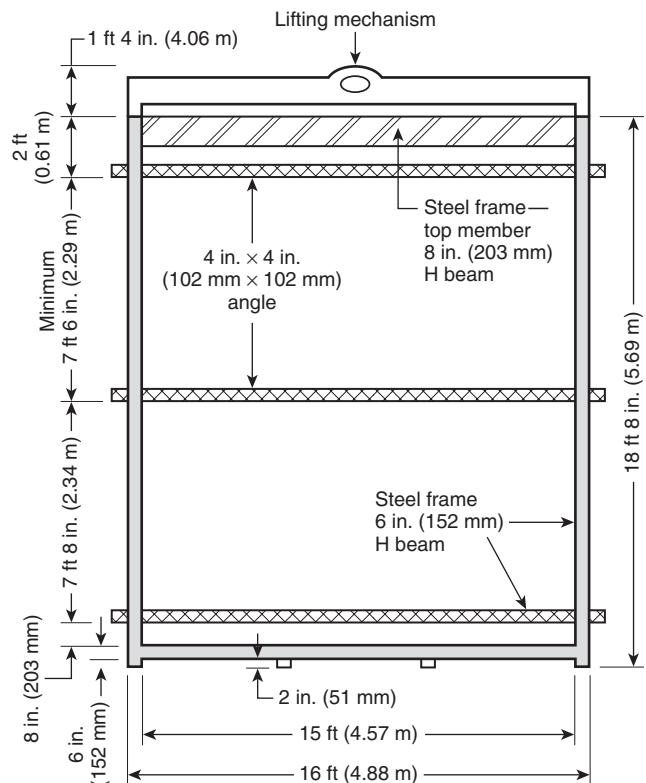


FIGURE 4.3.1.3 Front View of Movable Wall Frame (not to scale).

4.4 Burners.

4.4.1 The burner arrangement shall consist of two gas-fired burners.

4.4.2 One burner shall be placed inside the first-story test room, and the other burner shall be placed near the top of the first-story window opening of the test specimen, as required by Chapter 7.

4.4.3 The test room burner shall comply with 4.4.3.1 through 4.4.3.6.

4.4.3.1 The test room burner shall be constructed of nominal 2 in. (51 mm) outside diameter steel pipe with nominal $\frac{1}{8}$ in. (3 mm) diameter holes spaced a nominal 1 in. (25 mm) on center.

4.4.3.2 The burner holes shall be located along the top surface of the pipe.

4.4.3.3 The first hole shall be located 3.5 ft \pm 1 in. (1.06 m \pm 25 mm) from the rear wall on both sides of the gas supply pipes and continue across the front gas supply pipe.

4.4.3.4 The gas supply pipe located within the test room shall be wrapped with a single layer of nominal 1 in. (25 mm) thick nominal 8 lb/ft³ (128 kg/m³) density ceramic fiber blanket.

4.4.3.5 The burner shall be positioned with its centerline 2.5 ft \pm 1 in. (0.8 m \pm 25 mm) above the floor surface of the test facility.

4.4.3.6* Figure 4.4.3.6 shall be used to determine the design of the first-story test room burner.

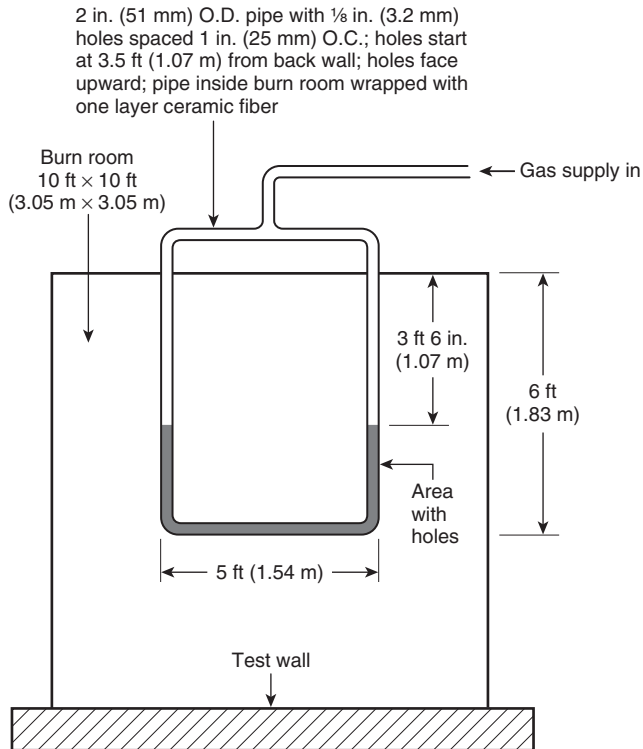


FIGURE 4.4.3.6 Burn Room Burner — Plan View (not to scale).

4.4.4 The window gas burner shall consist of a 60 in. \pm 0.5 in. (1520 mm \pm 13 mm) length of nominal 2 in. (51 mm) outside diameter pipe having a 0.5 in. \pm 0.06 in. wide \times 44 in. \pm 0.5 in. long (13 mm \pm 1.5 mm \times 1118 mm \pm 13 mm) slot.

4.4.5 The burner shall be supplied with gas at both ends through nominal 1 in. (25 mm) outside diameter pipe.

4.4.6 Figure 4.4.6 shall be used to determine the design of the window burner.

4.4.7 The window burner shall be wrapped with a layer of nominal 1 in. (25 mm) thick nominal 8 lb/ft³ (128 kg/m³) density ceramic fiber blanket.

4.4.8 The burner shall be permitted to be mounted on a movable trolley.

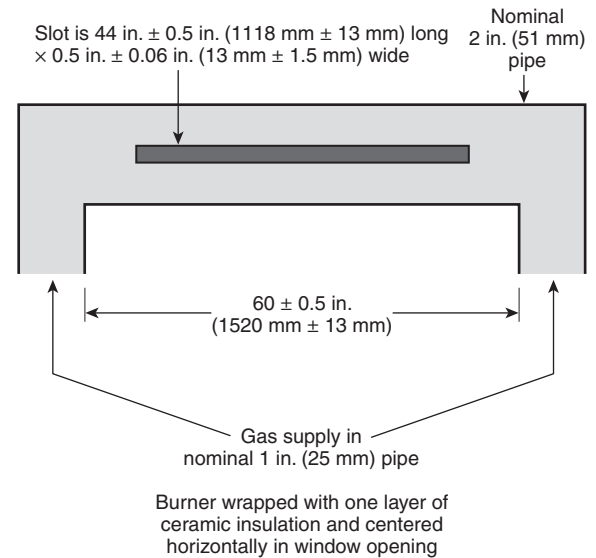


FIGURE 4.4.6 Plan View of Window Burner (not to scale).

4.4.9 During the fire test, the burner shall be positioned so the slot is located on the top surface of the pipe and centered horizontally in the first-story test room window opening.

4.4.10 The horizontal centerline of the burner shall be positioned 9 in. \pm 0.5 in. (230 mm \pm 13 mm) below the bottom surface of the window opening header.

4.4.11 The vertical centerline of the burner shall be positioned between 0 in. and 5 in. (0 mm and 130 mm) from the exterior face of the wall assembly.

4.4.12 The final position of the window burner from the exterior face of the wall assembly shall be determined from the calibration procedure.

4.4.13* The burners shall be fired during the fire test according to the calibration gas flow rates shown in Table 4.4.13.

4.4.14 Each burner shall attain its prescribed gas flow rate within 15 seconds of each specified change in the gas flow rate.

4.4.15 During the calibration procedure, if it is demonstrated that the burners must follow different gas flow rates to attain the prescribed test room and exterior face temperatures and heat fluxes, then the gas flows determined from the calibration tests shall be used.

Table 4.4.13 Calibration Gas Flow Rates (Based on Natural Gas)

Time Interval	Room Burner				Window Burner			
	SCFM	m ³ /min	kW	Btu/min	SCFM	m ³ /min	kW	Btu/min
0:00–5:00	38.0	1.08	687	39,064	0.0	0.00	0	0
5:00–10:00	38.0	1.08	687	39,064	9.0	0.25	163	9,252
10:00–15:00	43.0	1.22	777	44,204	12.0	0.34	217	12,336
15:00–20:00	46.0	1.30	831	47,288	16.0	0.45	289	16,448
20:00–25:00	46.0	1.30	831	47,288	19.0	0.54	343	19,532
25:00–30:00	50.0	1.42	904	51,400	22.0	0.62	398	22,616

Chapter 5 Test Specimens

5.1 Location of Test Specimens. The test specimens shall be constructed on the front face of the test apparatus or on the movable test frame specified in 4.3.1.

5.2 Specimen Mounting. Figure 5.2(a) through Figure 5.2(c) shall be used to determine the test specimen mounting on the front face of the test apparatus.

5.3 Size of Test Specimen. The test specimen shall be not less than 17.5 ft high \times 13.3 ft wide (5.3 m high \times 4.1 m wide).

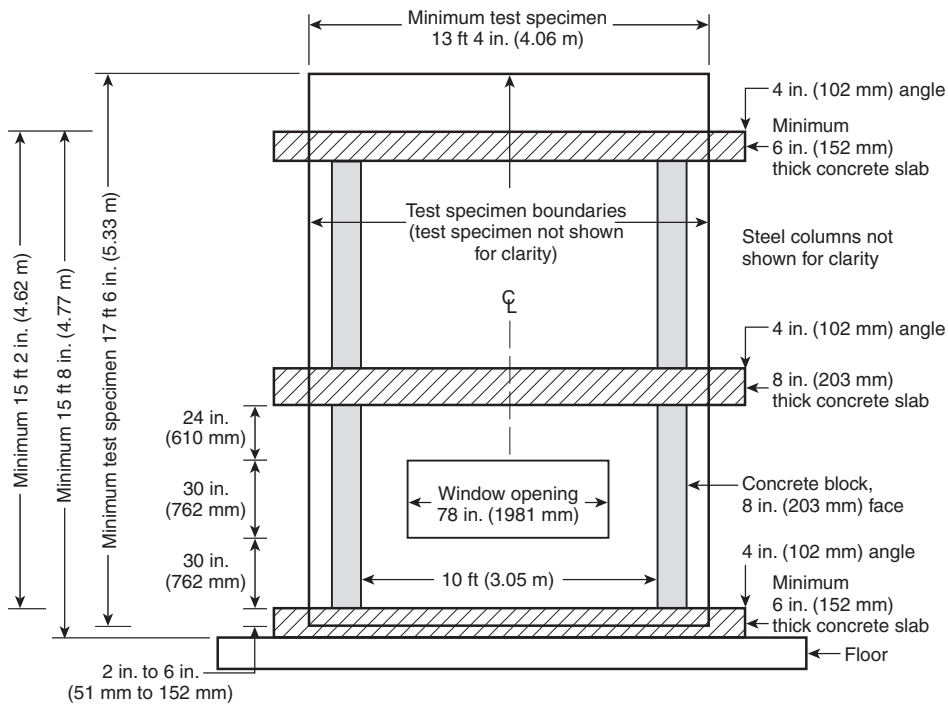


FIGURE 5.2(a) Front View of Test Specimen Superimposed over Test Apparatus (not to scale).

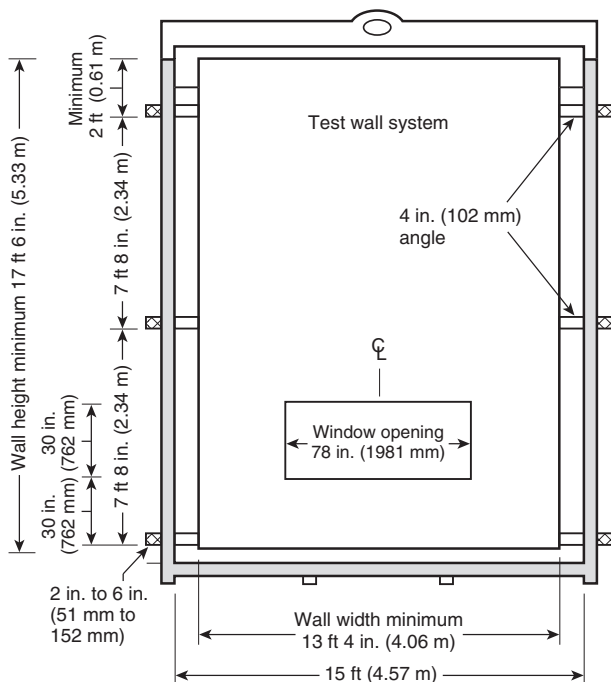


FIGURE 5.2(b) Front View of Test Specimen in Movable Test Frame (not to scale).

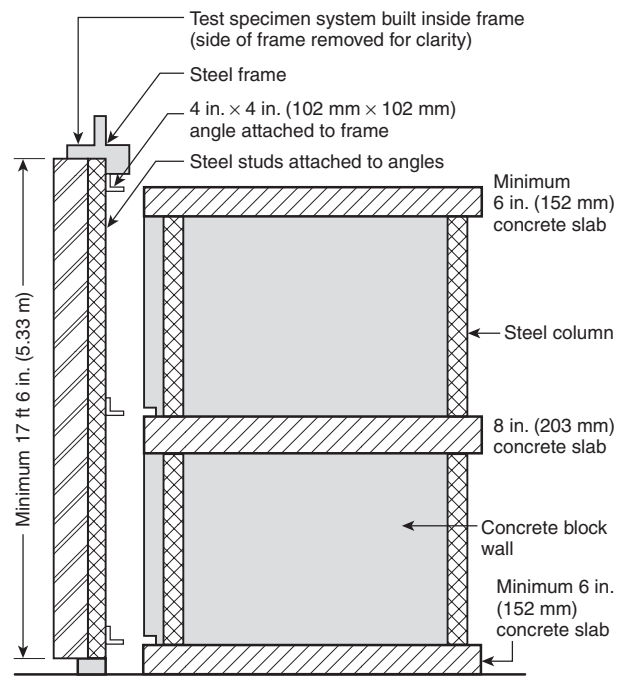


FIGURE 5.2(c) Side View of Test Apparatus with Test Specimen in Movable Test Frame (not to scale).

5.4 Position of Test Specimen.

5.4.1 The edges of the test specimen shall be positioned on the test apparatus as follows:

- (1) Below the top of the first-story slab, not less than 2 in. (51 mm)
- (2) Above the top of the top slab, not less than 2 ft (0.6 m)
- (3) Beyond the outside face of each side wall, not less than 1 ft (0.305 m)

5.4.2 The test specimen shall completely cover the front face of the test apparatus except for a window opening located in the test specimen at the first story.

5.5 Window Opening.

5.5.1 The window opening shall be 30 in. \pm 0.5 in. high \times 78 in. \pm 0.5 in. wide (760 mm \pm 13 mm high \times 1980 mm \pm 13 mm wide), with a sill height of 30 in. \pm 0.5 in. (760 mm \pm 13 mm) above the top of the first-story test room slab.

5.5.2 The window opening shall be centered horizontally with respect to the test room.

5.6 Securing Test Specimen to Test Apparatus.

5.6.1 The test specimen shall be secured to the test apparatus using a girt system of replaceable nominal 4 in. \times 4 in. \times $\frac{3}{16}$ in. (102 mm \times 102 mm \times 5 mm) steel angles.

5.6.2 A removable spandrel beam shall be mounted on the underside of the second-story floor slab where required for the attachment of the test specimen to the test apparatus.

5.6.2.1* Where used, the spandrel beam shall be a W8 \times 21 (W200 \times 31) wide flange steel beam.

5.6.2.2 Where used, the spandrel beam shall extend completely across the burn room compartment between the interior wall surfaces of the two side walls of the first-story test room.

5.6.2.3 Where used, the spandrel beam shall be either protected or unprotected at the discretion of the test laboratory or the client.

5.6.2.4 Where the spandrel beam is used and it has been determined that it will be protected, one layer of nominal 1 in. (25 mm) thick nominal 6 lb/ft³ (96 kg/m³) ceramic fiber blanket shall be used to protect the beam.

5.6.2.5 Outriggers and other connections provided to the spandrel beam shall not be protected.

5.7 Construction Details of Test Specimen.

5.7.1 The test specimen shall be constructed and secured to the test apparatus using fastening and construction details representative of actual field installations as specified by the manufacturer.

5.7.2* Details of the construction of the test specimen shall be in accordance with the manufacturer's instructions.

5.7.2.1 The framing system used to support the wall assembly that makes up the test specimen shall consist of steel studs.

5.7.3* Where the test specimen contains vertical or horizontal joints or seams, joints or seams representative of standard construction practices shall be incorporated into the test specimen.

5.8 Curing Period. Prior to the fire test, the test specimen shall be cured as required by the manufacturer.

5.8.1 In the case of cementitious coatings or materials, not less than 28 days shall elapse from completion of construction of the test specimen to fire testing the test specimen.

5.8.2 During the curing period, the wall assemblies shall be protected from exposure to the weather.

Chapter 6 Instrumentation

6.1* Temperature Measurements. Temperature measurements shall be taken at the following locations:

- (1) Exterior wall surface of the test specimen, as shown in Figure 6.1(a)
- (2) Combustible insulation in the exterior wall panel of the test specimen, where applicable, as shown in Figure 6.1(a) and in Figure 6.1(b), Details A and B
- (3) Cavity air space within the test specimen, where applicable, as shown in Figure 6.1(a) and in Figure 6.1(b), Detail D and Details F through I
- (4) Wall cavity insulation and stud cavity insulation, where applicable, as shown in Figure 6.1(a) and in Figure 6.1(b), Details B through I
- (5) Interior surface of the test specimen, as shown in Figure 6.1(c)
- (6) Below the first-story test room ceiling, as shown in Figure 6.1(d)
- (7) For other locations, as shown in Figure 6.1(a) and in Figure 6.1(b), Details A through I, as applicable, for the test specimen construction being tested

6.2 Gas Flow Meters. Each burner shall have gas flow metering equipment to measure the expected flow rates for each burner to within 5 percent.

6.3 Thermocouples. Temperature measurements shall be made using 20-gauge Type K thermocouples, except that those used to measure the temperatures shown in Figure 6.1(d) shall be 18-gauge Type K thermocouples.

Chapter 7 Calibration Procedure

7.1 Calibration Test Procedure. A calibration test shall be performed in accordance with this chapter to determine the gas flow rates of the gas burners to be used in the fire test procedure prescribed in Chapter 8.

7.1.1* The test specimen for the calibration test shall be constructed of two layers of nominal $\frac{5}{8}$ in. (16 mm) thick Type X gypsum wallboard, conforming to ASTM C 1396/C 1396M, *Specification for Gypsum Board*, applied to both sides of nominal 18-gauge steel studs spaced 24 in. (610 mm) on center.

7.1.2 Joints shall be taped or caulked.

7.1.3 The test specimen shall have a height not less than 18 ft (5.5 m) above the floor surface of the test facility and shall have a width not less than 14 ft (4.3 m).

7.1.4 The perimeter of the window opening shall be completely covered with a layer of nominal $\frac{5}{8}$ in. (16 mm) thick Type X gypsum wallboard.



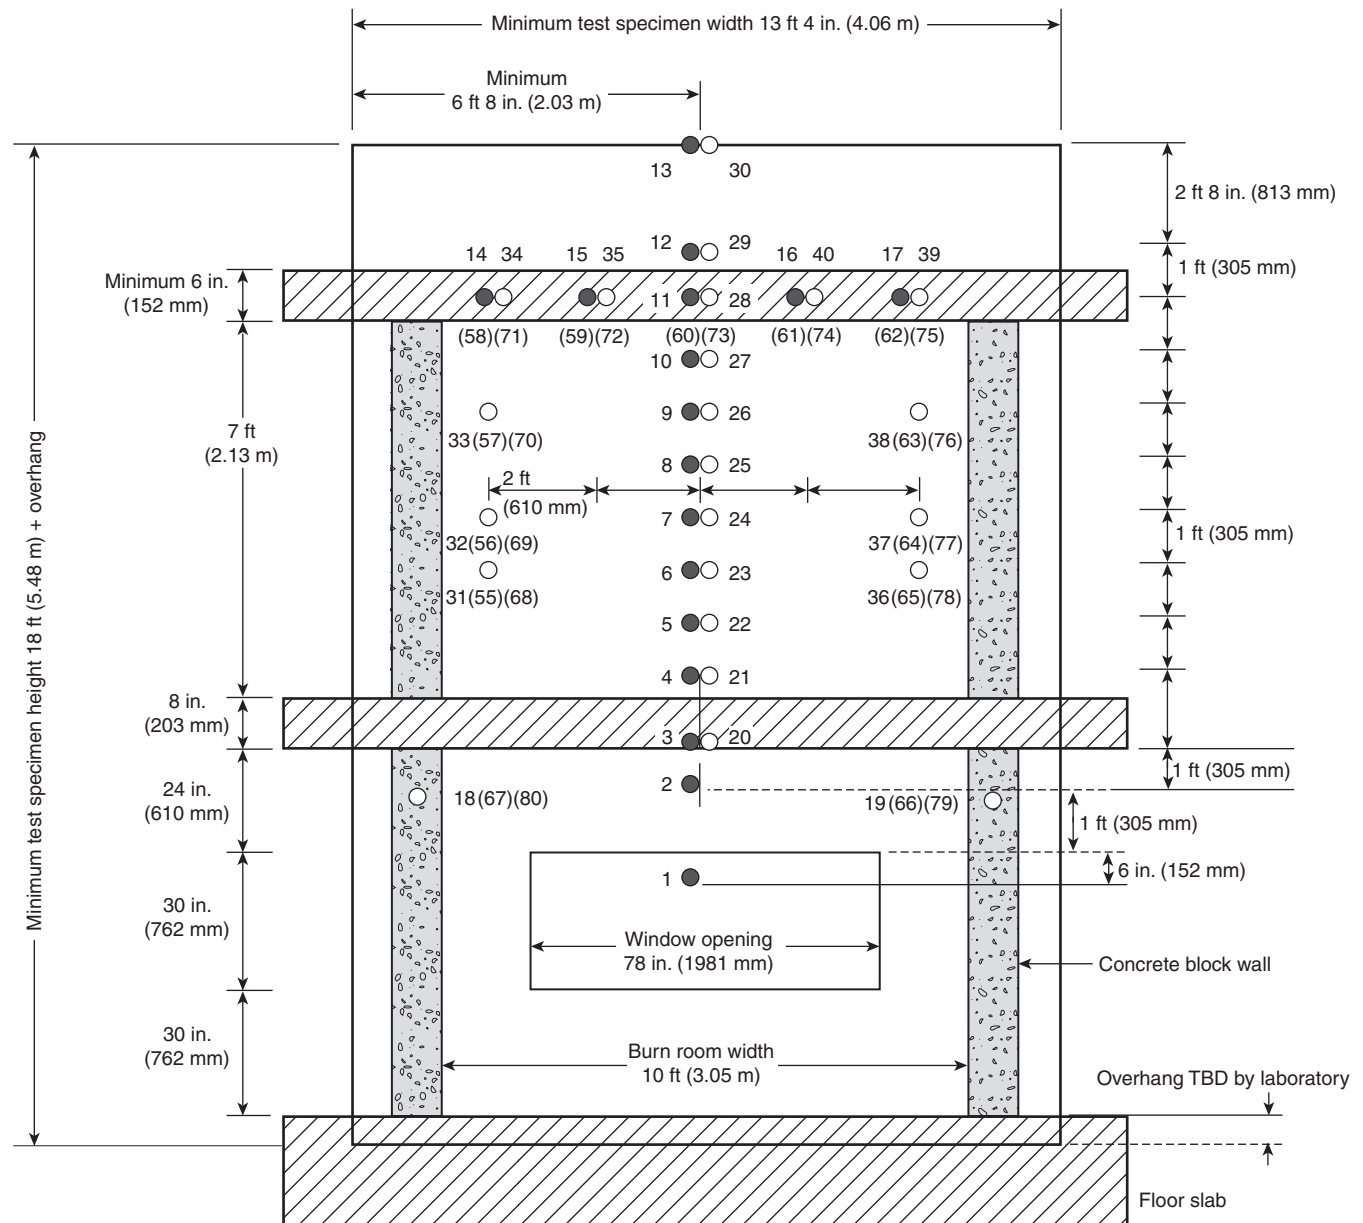


Figure not to scale


FIGURE 6.1(a) Front View of Test Specimen Superimposed over Test Apparatus Thermocouple Locations.

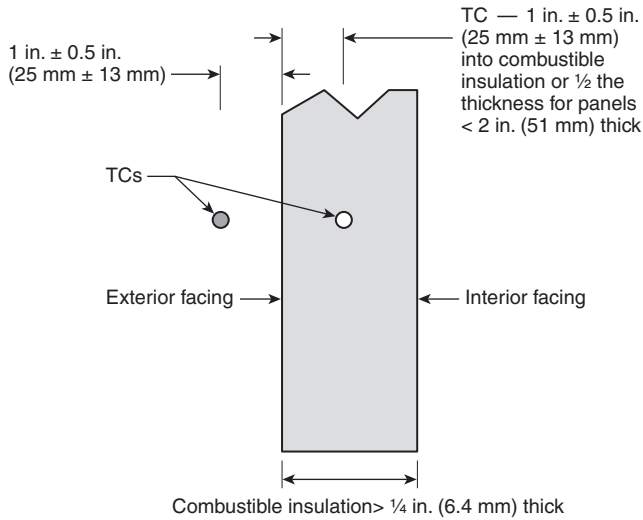

Detail A



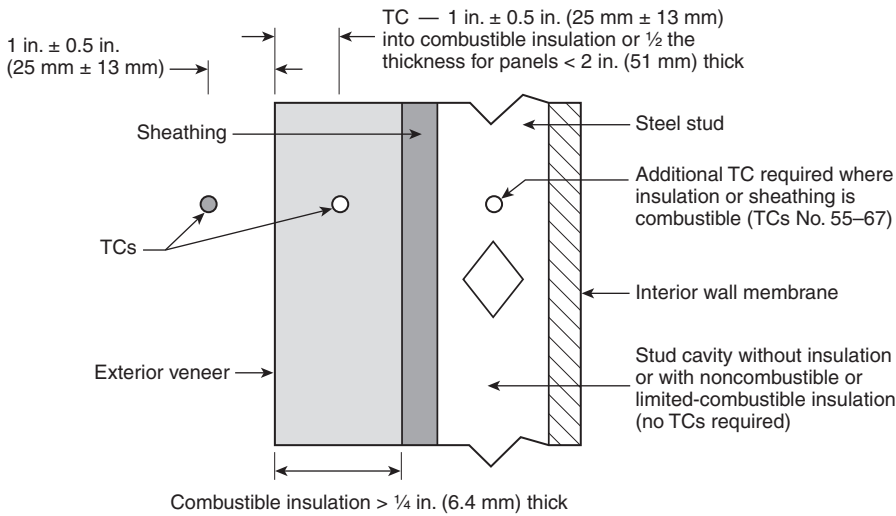


Detail B

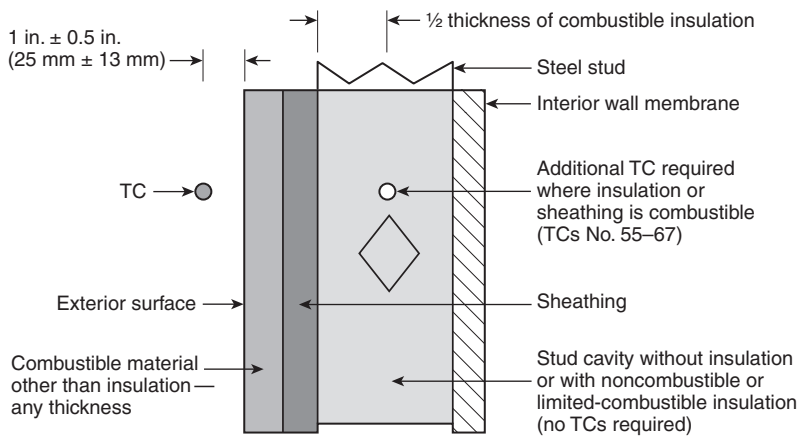

Detail C

FIGURE 6.1(b) Instrumentation Arrangement.

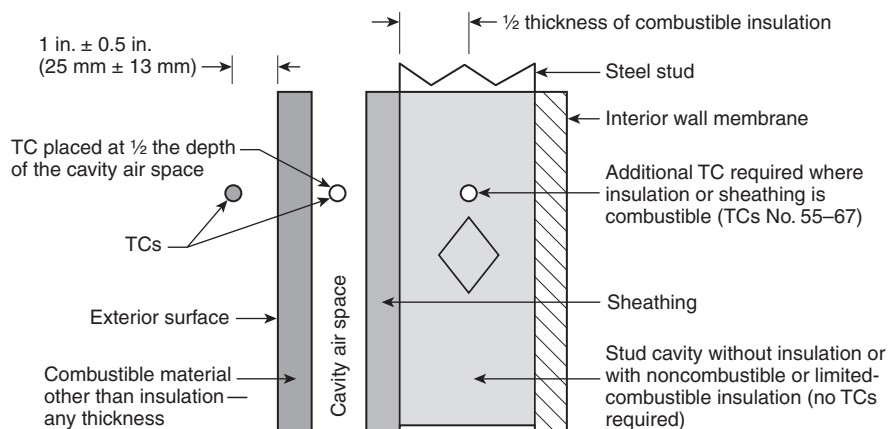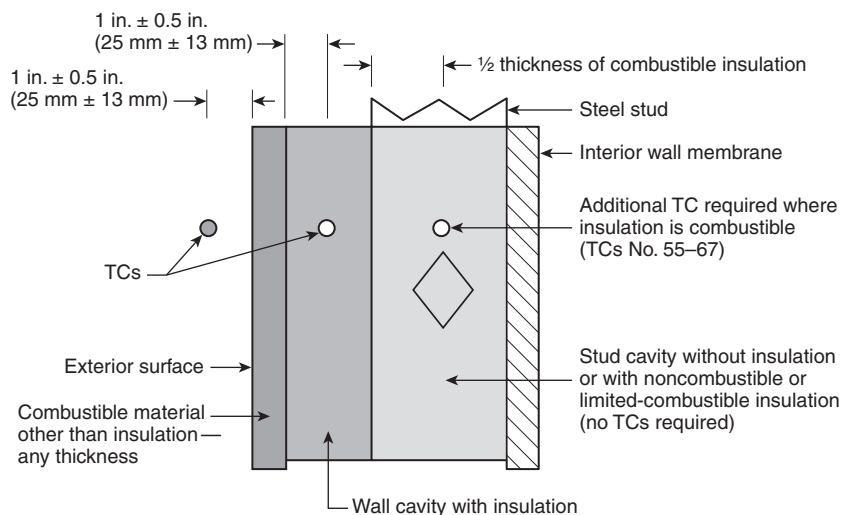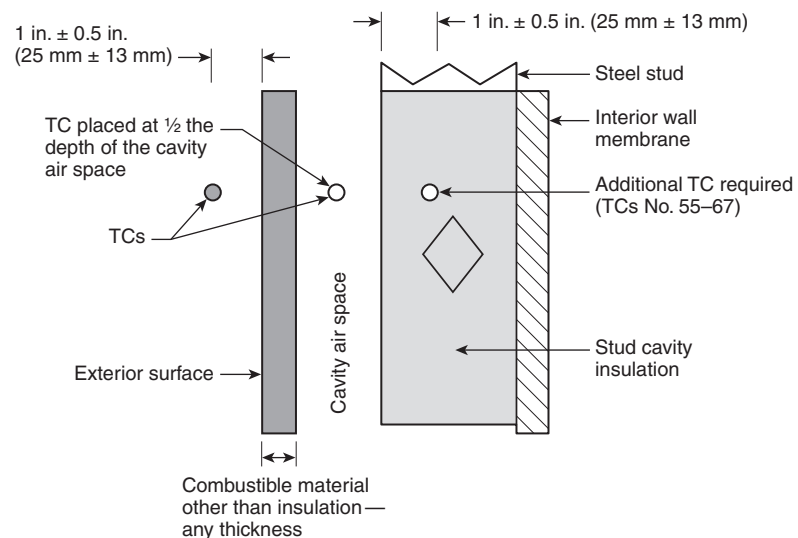FIGURE 6.1(b) *Continued*

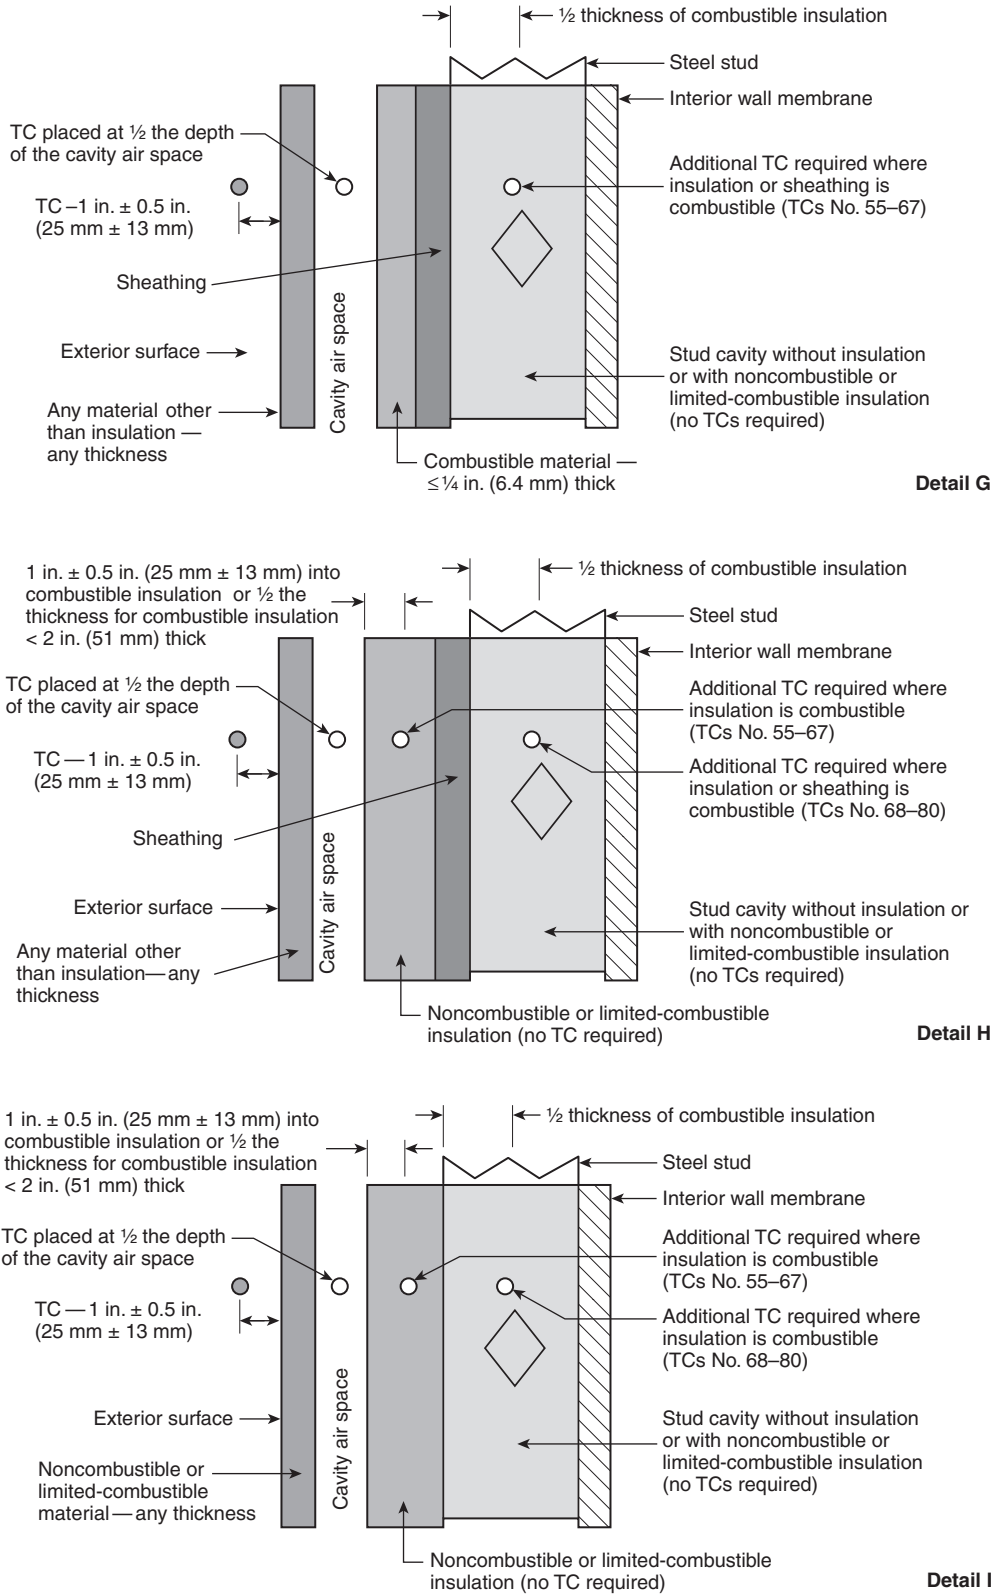


FIGURE 6.1(b) *Continued*

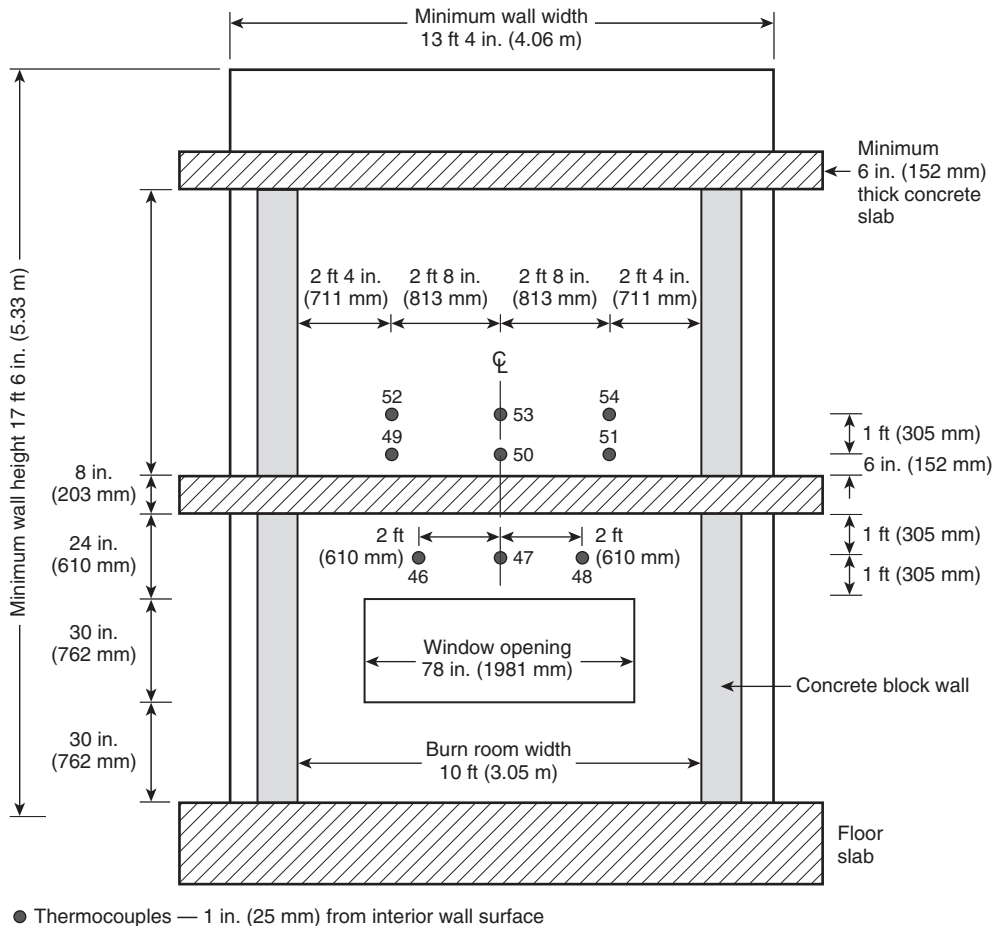


FIGURE 6.1(c) Interior View of the Test Specimen. Instrumentation arrangement.

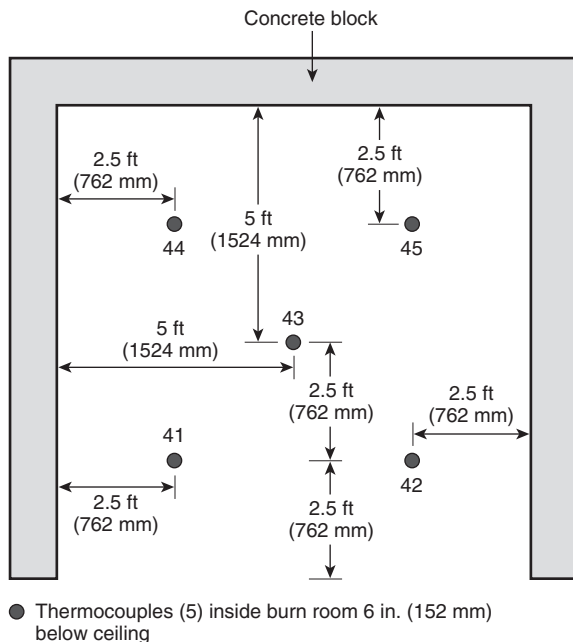


FIGURE 6.1(d) Plan View — First-Story Test Room. Instrumentation arrangement.

7.1.5 A spandrel beam shall not be used.


7.1.6 Calibration instrumentation shall consist of not less than the following:

- (1) Temperature measurements taken at the locations shown in Figure 7.1.6(a) and Figure 7.1.6(b) using nominal 20-gauge, Type K thermocouples, and those used to measure the temperatures at the locations shown in Figure 7.1.6(c) must be nominal 18-gauge, Type K thermocouples
- (2) No fewer than three 0–5 W/cm² circular foil total heat flux gauges located as shown in Figure 7.1.6(a)
- (3) Gas flow rate measurement equipment for each of the burners

7.1.7 Prior to the conduct of the calibration test, the paper facing of the gypsum wallboard on the exterior face of the calibration wall assembly shall be burned away by igniting both the room burner and the window burner and immediately adjusting the burners to their maximum flow rates as prescribed in Table 4.4.13 for not less than 5 minutes at these gas flow rates.

7.1.8 The calibration test shall be conducted with the gas burners supplied during the test according to the calibration gas flow rates prescribed in Table 4.4.13.


7.1.9 Each burner shall be flowing gas at its prescribed gas flow rate within 15 seconds of each prescribed change in the gas flow rate.



7.1.17 If it is demonstrated that the burners must follow different flow rates in order to attain the prescribed burn room and/or



FIGURE 7.1.6(b) Interior View of the Calibration Wall Assembly. Thermocouple locations (not to scale).



7.1.20 The window burner shall be recalibrated prior to the next test to be consistent with the flame height measurements

Table 7.1.11 Calibration Average Values for Time Periods Indicated

Thermocouple Location and Numbers	Temperature											
	0–5 min		5–10 min		10–15 min		15–20 min		20–25 min		25–30 min	
	°F	°C	°F	°C	°F	°C	°F	°C	°F	°C	°F	°C
Test room ceiling: Nos. 18–22	1151	622	1346	730	1482	806	1600	871	1597	869	1648	898
Interior wall surface of test room: Nos. 15–17	1065	574	1298	703	1433	778	1578	859	1576	858	1655	902
1 ft (305 mm) above top of window opening: No. 2	602	317	870	466	952	511	992	533	1046	563	1078	581
2 ft (610 mm) above top of window opening: No. 3	679	359	1015	546	1121	605	1183	639	1245	674	1296	702
3 ft (914 mm) above top of window opening: No. 4	646	341	971	521	1096	591	1174	634	1245	674	1314	712
4 ft (1219 mm) above top of window opening: No. 5	577	302	858	459	982	528	1063	573	1135	613	1224	662
5 ft (1524 mm) above top of window opening: No. 6	521	272	765	407	875	469	949	509	1007	542	1106	597
6 ft (1829 mm) above top of window opening: No. 7	472	244	690	366	787	419	856	458	913	489	1010	543
Calorimeter Locations and Numbers	Heat Flux (W/cm ²)											
	0–5 min		5–10 min		10–15 min		15–20 min		20–25 min		25–30 min	
2 ft (610 mm) above top of window opening: No. C–2ft	0.9 ± 0.2		1.9 ± 0.4		2.5 ± 0.5		2.9 ± 0.6		3.4 ± 0.7		3.8 ± 0.8	
3 ft (914 mm) above top of window opening: No. C–3ft	1.0 ± 0.2		2.0 ± 0.4		2.6 ± 0.5		3.2 ± 0.6		3.7 ± 0.7		4.0 ± 0.8	
4 ft (1219 mm) above top of window opening: No. C–4ft	0.8 ± 0.2		1.5 ± 0.3		2.0 ± 0.4		2.5 ± 0.5		3.0 ± 0.6		3.4 ± 0.7	

and visual observations taken in 7.1.19 when any of the following occurs:

- (1) The ceramic blanket covering the window burner is replaced.
- (2) The burner output distribution has been adversely affected by the accumulation of burning or melting debris, causing a change in the flame geometry.
- (3) The burner output distribution has been adversely affected by the impact of falling debris on the blanket, causing a change in the flame geometry.

7.1.20.1 The same flow rate as in the full-scale calibration test during the 5–10 minute time period shall be used.

7.1.20.2 The ceramic blanket shall be adjusted so that the flame heights at the three specified locations are measured to the same nominal height and look visually similar to that as measured and video recorded respectively in 7.1.19.

7.2 Frequency of Calibration. Calibration shall be performed in the following circumstances:

- (1) Initially, prior to the first wall assembly test
- (2) When significant changes to the gas flow systems are made (e.g., flowmeters are new)
- (3) Within 1 year prior to the test of an actual product wall assembly
- (4) When the ceramic blankets covering more than 50 percent of the wall or ceiling surface in the burn room are replaced

Chapter 8 Fire Test Procedure

8.1 Fire Test Procedure.

8.1.1 The fire test procedure shall be in accordance with 8.1.2 through 8.1.13.

8.1.2 The thermocouples installed on the completed test specimen shall be checked to verify that they are operating correctly.

8.1.3 Prior to final positioning of the window burner, the window burner shall be fired and the resultant flame verified and adjusted as required. Verification of the flame shall consist of visual observation of a consistent flame height over the width of the burner.

8.1.4 The placement of the window burner shall be verified to be in accordance with 4.4.9 through 4.4.12 and 7.1.18.

8.1.5 Ambient conditions at the start of the fire test shall be as follows:

- (1) The temperature of the air in the test facility shall be between 50°F and 90°F (10°C and 32°C).
- (2) The relative humidity of the air in the test facility shall be between 20 percent and 80 percent.
- (3) Airflow across the exterior face of the test specimen shall be less than 4.4 ft/sec (1.3 m/sec), as determined by an anemometer placed at a right angle to the exterior face and located within 3 ft (1 m) of the exterior face. The anemometer shall be of the hot wire or vane type and shall have an accuracy of 1 ft/min (305 mm/min).

8.1.6 The gas supply to the test room burner shall be turned on and the burner ignited.

8.1.7 The gas flow rates established in accordance with 4.4.13 through 4.4.15 and 7.1.17 shall be followed for test room burners and the window burner.

8.1.8 At 5 minutes \pm 5 seconds after ignition of the test room burner, the gas supply to the window burner shall be turned on and the burner ignited.

8.1.9 At 30 minutes \pm 5 seconds after ignition of the test room burner, the gas supply to both burners shall be shut off.

8.1.10 Any residual burning on the test specimen shall not be extinguished until not less than 10 minutes after the gas supply is shut off, unless the test laboratory determines that extinguishment is required to maintain safe conditions in the test facility.

8.1.11 The access opening for the second-story test room shall remain open during the fire tests.

8.1.12 Any additional access openings in the second-story test room shall be closed during the fire test.

8.1.13 The window opening shall be the only opening permitted to be open in the first-story test room during the fire test.

Chapter 9 Data Collection and Observation

9.1 Duration.

9.1.1 Video recording and data collection shall be started not less than 1 minute prior to ignition of the test room burner.

9.1.2 Video recording, data collection, and visual observations shall be continued until residual burning has stopped but not before not less than 10 minutes has elapsed after the gas supply to the burners is shut off.

9.2 Data Recording. Measurements of the temperatures at the locations specified in Section 6.1 and the gas flows specified in 8.1.6 shall be recorded at intervals not to exceed 15 seconds.

9.3 Ambient Conditions. The ambient conditions specified in 8.1.4 shall be recorded at the start of the fire test.

9.4 Visual Observations.

9.4.1 Visual observation of the test specimen and its performance shall be recorded and documented in accordance with the following:

- (1) Color photographs or digital images of the exterior face of the test specimen taken during construction of the test specimen, during the fire test at the rate of not less than once every minute, at the end of the fire test, and after the fire test, including the 10-minute post-fire-test period and the dissection of the test specimen
- (2) Color video recording of the exterior face of the test specimen taken prior to, during, and after the fire test, showing the laboratory test report identification number and the test date
- (3)*Color video recording taken of the test specimen-floor intersection in the second-story test room during the fire test
- (4) Color photographs or digital images taken of the interior face of the test specimen before and after the fire test

9.4.2 The color video recordings shall include a clock or a timer depicting real time.

9.4.3 The timer in 9.4.2 shall be integral to the video camera unless a clock or timer that is clearly viewed throughout the fire test is used.

9.5 Determination of Extent and Depth of Damage. The test specimen shall be dismantled and dissected to determine the extent and the depth of damage within the combustible components and the condition of the test specimen's exterior wall panel facings.

Chapter 10 Conditions of Acceptance

10.1 Test Specimen. The performance of the test specimen shall be determined on the basis of visual observations both during and after the test in conjunction with the temperature data obtained during the fire test.

10.2 Performance Criteria. The test specimen shall be considered as passing the fire test when the performance criteria specified in 10.2.1 through 10.2.6 are met during the 30-minute fire exposure specified in Chapter 8.

10.2.1 Flame Propagation: Exterior Face of Test Specimen.

10.2.1.1 Flame propagation on the exterior face of the test specimen shall not occur either vertically or horizontally beyond the area of flame plume impingement by the window burner flames.

10.2.1.2 Flame propagation shall be determined to occur if any one of the following conditions is measured or observed:

- (1) A temperature of 1000°F (538°C) is measured by any one of the thermocouples nos. 11 and 14 through 17, as shown in Figure 10.2.1.2.
- (2) Flames emitting from the surface of the exterior face of the test specimen reach a height of 10 ft (3.05 m) or greater above the top of the window opening, as shown in Figure 10.2.1.2.
- (3) Flames emitting from the surface of the exterior face of the test specimen reach a horizontal distance of 5 ft (1.52 m) or greater from the vertical centerline of the window opening, as shown in Figure 10.2.1.2.



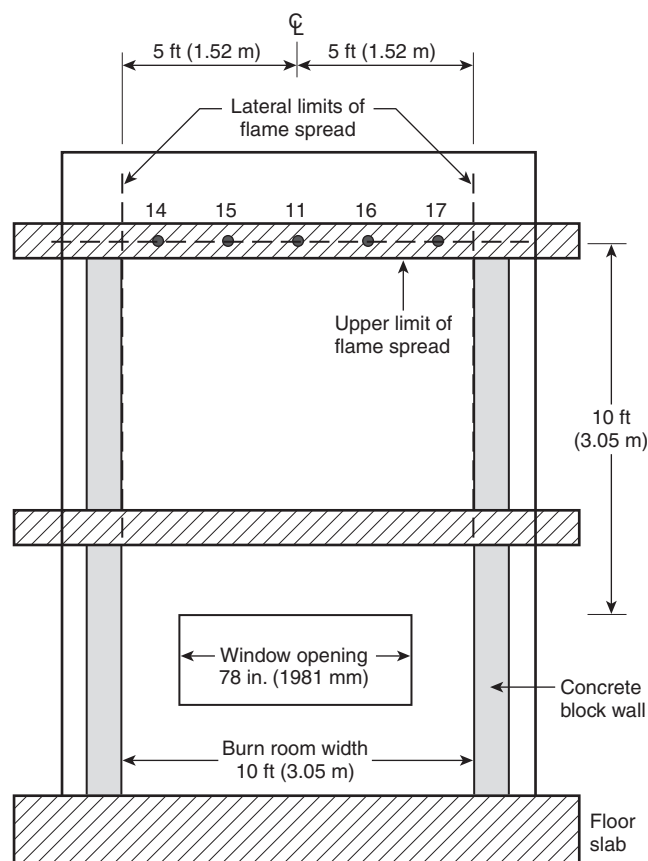


FIGURE 10.2.1.2 Limits of Flame Propagation — Exterior Surface of Test Specimen (not to scale).

10.2.2 Vertical Flame Propagation: Combustible Components and Insulation. Flame propagation shall not occur vertically through the combustible components or the combustible insulation installed within the test specimen, as determined in accordance with the following:

- (1) For test specimens constructed of exterior wall panels greater than $\frac{1}{4}$ in. (6.4 mm) thick containing combustible components, temperatures in the combustible components shall not exceed 750°F (417°C) above their temperature as measured immediately after the start of the test by thermocouple nos. 28 and 31 through 40, as shown in Figure 6.1(a) and in Figure 6.1(b), Details A and B.
- (2) For test specimens constructed of exterior wall panels containing combustible components and having a wall cavity with an air space as shown in Figure 6.1(a) and in Figure 6.1(b), Details C, E, F, and I, the following conditions shall be met:
 - (a) Temperatures in the wall cavity air space shall not exceed 1000°F (538°C) as measured by thermocouples nos. 28 and 31 through 40.
 - (b) Temperatures in the wall cavity and stud cavity insulation shall not exceed 750°F (417°C) above their temperature as measured immediately after the start of the fire test by thermocouples nos. 55 through 65 and 68 through 79, as applicable.

- (3) For test specimens constructed of exterior wall panels that are $\frac{1}{4}$ in. (6.4 mm) thick or less, containing combustible components and having a wall cavity without an air space, temperatures in the wall cavity and stud cavity insulation shall not exceed 750°F (417°C) above their temperature as measured immediately after the start of the fire test by thermocouples nos. 28, 31 through 40 and 55 through 65, as applicable, as shown in Figure 6.1(a) and in Figure 6.1(b), Detail D.
- (4) For test specimens constructed of noncombustible or limited-combustible exterior wall panels and having a wall cavity with an air space as shown in Figure 6.1(a) and in Figure 6.1(b), Details G, H and I, the following conditions shall be met:
 - (a) Temperatures in the wall cavity air space shall not exceed 1000°F (538°C) as measured by thermocouples nos. 28 and 31 through 40.
 - (b) Temperatures in the wall cavity and stud cavity insulation shall not exceed 750°F (417°C) above their temperature as measured immediately after the start of the fire test by thermocouples nos. 55 through 65 and 68 through 78, as applicable.

10.2.3 Horizontal Flame Propagation: Combustible Components and Insulation.

10.2.3.1 Flame propagation shall not occur horizontally through the combustible components or the combustible insulation installed within the test specimen, as determined in accordance with the following:

- (1) For test specimens constructed of exterior wall panels greater than $\frac{1}{4}$ in. (6.4 mm) thick containing combustible components, temperatures in the combustible components shall not exceed 750°F (417°C) above their temperature measured immediately after the start of the fire test by thermocouples nos. 18 and 19, as shown in Figure 6.1(a) and in Figure 6.1(b), Details A and B.
- (2) For test specimens constructed of exterior wall panels containing combustible components and having a wall cavity with an air space as shown in Figure 6.1(a) and in Figure 6.1(b), Details C, E, F, and I, the following conditions shall be met:
 - (a) Temperatures in the wall cavity air space shall not exceed 1000°F (538°C) as measured by thermocouples nos. 18 and 19.
 - (b) Temperatures in the wall cavity and stud cavity insulation shall not exceed 750°F (417°C) above their temperature as measured immediately after the start of the fire test, by thermocouples nos. 66 and 67 and nos. 79, and 80, as applicable.
- (3) For wall assemblies constructed of exterior wall panels that are $\frac{1}{4}$ in. (6.4 mm) thick or less containing combustible components and having a wall cavity without an air space, temperatures in the wall cavity and stud cavity insulation shall not exceed 750°F (417°C) above their temperature as measured immediately after the start of the test by thermocouples nos. 18, 19, 66, and 67, as applicable, as shown in Figure 6.1(a) and in Figure 6.1(b), Detail D.

- (4) For test specimens constructed of noncombustible or limited-combustible exterior wall panels and having a wall cavity with an air space as shown in Figure 6.1(a) and in Figure 6.1(b), Details G, H and I, the following conditions shall be met:

- (a) Temperatures in the wall cavity air space shall not exceed 1000°F (538°C) as measured by thermocouples nos. 18 and 19.
- (b) Temperatures in the wall cavity and stud cavity insulation shall not exceed 750°F (417°C) above their temperature as measured immediately after the start of the fire test by thermocouples nos. 66, 67, 70, and 80, as applicable.

10.2.4 Temperatures in Second-Story Test Room. Temperatures measured 1 in. (25 mm) from the interior surface of the test specimen within the second-story test room shall not exceed 500°F (278°C) above the ambient air temperature of the test facility at the start of the fire test as measured by thermocouples nos. 49 through 54 as shown in Figure 6.1(c).

10.2.5 Flames in Second-Story Test Room. Flames shall not occur in the second-story test room.

10.2.6 Flame Propagation to Adjacent Horizontal Spaces. Flames shall not occur beyond the intersection of the test specimen and the side walls of the test apparatus.

Chapter 11 Report

11.1 Fire Test Report. A fire test report shall be prepared to document the fire test and shall contain all of the following:

- (1)*Description of the test specimen wall assembly, including the following:
 - (a) Drawings showing the structural design in plan and elevation, principal cross-section and other sections as needed for clarity, and joint locations and details
 - (b) Details of the attachment of the wall assembly to the test apparatus
- (2) Location of thermocouples
- (3) Ambient conditions at the start of the fire test
- (4) Temperatures of all thermocouples during the fire test
- (5) Burner gas flow data obtained during the fire test, including type of gas used and total gas flow of both burners for the duration of fire test
- (6) Comparison of burner gas flow data obtained during the fire test to the burner gas flow data obtained during the latest calibration test
- (7) Position of the vertical centerline of the window burner with respect to the exterior face of the wall assembly for the fire test and the latest calibration test
- (8) Visual observations made during the fire test
- (9) Photographs of the following:
 - (a) Wall assembly — prior to fire test, exterior face
 - (b) Wall assembly — fire test in progress, exterior face
 - (c) Wall assembly — post-fire test, exterior face
 - (d) Wall assembly — post-fire test, interior face, both stories
 - (e) Wall cavity insulation in wall assembly — post-fire test
- (10) Damage sketch(es) of the wall assembly
- (11) Extent of residual burning that continues during the 10-minute period immediately after the gas flow to the gas burners has been shut off
- (12) Visual observations of smoke accumulation inside the second-story test room during the fire test
- (13) Performance of the wall assembly with respect to each of the applicable conditions of acceptance (*see Chapter 10*)

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1 In the late 1970s, the use of foam plastic insulation and other combustible materials in exterior, non-load-bearing walls on noncombustible construction (typically Types I, II, III, and IV) was proposed. At that time, questions were raised concerning the vertical and horizontal spread of fire over the combustible faces or through the combustible cores of these types of exterior walls. In order to address these concerns, a full-scale fire test program was sponsored by the Society of Plastics Industry (SPI). The testing was conducted in 1980 at Southwest Research Institute. This program consisted of a series of full-scale fire tests that utilized an outdoor 26 ft tall two-story building. The test wall systems were erected on two adjoining sides of the building and in one wall; a window opening was placed in the lower floor wall area. A 1285 lb wood crib was placed in the lower floor, and when ignited this fire source produced an NFPA 251, *Standard Methods of Tests of Fire Resistance of Building Construction and Materials*, time-temperature fire exposure on the interior of the wall system. At approximately 5 minutes into the test, flames exited the window opening and simultaneously exposed the exterior face of the wall assembly. Temperature measurements and visual observations were made during the 30-minute test and after the test to evaluate the extent of flame propagation. The test series showed that for the wall panel systems evaluated, the extent of flame propagation both vertically and horizontally was limited (Beitel and Evans).

When the ICC *Uniform Building Code (UBC)* was modified to recognize this application, the full-scale fire test was also codified and was published in the 1988 edition of the *UBC* as Test Standard 17-6. When the 1994 edition of the *UBC* was reorganized, the test became UBC Test Standard 26-4.

In the early 1990s, SPI sponsored a test program that developed a reduced-scale version of the UBC 26-4 test. This test used an indoor, intermediate-scale, multistory test apparatus, a single wall with a window opening, and two gas-fired burners to produce the same exposure conditions as the UBC 26-4 test. A combination of temperature measurements and visual observations were used to determine the extent of vertical and horizontal flame propagation over the face of the wall systems or through the combustible core material. After development of the test apparatus, a series of tests were conducted that showed correlation between the new intermediate-scale test and the full-scale UBC 26-4 test. Testing was done with wall systems that both passed and failed in the UBC 26-4 test, with similar results being attained in the intermediate-scale test method (Beitel and Griffith).

This test was recognized by the *UBC* as an alternative to the UBC 26-4 test and was published as UBC Test Standard 26-9 in the 1997 edition of the *UBC*.

In 1998, NFPA adopted NFPA 285, *Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Non-Load-Bearing Wall Assemblies Containing Combustible Components*, which used as its basis the UBC 26-9 test. The NFPA 285 test is technically the same as the UBC 26-9 test, with the only differences between the test methods being formatting and editorial issues.



A.1.1.1 The fire test method described is intended to evaluate the inclusion of combustible components within wall assemblies/panels of buildings that are required to have exterior walls of noncombustible construction.

The test apparatus described in this standard is commonly referred to as the intermediate-scale multistory test apparatus (ISMA).

A.1.1.2 This standard addresses fire exposures from interior fires that reach flashover, break exterior windows, and expose the building facade. It is not intended to address fire exposures that originate from the building's exterior.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase “authority having jurisdiction,” or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.3.3 Exterior Wallcovering. Examples include but are not limited to veneers, siding, exterior insulation, and finish systems.

A.4.2.3 Figure A.4.2.3(a) through Figure A.4.2.3(c) show additional diagrams of the test structure.

A.4.4.3.6 In relation to Figure 4.4.3.6, Figure A.4.4.3.6 illustrates a side view of burner placement. The window burner is similar to the burner described in Section 5.1 and Figure 1 of ASTM E 108, *Standard Test Methods for Fire Tests of Roof Coverings*.

A.4.4.13 The calibration flow rates shown in Table 4.4.13 are designed to achieve the temperatures shown in Table 7.1.11.

A.5.6.2.1 Figure A.4.2.3(b) and Figure A.4.2.3(c) provide an illustration of the spandrel beam.

A.5.7.2 The construction of the wall assembly should be typical of actual product use.

A.5.7.3 Joints and seams should be caulked, backed, or otherwise installed as appropriate to replicate typical field installations.

A.6.1 The thermocouple locations specified in Figure 6.1(b), Details A through D, were developed for the typical wall sys-

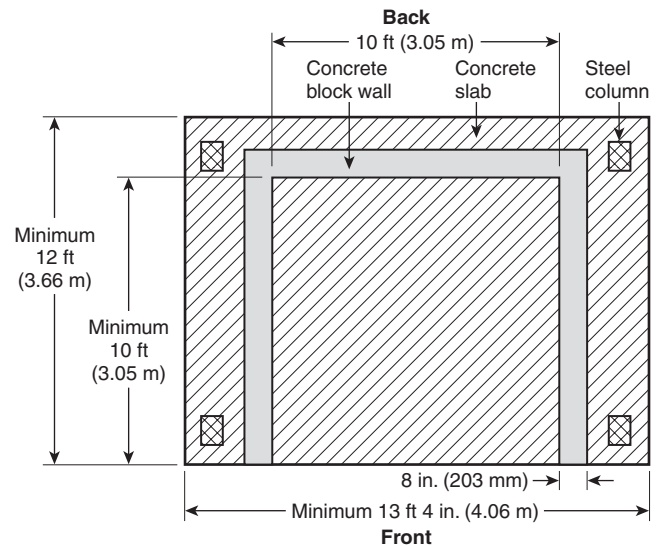


FIGURE A.4.2.3(a) Plan View of Test Apparatus — Both Stories (not to scale).

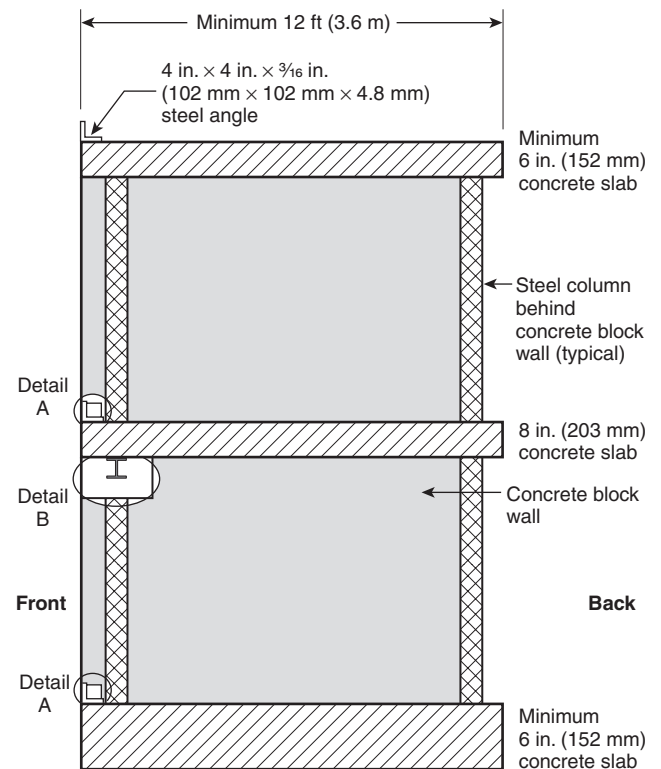


FIGURE A.4.2.3(b) Section View Through Test Apparatus (not to scale). For Details A and B, see Figure A.4.2.3(c).

tems in use at the time the test method was developed. Over time, many new and different wall constructions and configurations have come into use and have been tested. The revisions to Figure 6.1(b) address and clarify the thermocouple locations for newer types of wall systems.