

NFPA 328
Manholes, Sewers,
and Similar
Underground
Structures
1987 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA Headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision

This document is copyrighted by the National Fire Protection Association (NFPA). The terms and conditions set forth below do not extend to the index to this document. If public authorities and others reference this document in laws, ordinances, regulations and administrative orders or similar instruments, it should be with the understanding that this document is informative in nature and does not contain mandatory requirements. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method ("adoption by reference") are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use.

The term "adoption by reference" means the citing of the title and publishing information only.

(For further explanation, see the Policy Concerning the Adoption, Printing and Publication of NFPA Documents which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accepts any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

FREE! Send today for the NFPA Catalog.

The National Fire Protection Association publishes a 100 page catalog of all its Firesafety Products and Services.

If you ever need firesafety codes and standards, Fire Service training programs and firesafety education materials this catalog is a necessity.

To receive your free copy of the NFPA Catalog, just mail in this postage paid card today! Or call toll-free 1-800-344-3555 and ask one of our Customer Service Reps to send you one. (M6)


(Please Print)

Name _____ Title _____

Business _____


Address _____ Phone _____

City _____ State _____ Zip _____

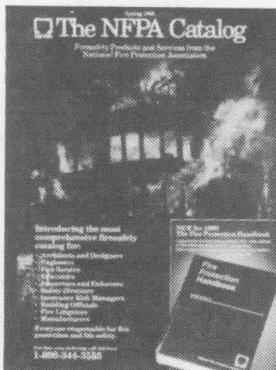

I am also interested in NFPA membership.

NEED QUICK ANSWERS TO A WIDE RANGE OF FIRESAFETY QUESTIONS?



Save your time — put the leading one-volume firesafety “Library” on your bookshelf! — the new 16th edition of NFPA’s **FIRE PROTECTION HANDBOOK**

You need to preplan a response to a hazardous waste emergency . . . quench an oil fire in a hurry . . . OK the design of a state-of-the-art sprinkler system . . . fireproof a robotics installation . . . inspect an aerosol charging outfit . . .

WHERE CAN YOU TURN FOR QUICK ANSWERS AND DIRECTION? THE RIGHT ANSWERS? RIGHT AWAY?

Do what thousands of fire-safety professionals do . . . keep a copy of the world’s leading one-volume firesafety “library” close at hand. No other fire reference comes close to matching the colossal coverage of NFPA’s FIRE PROTECTION HANDBOOK. Or to matching its ease of use, either. And the new 16th edition is better equipped than ever to meet your fire protection and prevention needs — with over 600 pages of all-new or updated information! (M3-FPH1686) **\$75.00 Members \$67.50**

NEW 16TH EDITION LET US SEND YOU A COPY FOR 30 DAYS FREE EXAMINATION

Simply complete and mail this card today for free trial copy of **FIRE PROTECTION HANDBOOK**. Then either keep it and pay our bill for \$75.00 plus \$2.85 for handling, or return it within 30 days and owe nothing.

Name _____ NFPA Member I.D.# _____

Organization _____


Address _____

City _____ State _____ Zip _____

Phone _____

FOR FASTER SERVICE CALL TOLL-FREE **1-800-344-3555**






NO POSTAGE
NECESSARY
IF MAILED
IN THE
UNITED STATES

BUSINESS REPLY CARD

FIRST CLASS PERMIT NO. 3376 QUINCY, MA

POSTAGE WILL BE PAID BY ADDRESSEE

National Fire Protection Association
Batterymarch Park
Quincy, MA 02269-9904



NO POSTAGE
NECESSARY
IF MAILED
IN THE
UNITED STATES

BUSINESS REPLY CARD

FIRST CLASS PERMIT NO. 3376 QUINCY, MA

POSTAGE WILL BE PAID BY ADDRESSEE

National Fire Protection Association
Batterymarch Park
Quincy, MA 02269-9904



© 1987 NFPA, All Rights Reserved

NFPA 328

**Recommended Practice for the Control of
Flammable and Combustible Liquids and Gases
in Manholes, Sewers, and
Similar Underground Structures**

1987 Edition

This edition of NFPA 328, *Recommended Practice for the Control of Flammable and Combustible Liquids and Gases in Manholes, Sewers, and Similar Underground Structures*, was prepared by the Technical Committee on Tank Leakage and Repair Safeguards, released by the Correlating Committee on Flammable Liquids, and acted on by the National Fire Protection Association, Inc. at its Fall Meeting held November 17-20, 1986, in Denver, Colorado. It was issued by the Standards Council on December 10, 1986 with an effective date of December 30, 1986, and supersedes all previous editions.

The 1987 edition of this standard has been approved by the American National Standards Institute.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are intended as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 328

Sufficient case histories of fires and explosions in underground structures fully justify a careful review of the material contained within this report. The sources of flammable vapor-air mixtures in these locations, coupled with a study of unsafe practices and protective practices contained herein, certainly will indicate the desirability of utilizing the applicable corrective measures suggested in the summary of this report. This recommended practice was first adopted in 1956 and subsequent editions were published in 1964, 1970, 1975, 1982, and 1987.

Committee on Flammable Liquids Correlating Committee

Paul C. Lamb, *Chairman*
Englewood, NJ

Martin F. Henry, *Secretary*
National Fire Protection Association
(Nonvoting)

W. H. Axtman, American Boiler Mfrs. Assn.
Rep. Liquid Fuel Burning Equipment Comm.
G. E. Cain, G. E. Cain & Co.
J. A. Cedervall, Underwriters Laboratories Inc.
Donald M. Johnson, San Bruno, CA
Rep. Western Oil & Gas Assn.

F. Owen Kubias, SCM/Glidden
Steven Landon, Roanoke, TX
Rep. Textile Care Allied Trades Assn.
William R. Rucinski, Fire Marshal Div., Lansing, MI

Technical Committee on Tank Leakage and Repair Safeguards

J. A. Cedervall, *Chairman*
Underwriters Laboratories Inc.

Martin F. Henry, *Secretary*
National Fire Protection Assn.
(Nonvoting)

Donald W. Fleischer, Veeder-Root Co.
Carl V. Hasselback, White Arrow Service Stations, Inc.
Rep. Petroleum Marketers Assn. of America
William C. Jackson, Phillips Petroleum Co.
Rep. American Petroleum Inst.
Donald M. Johnson, San Bruno, CA
Rep. Western Oil & Gas Assn.
Richard J. Kelner, Nassau County Fire Marshals Office

Frederick B. Killmar, Killmar Assoc., Inc.
Edwin Liu, NJ Dept. of Environmental Protection
George S. Lomax, Heath Consultants, Inc.
Robert N. Renkes, Petroleum Equipment Institute
Robert L. Ruyle, Ruyle & Assoc.
Bruce R. Sharp, Armor Shield, Inc.
Robert P. Siegel, 3M Co.
Pat R. Wrigley, Nat'l. Petroleum Refiners Assn.

Alternates

John A. Ainlay, Steel Tank Institute
(Alternate to Steel Tank Institute Rep.)

Rudolph C. White, American Petroleum Institute
(Alternate to W. C. Jackson)

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Contents

Foreword	328- 4
Chapter 1 The Problem	328- 5
1-1 General	328- 5
1-2 Sources of Ignition	328- 5
1-3 Sources of Flammable and Combustible Liquids and Gases	328- 5
1-4 Damage to Underground Lines	328- 6
1-5 Unsafe Practices	328- 7
Chapter 2 Protective Practices	328- 7
2-1 General	328- 7
Chapter 3 Summary	328- 8
3-1 General	328- 8
Chapter 4 Referenced Publications	328- 9
Appendix A	328-10
Index	328-11

Foreword

Manholes, sewers, and similar underground conduits have long been recognized as constituting areas where fire and explosion hazards of some severity may exist. The probability of an explosion within an underground space is dependent on two factors: (1) that the atmosphere contains a mixture of flammable vapor and air within the flammable range, and (2), that there be a coincident source of ignition. The severity of an individual explosion and its consequences are dependent on various factors. The possibility that any one explosion may result in a major catastrophe is always present.

This publication is limited to the control of hazards presented by flammable and combustible liquids and gases found in manholes, sewers, vaults and similar underground structures. The underground structures include: sanitary sewers, storm drains, water lines, fuel gas distribution systems, electric light and power conduits, telephone and telegraph communication lines, street lighting conduits, police and fire signal systems, traffic signal lines, refrigeration service lines, steam lines, and petroleum pipelines.

The term "underground structures" is not intended to include subways, tunnels, and the substructural areas of buildings such as underground garages.

The purpose of this publication is to give to enforcement officials, fire authorities, contractors, and owners of underground structures guidance on problems involving flammable and combustible liquids and gases that may be found in underground structures.

NFPA 328

Recommended Practice for the Control of Flammable and Combustible Liquids and Gases in Manholes, Sewers, and Similar Underground Structures

1987 Edition

Notice: Information on referenced publications can be found in Chapter 4.

Chapter 1 The Problem

1-1 General. With increasing congestion, and for aesthetic considerations, the trend in civic planning is toward the installation of all types of utility services beneath the street surface. This results in a continuous program of excavation and construction, with frequent damage to existing structures.

1-2 Sources of Ignition.

1-2.1 The possibility of ignition of flammable gases or vapors that may collect in underground areas is limited by certain fundamental conditions. The vapor must be mixed with sufficient air to make a flammable mixture, or it must be escaping into air at a point where a flammable mixture can be created. Heat of sufficient intensity to ignite the particular air-vapor mixture involved must be present at the place where a flammable mixture exists. Such heat may be caused by an open flame, an electric arc or spark, an incandescent heated particle, or a hot surface.

1-2.2 The flammable limits of the gases and vapors that have been found in underground structures are listed in Appendix A. Flammable mixtures are formed when the concentration of these gases in air is between the minimum and maximum shown.

1-2.3 Any open flame is a potential source of ignition. These may be encountered in everyday work operations. Little control can be exerted over the casual sources of ignition when flammable vapors are escaping from or into underground structures. Such casual sources of ignition include burners and warning lanterns used by street surface maintenance crews, automotive and other internal combustion engines, tar pots and pedestrian smokers.

1-2.4 The heat of an electric arc occurring in electric underground structures may cause the distillation of insulating material, thus producing flammable gases which in turn may be ignited by the arc itself when the proper air-gas ratio is reached. This usually will occur when the arc reaches a manhole or vault after having started in a duct. Other gases or flammable vapors, if present, may also be ignited by such an arc.

1-2.5 Static electricity may be a source of ignition and its accumulation is generally greatest in an atmosphere of low humidity. The hazard appears when static accumulates to the extent that a spark discharge may occur. Static electricity may be generated when a liquid under pressure escapes from a pipe at high velocity. Particles of dust, scale, rust, or liquid droplets inside the pipe may become heavily charged with static when blown out by gas or vapor and, if they impinge on an insulated body, the body will accumulate the charge and a spark discharge may occur.

1-3 Sources of Flammable and Combustible Liquids and Gases.

1-3.1 The condition created by the existence of gases and vapors in underground structures can be grouped into two classes: (1) flammable and (2) injurious to life. The latter condition results from the toxic or suffocating properties of the gases or vapors. Some of these liquids and gases fall into both classes. While this publication deals primarily with the flammable limits associated with liquids and gases, some of which are listed in Appendix A, additional precautions may be required to protect against health hazards. An example is hydrogen sulfide, where the dangerous breathing concentration is only a small fraction of the lower flammable limit (LFL).

1-3.2 Natural Gas. Natural gas is gas originating from naturally occurring gas- or oil-bearing strata. In oil and natural gas producing areas, cracks and faults in the underlying strata or abandoned wells may permit gas to permeate the soil and enter underground conduits and vaults. Within the boundaries of some cities there are actively producing oil and gas fields and many of these underlie developed areas, residential and industrial, where underground structures are now installed.

1-3.3 Fuel Gas. Fuel gases include natural gas, liquefied petroleum gases, coke-oven gas, coal gas, oil gas, carbureted water gas, water gas, producer gas and blast-furnace gas. These gases, except liquefied petroleum gases, have specific gravities lower than that of air so that when released in an underground space they will tend to rise and diffuse rather rapidly above the point of leakage. These gases, when mixed with air within certain limits, produce flammable mixtures. Since the oxygen content of each of these gases when not mixed with air is usually below 1.0 percent, they may be classed as suffocating gases. With the exception of natural gas and liquefied petroleum gas, they are also highly toxic because of the high carbon monoxide content. Natural gas and other fuel gases as distributed by utility companies in underground pipes are also a source of flammable gas. These pipes may be subject to damage caused by corrosion, electrolysis, structural failures and adjacent excavating. These causes are discussed in greater detail in later paragraphs of this section.

1-3.4 Refrigerant Gases. A number of the common refrigerants, such as ammonia, methyl chloride, ethyl chloride, methyl bromide and ethyl bromide, have varying degrees of flammability. With the exception of ammonia, all of these refrigerants in the vapor phase are heavier than air. Therefore, if they are released in large quantities in closed spaces, these heavy gases will flow

downward into the lowest areas. Of these, only ammonia has a sufficiently strong odor in dilute concentrations to indicate its presence. Exposure to ammonia fumes may cause severe ammonia burns even at concentrations below the flammable limits. Liquid ammonia is often distributed through underground street pipes for refrigeration service in the business districts of many large cities. This system of pipes may be subject to the same exposure to physical damage as fuel gas pipes and petroleum pipelines.

1-3.5 Electric Cable and Other Insulating Material Gases. This source of flammable gas is practically limited to severely overloaded electric underground circuits. A breakdown of cable insulation will produce an electric arc. If the protective fuses do not operate promptly, this electric arc will continue. The heat of the arc may, by destructive distillation of cable insulation (varnished cambric, rubber, or paper), produce flammable gases containing hydrogen, carbon monoxide, and hydrocarbons.

1-3.6 Chemicals. Accidental spillage in chemical processing plants and disposal of waste chemical products through sewers by industrial plants may be potential sources or contributing causes for explosive conditions. Examples of such products are carbon disulfide and ammonia. Calcium carbide will react with water to produce the flammable gas acetylene.

1-3.7 Sewage Gases. Sewage gas results from the fermentation or decomposition of organic matter. These gases can be produced when organic matter has settled as a solid in sewer lines caused by flat grades, crevices, sumps, or obstructions where consistent flow of sewage is lacking, or as the result of bacterial action on wood or other organic material immersed in water. These flammable gases are principally methane, hydrogen sulfide, and hydrogen and, on the basis of present evidence, they seldom reach explosive concentrations in sewers and drains. However, when they are mixed with other flammable liquids and gases present in sewers, explosive conditions may occur.

1-3.8 Flammable and Combustible Liquids. Cleaning solvents and compounds washed down drains by industrial and domestic users may be the media from which flammable vapors originate. Hydrocarbon liquids such as gasoline and kerosene in industrial plants, service station and garage wash racks are occasionally sent to sewers and drains either accidentally or through negligence. Any leaking underground tank containing liquids, such as a service station's underground gasoline tanks, may be a source of flammable vapors in underground structures (see *NFPA 329, Recommended Practice for Handling Underground Leakage of Flammable and Combustible Liquids*).

1-3.9 Petroleum Pipeline Liquids. Liquid petroleum and liquefied petroleum gases are conveyed by pipelines installed beneath public streets and rights-of-way. These pipelines may be exposed to the same sources of physical damage as fuel gas pipes, as discussed in detail later. If any of these pipelines should fail, the escaping liquids and gases may penetrate substructure walls or rise to the

street surface. Liquids may be washed into drains or enter the ventilating openings in the manhole covers of underground structures. Escaping liquid petroleum products may evaporate in the ground, penetrate the surrounding ground, or enter a confined space to produce a flammable mixture.

1-3.10 Penetration of Structures by Gases. Flammable gas as present in the soil may enter conduits, sewers, drains, or basements because underground structures constructed of cement, concrete, brick or vitreous tile generally are not built to be impervious to gas. If a flammable gas or liquid is present in the soil, as may be produced by decaying organic matter, there is some likelihood that it may penetrate an adjacent underground structure. Particular attention should be paid to landfill sites developed by the depositing of garbage and trash. Gas from this source, primarily methane, may not have an odor. Gas may enter the subsurface sections of buildings through cracks or around any underground conduits that penetrate the substructure walls.

1-3.11 Electric Circuit Oil Switches and Oil Insulated Transformers. This equipment is frequently installed in a street vault and electrical failures will occasionally result in an explosion. The action of protective devices in shutting off current is usually very fast, being of the order of two seconds or less. This has the effect of limiting the damage to the vault in which the failure occurs. However, when the vault is adjacent to or within a large structure, such an explosion may result in heavy damage.

1-4 Damage to Underground Lines.

1-4.1 Corrosion. One type of corrosion affecting gas lines and petroleum pipelines occurs when the soil composition and resistance are such that electric current from the development of local action cells can flow readily from anodic areas on the pipe surface through the soil to the cathodic areas on the same pipe. Such conditions may be due to the soil's acid or alkali content, organic matter, variations of water or oxygen content, soil type, or the presence of certain bacteria in the soil. Corrosion may also occur as a result of chemical reaction between the pipe and surrounding soil. Corrosion of this type can be controlled with cathodic protection.

1-4.2 Stray Currents. Another cause of corrosion in underground lines is stray electric currents originating from such sources as direct current electric railways and trolley lines using rails to carry return currents; industrial plant direct current machinery using the ground as a return conductor; stray currents from cross connections with other structures carrying current; and leakage from foreign system cathodic protection rectifiers. These currents may not be destructive where they enter the piping system, but drainage of these stray currents to ground may cause corrosion at these points of discharge.

1-4.3 Structural Failures. The allocation of insufficient space for the installation of underground structures may, in some situations, result in the encasing of gas and flammable and combustible liquid pipes in the walls of ducts and subsequently constructed masonry vaults. Such pipes from vaults under certain conditions may be fractured. Flood washouts, earthquakes, and landslides may

cause the dislocation and movement of ground and are often responsible for pipe fractures. Rupture of water mains due to corrosion, electrolysis, or structural failure may in turn cause washout of soil that supports gas and flammable liquid pipes. Lacking support, these pipes may fracture.

1-4.4 Excavating. Contractors doing excavation work often encounter gas and flammable and combustible liquid pipes, and even though aware of their presence, workers may unintentionally damage a pipe, resulting either immediately or ultimately in a leak. Damage such as this is not always reported and often inadequate repairs are attempted by the party responsible for the physical damage.

1-4.5 Fire Damage. Fires in underground structures can result in spalling of concrete, destruction of protective linings and deterioration of other interior surfaces. Such damage, if extensive, may weaken the structure.

1-5 Unsafe Practices.

1-5.1 Before washing spilled petroleum products from street surfaces into drains or sewers, which may be a potentially dangerous action and often is an unlawful practice, other disposal means such as soaking up the substance with sand, rags, or mops should be considered. If, in an emergency, no alternative is available, disposal into a drain or sewer should be done only on the decision of a qualified person, after appropriate public authorities have been notified.

1-5.2 Disastrous consequences may result from the thoughtless or deliberate dumping into drains of waste products that are either directly flammable or that, by reaction with organic matter in sewers, may produce a flammable mixture. Though the presence of a flammable material may be detected, its source may be difficult to determine.

Chapter 2 Protective Practices

2-1 General.

2-1.1 The adoption of protective measures that will detect the presence of flammable materials in manholes and vaults, and provide the means to prevent the accumulations of gas or vapor within the explosive range, should reduce the incidence of explosions in underground structures. Such a defensive procedure is necessary because of the difficulty of eliminating the flammable material at its source.

2-1.2 Numerous sources of ignition may be found in underground structures. The operators of underground structures may materially reduce the number of ignitions by eliminating the use of flames in suspected areas. Experience has shown, though, that fire and explosion incidence can best be reduced by the elimination of flammable vapors from the atmosphere of the underground structure. It is all but impossible to remove all ignition sources.

2-1.3 Considering the diversity of contributory causes for flammable products in underground structures, protective practices should be designed to reduce to a minimum the quantity of flammable vapors. Where such vapors are found to be present, a complete purge of the manhole or vault atmosphere should be made and the source of the flammable vapors eliminated. Manholes and vaults should be ventilated by forced draft when necessary to prevent concentrations of these vapors within the explosive range. After complete ventilation of the underground structure, the atmosphere should be tested with a combustible gas indicator before entering and before any hot work is performed. A low reading on the combustible gas indicator does not necessarily mean that the toxicity hazard has been eliminated. Adequate ventilation should be maintained and periodic gas analysis of the atmosphere during any such work should be made.

2-1.4 There are a number of instruments that can be used to detect unsafe atmospheres found in underground structures. They should be used to determine the characteristics of any questionable situation.

2-1.5 Oxygen. There are indicators that give a direct reading of oxygen concentration. Under no conditions should an area be entered, without self-contained breathing apparatus, unless it contains at least 19.5 percent oxygen.

2-1.6 Carbon Monoxide. This gas in concentrations greater than 0.10 percent by volume results in unconsciousness in little more than an hour and death in four hours. Further increases in concentration reduce this time element. Its effect is to displace oxygen in the blood stream. Several instruments have been developed for the quick detection of carbon monoxide. Those capable of detecting the smallest concentrations considered hazardous are the carbon monoxide tester (palladium-molybdate complex) and the carbon monoxide indicator.

2-1.7 Hydrogen Sulfide. This flammable and toxic gas is colorless and has an odor resembling rotten eggs. It is toxic in concentrations in excess of 0.002 percent by volume. Continued exposure will paralyze the olfactory nerves. The hydrogen sulfide detector will detect the low toxic concentrations of this gas.

2-1.8 Fuel Gases and Vapors from Flammable and Combustible Liquids. Combustible gas indicators are available in a number of different types to meet the requirements of the specific use to which they may be applied. The most common type is an "all-purpose" instrument suitable for the detection of flammable gases such as natural gas, manufactured gas, hydrogen, and acetylene and all vapor-air mixtures associated with fuel oils, gasoline including leaded gasoline, alcohols, and acetones. This instrument indicates the presence of gases and vapors in percent of the lower flammable limit (LFL). It must be calibrated, used, and maintained in accordance with the manufacturer's instructions. This instrument must be calibrated on the specific gas being sampled, i.e., natural or manufactured gas, and has a scale range of zero to 100 percent gas. A portable combustible gas indicator is also available for operation in explosive atmospheres.

2-1.9 Periodic surveys with instruments should be made of the atmosphere in all water, gas, and electric underground structures for the presence of flammable vapors. The frequency of such surveys will depend upon the previous experience and the potential hazard.

2-1.10 Liquefied petroleum gases and utility gases are odorized to facilitate detection unless the odorant would serve no useful purpose as a warning agent. Such purposes are relatively rare and practically all such gases distributed by underground pipelines are odorized. Experience has shown that odorants can be absorbed in traveling through the soil.

2-1.11 Volatile flammable liquids may enter a drainage system because of a spill or other emergency. Steps should be taken to minimize the hazard by exhausting the vapors with blowers or exhaust fans driven by explosionproof motors and by pumping out the liquid with pumps equipped with explosionproof motors. Floor drain openings into buildings in the area of the spill and for some distance downstream should be checked for escape of vapors. Water should be placed in any dry traps to seal them. Copious quantities of water should be used to flush any flammable or combustible liquid through the system quickly and to dilute it, if miscible with water.

2-1.12 Underground tanks of flammable liquids may be a source of leakage. When a tank is found to be leaking, its contents should be removed immediately. When such a tank is taken out of service, abandoned, or removed, the procedures described in Appendix B of NFPA 30, *Flammable and Combustible Liquids Code*, entitled Abandonment or Removal of Underground Tanks, should be followed.

2-1.13 Sewers and drains should be periodically flushed and cleaned to prevent deposits of organic material and slime growth. Periodic inspections should be made of industrial plants to prevent the discharge into sewers of waste that might produce explosive gases due to physical or chemical impurities, high temperatures, alkalis, or acids, unless the system is specifically designed for such materials.

2-1.14 Periodic checks should be made of protective equipment in underground electric systems. Efforts should be made to prevent the overloading of cables and to avoid arcing conditions that may be forming flammable gas by the breakdown of insulation.

Chapter 3 Summary

3-1 General.

3-1.1 A review of all the factors relating to the problem of explosive hazards in underground structures, together with an analysis of causes of explosions, indicates that flammable material may at some time be present in an underground structure.

Control procedures and education are the proper approaches to the problem. Effective control cannot be maintained unless the various utilities involved, the administrative bodies of cities, and others cooperate in an adequate safety program.

3-1.2 Utility companies should maintain an adequate inspection program for the detection of leaks at street openings. This can best be accomplished by the use of combustible gas indicators, vegetation surveys, and other methods. Periodic inspection and testing of key equipment should be conducted with reasonable frequency as a part of regular maintenance operations. Such a distribution piping maintenance program could be carried out in accordance with the requirements of federal and state pipeline regulations.

3-1.3 Inactive gas services and mains should be abandoned in accordance with federal and state regulations.

3-1.4 Automatic or manually operated drains in industrial piping should be designed so as not to discharge their product into underground structures.

3-1.5 Owners and operators of underground pipelines carrying flammable and combustible liquids should maintain an adequate inspection program for the detection of escaping liquids.

3-1.6 Publication 1621, *Recommended Practice for Bulk Liquid Stock Control at Retail Outlets*, published by the American Petroleum Institute, will be of value to operators of service stations.

3-1.7 An in-service training program for all employees whose occupation is associated with underground structures will teach them to recognize the presence of fire and toxic hazards and oxygen deficiencies and teach them how to take proper precautions against such possibilities.

3-1.8 Some public authorities have established a program to control or prevent the discharge into sewers and drains of all products likely to result in flammable atmospheres in vaults and manholes.

3-1.9 Sewers and drains should be designed to ensure proper cleansing velocities, proper ventilation, to prevent infiltration, and to avoid the settling of heavy solids. Sewers and drains should be designed to minimize the danger of settlement and failure which in turn might break other adjacent underground structures.

3-1.10 Where ventilation of a vault or manhole is necessary, and mechanical ventilation cannot be provided, the manhole or vault should be designed (depending upon local conditions) so that effective natural ventilation for vapors or gases lighter than air can be obtained. Manholes for sewers should be regularly spaced to provide effective ventilation and explosion relief.

3-1.11 Every effort should be made to establish standard practice for the design, construction, and maintenance of all underground structures with respect to the elimination of explosive hazards and the contributory causes.

3-1.12 Close liaison should be established between the fire chief and industrial safety officials. Mutually approved procedures should be developed to cope with emergencies so that fire fighters can act effectively in their line of duty.

3-1.13 All agencies having underground structures should be prepared to furnish contractors with the record of the locations of such adjacent structures or furnish a person who knows the location of these pipes. In the event the exact location of any underground structure is not known, the contractor should make a physical inspection of the entire right-of-way of the proposed excavation by employing underground detecting devices and visual inspection of adjacent structures.

3-1.14 Apart from direct damage to piping, contractors should take extra precautions to avoid damage to corrosion protecting coatings, anodes, electrodes, bonding facilities, and related devices. If these are disturbed or damaged, the owner of the structures should be notified before backfilling the excavation. Care should be taken in all excavations in which wire or metal is found, even though these are not immediately adjacent to a pipeline. They may be part of the protective system.

3-1.15 Public authorities should:

(a) adopt an ordinance that would require a contractor before starting construction or excavation work (1) to obtain a permit, (2) to notify the owner of adjacent underground structures in writing of his intention to start work, and (3) to obtain from the owner the exact information on the location of the underground structures and pipes containing flammable materials. All agencies having underground structures should be prepared to furnish contractors with exact information on the location of such underground structures. This permit should prohibit the contractor from interference with the above-mentioned pipes without giving prior notice to the owner or operator.

(b) require anyone conducting blasting operations to obtain a permit. The permit should not be granted until the owners of adjacent underground structures have been consulted. NFPA 495, *Code for the Manufacture, Transportation, Storage, and Use of Explosive Materials*, and the American Insurance Association's *Fire Prevention Code* contain additional information on this subject.

(c) require anyone razing buildings to obtain a permit. The permit should not be granted until the owners of underground structures in the area have been consulted.

(d) prohibit the encasement of pipes containing flammable materials within the constructed walls of new structures. This recommendation does not apply to piping entering buildings.

(e) establish a procedure for connecting direct current electrical equipment to ground on the premises of the user. This is to prevent the inclusion, directly or indirectly, of underground pipes carrying flammable materials in the return electric circuit.

(f) promote cooperative efforts on the part of all organizations having underground facilities to reduce corrosion.

Chapter 4 Referenced Publications

4-1 The following documents or portions thereof are referenced within this recommended practice and should be considered part of the recommendations of this document. The edition indicated for each reference should be the current edition as of the date of the NFPA issuance of this document. These references should be listed separately to facilitate updating to the latest edition by the user.

4-1.1 NFPA Publications. National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

NFPA 30-1984, *Flammable and Combustible Liquids Code*

NFPA 325M-1984, *Fire Hazard Properties of Flammable Liquids, Gases, and Volatile Solids*

NFPA 329-1987, *Recommended Practice for Handling Underground Leakage of Flammable and Combustible Liquids*

NFPA 495-1985, *Code for the Manufacture, Transportation, Storage, and Use of Explosive Materials*

4-1.2 Other Publications.

American Insurance Association, *Fire Prevention Code*

American Petroleum Institute 1621-1977, *Recommended Practice for Bulk Liquid Stock Control at Retail Outlets*

Appendix A

This Appendix is not a part of the recommendations of this NFPA document, but is included for information purposes only.

Properties of Some Flammable and Combustible Liquids and Gases Which Have Been Found in Underground Structures¹

	Flash Point Closed Cup Deg. F	Flammable Limits in Air % by Vol.		Specific Gravity of Liquid (Water = 1)	Vapor Density (Air = 1)
		Lower	Upper		
Acetone	-4	2.15	13.0	0.8	2.00
Acetylene	Gas	2.5	100.0		0.90
Ammonia	Gas	16.0	25.0		0.6
Benzene	12	1.3	7.1	0.9	2.8
Butadiene	Gas	2.0	12.0		1.9
Butane	Gas	1.6	8.5		2.00
Carbon Disulfide	-22	1.3	50.0	1.30	2.60
Carbon Monoxide	Gas	12.5	74.0	...	1.0
Ethane	Gas	3.0	12.5		1.0
Ethyl Chloride	-58	3.8	15.4	0.9	2.2
Gas Oil*	150*	0.5	5.0	< 1	
Gasoline (Values vary for different grades of gasoline)	-45	1.4	7.6	0.8	3.-4.0
Hydrogen	Gas	4.0	75.0		0.1
Hydrogen Sulfide	Gas	4.0	44.0		1.2
Kerosene	100-162	0.7	5.0	< 1	
Methane	Gas	5.0	15.0		0.6
Methyl Bromide (Practically nonflammable)	Gas	10.0	15.0		3.3
Methyl Chloride	Gas	8.1	17.4		1.8
Natural Gas*	Gas	3.8	13.0	..	
Petroleum Naphtha* (Petroleum Ether)	< 0	1.1	5.9	0.6	2.5
Propane	Gas	2.1	9.5		1.6
Toluene	40	1.2	7.1	0.9	3.1

*These liquids and gases are mixtures and their properties may vary depending on the composition.

¹Properties of other flammable materials can be found in NFPA 325M, *Fire Hazard Properties of Flammable Liquids, Gases, and Volatile Solids*.

Index

© 1987 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

- C-**
- Carbon monoxide 2-1.6
 Chemicals, accidental spillage 1-3.6
 Contractors 3-1.13 thru 3-1.15
 Corrosion, damage to underground lines 1-4.1
 Current, stray electric, damage to underground lines 1-4.2
- D-**
- Detection instruments 2-1.4
 Drainage system, volatile flammable liquids in 2-1.11
 Drains
 Automatic or manually operated in industrial piping 3-1.4
 Design of 3-1.9
 Flushing and cleaning 2-1.13
- E-**
- Electric systems, underground 2-1.14
 Excavating, damage to underground lines 1-4.4
 Explosions, analysis of causes App. B
- F-**
- Fire chief, liaison with industrial safety officials 3-1.12
 Fire, damage to underground lines 1-4.5
 Flames, open 1-2.1, 1-2.3
 Flammable and combustible gases see Gases, Flammable and combustible
 Flammable and combustible liquids see Liquids, Flammable and combustible
- G-**
- Gas services and mains, inactive 3-1.3
 Gases
 Electric cable and other insulating material 1-3.5
 Flammable and combustible
 Properties of App. A
 Sources of 1-3
 Fuel 1-3.3, 2-1.8
 Natural 1-3.2
 Odorized gases 2-1.8
 Penetration of structures by 1-3.10
 Refrigerant 1-3.4
 Sewage 1-3.7
- H-**
- Hydrogen sulfide 2-1.7
- L-**
- Liquids
 Flammable and combustible 1-3.8
- M-**
- Pipelines for 3-1.5
 Properties of App. A
 Sources of 1-3
 Underground tanks 2-1.12
 Vapors from 2-1.8
 Volatile flammable 2-1.11
 Petroleum pipeline liquids 1-3.9
- O-**
- Oxygen 2-1.5
- P-**
- Protective practices Chap. 2
 Public authorities
 Programs established by 3-1.8
 Responsibilities of 3-1.15
- S-**
- Service stations 3-1.6
 Sewers
 Design of 3-1.9
 Flushing and cleaning 2-1.13
 Sources of ignition 1-2, 2-1.2
 Static electricity 1-2.5
 Structural failures, underground 1-4.3
 Summary Chap. 3
 Switches, electric circuit oil 1-3.11
- T-**
- Tanks, underground, flammable liquids 2-1.12
 Training for employees 3-1.7
 Transformers, oil insulated 1-3.11
- U-**
- Underground lines, damage to 1-4
 Unsafe practices 1-5
 Utility companies, inspection by 3-1.2
- V-**
- Vapors
 Flammable, reduction of 2-1.3
 From flammable and combustible liquids 2-1.8
 Vaults, ventilation of 3-1.10

SUBMITTING PROPOSALS ON NFPA TECHNICAL COMMITTEE DOCUMENTS

**Contact NFPA Standards Administration for final date for receipt of proposals
on a specific document.**

INSTRUCTIONS

**Please use the forms which follow for submitting proposed amendments.
Use a separate form for each proposal.**

1. For each document on which you are proposing amendment indicate:
 - (a) The number and title of the document
 - (b) The specific section or paragraph.
2. Check the box indicating whether or not this proposal recommends new text, revised text, or to delete text.
3. In the space identified as "Proposal" include the wording you propose as new or revised text, or indicate if you wish to delete text.
4. In the space titled "Statement of Problem and Substantiation for Proposal" state the problem which will be resolved by your recommendation and give the specific reason for your proposal including copies of tests, research papers, fire experience, etc. If a statement is more than 200 words in length, the technical committee is authorized to abstract it for the Technical Committee Report.
5. Check the box indicating whether or not this proposal is original material, and if it is not, indicate source.
6. If supplementary material (photographs, diagrams, reports, etc.) is included, you may be required to submit sufficient copies for all members and alternates of the technical committee.

NOTE: The NFPA Regulations Governing Committee Projects in Paragraph 10-10 state: Each proposal shall be submitted to the Council Secretary and shall include:

- (a) identification of the submitter and his affiliation (Committee, organization, company) where appropriate, and
- (b) identification of the document, paragraph of the document to which the proposal is directed, and
- (c) a statement of the problem and substantiation for the proposal, and
- (d) proposed text of proposal, including the wording to be added, revised (and how revised), or deleted.

FORM FOR PROPOSALS ON NFPA TECHNICAL COMMITTEE DOCUMENTS

Mail to: Secretary, Standards Council
National Fire Protection Association, Batterymarch Park, Quincy, Massachusetts 02269

Date 5/18/85 Name John B. Smith Tel. No. 617-555-1212

Address 9 Seattle St., Seattle, WA 02255

Representing (Please indicate organization, company or self) Fire Marshals Assn. of North America

1. a) Document Title: Protective Signaling Systems NFPA No. & Year NFPA 72D

b) Section/Paragraph: 2-7.1 (Exception)

- 2. Proposal recommends: (Check one) new text
- revised text
- deleted text.

3. Proposal (include proposed new or revised wording, or identification of wording to be deleted):

Delete exception.


4. Statement of Problem and Substantiation for Proposal:

A properly installed and maintained system should be free of ground faults. The occurrence of one or more ground faults should be required to cause a "trouble" signal because it indicates a condition that could contribute to future malfunction of the system. Ground fault protection has been widely available on these systems for years and its cost is negligible. Requiring it on all systems will promote better installations, maintenance and reliability.

- 5. This Proposal is original material.
- This Proposal is not original material; its source (if known) is as follows: _____

(Note: Original material is considered to be the submitter's own idea based on or as a result of his own experience, thought, or research and, to the best of his knowledge, is not copied from another source.)

I agree to give NFPA all and full rights, including rights of copyright, in this Proposal and I understand that I acquire no rights in any publication of NFPA in which this Proposal in this or another similar or analogous form is used.

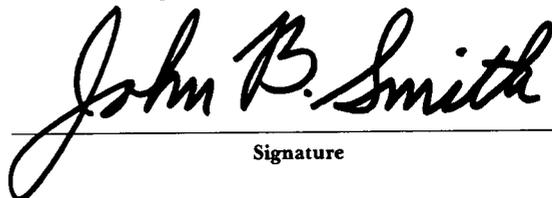
Signature

PLEASE USE SEPARATE FORM FOR EACH PROPOSAL

FORM FOR PROPOSALS ON NFPA TECHNICAL COMMITTEE DOCUMENTS

Mail to: Secretary, Standards Council
National Fire Protection Association, Batterymarch Park, Quincy, Massachusetts 02269

Date _____ Name _____ Tel. No. _____

Address _____

Representing (Please indicate organization, company or self) _____

1. a) Document Title: _____ NFPA No. & Year _____

b) Section/Paragraph: _____

2. Proposal recommends: (Check one) new text
 revised text
 deleted text.

3. Proposal (include proposed new or revised wording, or identification of wording to be deleted):

4. Statement of Problem and Substantiation for Proposal:

5. This Proposal is original material.
 This Proposal is not original material; its source (if known) is as follows: _____

(Note: Original material is considered to be the submitter's own idea based on or as a result of his own experience, thought, or research and, to the best of his knowledge, is not copied from another source.)

I agree to give NFPA all and full rights, including rights of copyright, in this Proposal and I understand that I acquire no rights in any publication of NFPA in which this Proposal in this or another similar or analogous form is used.

Signature

PLEASE USE SEPARATE FORM FOR EACH PROPOSAL

Cut Here