

NFPA 35

Manufacture of Organic Coatings

1987 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA Headquarters addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable Federal, State and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action which is not in compliance with applicable laws and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision — This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference — Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders or similar instruments. Any deletions, additions and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription — **A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof, and, (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rulemaking process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rulemaking powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rulemaking powers may apply for and may receive a special royalty when the public interest will be served thereby.

3. Scope of License Grant — The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing and Publication of NFPA Documents which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accepts any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

FREE! Send today for the NFPA Catalog.

The National Fire Protection Association publishes a 100 page catalog of all its Firesafety Products and Services.

If you ever need firesafety codes and standards, Fire Service training programs and firesafety education materials this catalog is a necessity.

To receive your free copy of the NFPA Catalog, just mail in this postage paid card today! Or call toll-free 1-800-344-3555 and ask one of our Customer Service Reps to send you one. (M6)

(Please Print)


Name _____ Title _____

Business _____

Address _____ Phone _____

City _____ State _____ Zip _____

☐ I am also interested in NFPA membership.

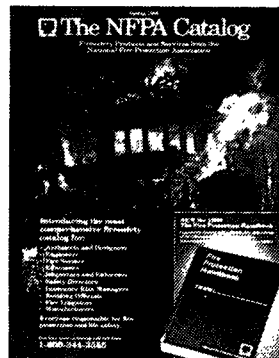

NEED QUICK ANSWERS TO A WIDE RANGE OF FIRESAFETY QUESTIONS?



Save your time — put the leading one-volume firesafety "Library" on your bookshelf! — the new 16th edition of NFPA's FIRE PROTECTION HANDBOOK

You need to preplan a response to a hazardous waste emergency — quench an oil fire in a hurry — OK the design of a state-of-the-art sprinkler system — fireproof a robotics installation — inspect an aerosol charging outfit

WHERE CAN YOU TURN FOR QUICK ANSWERS AND DIRECTION? THE RIGHT ANSWERS? RIGHT AWAY?

Do what thousands of fire-safety professionals do — keep a copy of the world's leading one-volume firesafety "library" close at hand. No other fire reference comes close to matching the colossal coverage of NFPA's FIRE PROTECTION HANDBOOK. Or to matching its ease of use. *And the new 16th edition is better equipped than ever to meet your fire protection and prevention needs — with over 600 pages of all new or updated information!* (M3-FPH1686) **\$75.00 Members \$67.50**

NEW 16TH EDITION LET US SEND YOU A COPY FOR 30 DAYS FREE EXAMINATION

Simply complete and mail this card today for free trial copy of **FIRE PROTECTION HANDBOOK**. Then either keep it and pay our bill for \$75.00 plus \$2.85 for handling, or return it within 30 days and owe nothing.

Name _____ NFPA Member I D # _____

Organization _____

Address _____

City _____ State _____ Zip _____

Phone _____

FOR FASTER SERVICE CALL TOLL-FREE 1-800-344-3555






NO POSTAGE
NECESSARY
IF MAILED
IN THE
UNITED STATES

BUSINESS REPLY CARD

FIRST CLASS PERMIT NO 3376 QUINCY, MA

POSTAGE WILL BE PAID BY ADDRESSEE

National Fire Protection Association
Batterymarch Park
Quincy, MA 02269-9904



NO POSTAGE
NECESSARY
IF MAILED
IN THE
UNITED STATES

BUSINESS REPLY CARD

FIRST CLASS PERMIT NO 3376 QUINCY, MA

POSTAGE WILL BE PAID BY ADDRESSEE

National Fire Protection Association
Batterymarch Park
Quincy, MA 02269-9904



© 1987 NFPA, All Rights Reserved

NFPA 35
Standard for the
Manufacture of Organic Coatings
1987 Edition

This edition of NFPA 35, *Standard for the Manufacture of Organic Coatings*, was prepared by the Technical Committee on Manufacture of Organic Coatings, released by the Correlating Committee on Flammable Liquids, and acted on by the National Fire Protection Association, Inc. at its Fall Meeting held November 17-20, 1986, in Denver, Colorado. It was issued by the Standards Council on December 10, 1986, with an effective date of December 30, 1986, and supersedes all previous editions.

The 1987 edition of this standard has been approved by the American National Standards Institute.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

Origin and Development of NFPA 35

The *Standard on Lacquer Manufacturing Plants*, the predecessor text covering this subject, was originally developed by the NFPA Manufacturing Hazards Council. Following the discontinuance of this Council by the Association, jurisdiction over this standard was given to the NFPA Committee on Flammable Liquids.

The Committee decided to greatly expand the scope of the publication to include the manufacture of all flammable organic coatings. In 1963 this greatly expanded text was officially adopted as a recommended practice. In 1964 the text was revised, but the same format was maintained. In 1970 the format of this publication was changed from a recommended practice to a standard and further revised in 1971, 1976, and 1981 (the latter edition dated 1982).

The Committee began working on this 1987 edition in mid-1985. Major changes were made to the requirements to the information on nitrocellulose.

**Committee on Flammable Liquids
Correlating Committee**

Paul C. Lamb, *Chairman*
Englewood, NJ

Martin F. Henry, *Secretary*
National Fire Protection Association
(Nonvoting)

W. H. Axtman, American Boiler Mfrs. Assn.
Rep. Liquid Fuel Burning Equipment Comm.
G. E. Cain, G. E. Cain & Co.
J. A. Cedervall, Underwriters Laboratories Inc
Donald M. Johnson, San Bruno, CA
Rep. Western Oil & Gas Assn.

F. Owen Kubias, SCM/Glidden
Steven Landon, Roanoke, TX
Rep. Textile Care Allied Trades Assn.
William R. Rucinski, Fire Marshal Div., Lansing, MI

**Technical Committee on
Manufacture of Organic Coatings**

G. E. Cain, *Chairman*
G. E. Cain & Co.

Martin F. Henry, *Secretary*
National Fire Protection Association
(Nonvoting)

Andrew W. Beilfuss Jr., M & M Protection Consultants
Floyd T. Edwards, Industrial Risk Insurers
Nelson W. Lamb, Hercules Inc.
Rep. Chemical Manufacturers Assn.

J. Benjamin Roy Jr., Office of the State Fire Marshal, Delaware
Rep. Fire Marshals Assn. of N. America
Damon W. Snow, Monsanto Co.
Rep. American Petroleum Inst.

Alternate

John Jaresko, Industrial Risk Insurers
(Alternate to F. T. Edwards)

*This list represents the membership at the time the Committee was balloted on the text of this edition.
Since that time, changes in the membership may have occurred*

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Contents

Chapter 1 Introduction	35- 4
Chapter 2 Location of Plants and Buildings	35- 6
2-1 Location	35- 6
2-2 General Layout and Design	35- 6
Chapter 3 Building Construction	35- 7
3-1 General Construction	35- 7
3-2 Drainage	35- 7
3-3 Building Heating	35- 7
3-4 Ventilation	35- 7
3-5 Explosion Venting	35- 7
3-6 Electrical Equipment	35- 8
Chapter 4 Process Equipment and Operations	35- 8
4-1 Transfer of Flammable and Combustible Liquids	35- 8
4-2 Piping, Valves, and Fittings	35- 8
4-3 Kettles, Reactors, and Vessels	35- 9
4-4 Dispersion Equipment	35- 9
4-5 Mixers and Mixing Tanks	35- 9
Chapter 5 Material Storage and Handling	35-10
5-1 Tank Car and Tank Vehicle Unloading and Loading	35-10
5-2 Flammable and Combustible Liquid Storage	35-10
5-3 Storage of Finished Product	35-10
5-4 Container Storage	35-10
5-5 Portable Shipping Tanks	35-10
5-6 Industrial Trucks	35-11
Chapter 6 Special Hazards	35-11
6-1 Nitrocellulose	35-11
6-2 Monomers	35-13
6-3 Organic Peroxides	35-14
Chapter 7 Fire Protection	35-14
7-1 Ignition Sources	35-14
7-2 Static Electricity	35-14
7-3 Lightning Protection	35-14
7-4 Outside Fire Protection	35-14
7-5 Fire Alarm Systems	35-15
7-6 Sprinkler Systems	35-15
7-7 Standpipe and Hose Systems	35-15
7-8 Portable Fire Extinguishers	35-15
7-9 Fixed Extinguishing Systems	35-15
Chapter 8 Personnel Training	35-15
8-1 Fire Brigade	35-15
8-2 Personnel Training	35-15
Chapter 9 Maintenance	35-15
9-1 Maintenance of Fire Protection Equipment	35-15
9-2 Hot Work and Confined Space Entry Permits	35-15
9-3 Cleaning Tanks or Vessels	35-16
9-4 Housekeeping	35-17
Chapter 10 Referenced Publications	35-17
Appendix A	35-17
Appendix B Operational Practices	35-18
Appendix C Referenced Publications	35-20
Index	35-21

NFPA 35

Standard for the Manufacture of Organic Coatings

1987 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates explanatory material on that paragraph in Appendix A.

Information on referenced publications can be found in Chapter 10 and Appendix C.

Chapter 1 Introduction

1-1 Scope and Application.

1-1.1 This standard shall:

1-1.1.1 Apply to facilities and processes used for the manufacture of protective and decorative finishes or coatings for industrial, automotive, marine, transportation, institutional, household, and other purposes.

1-1.1.2 Apply only to those organic coatings manufacturing facilities involving flammable and combustible liquids.

1-1.1.3 Prescribe reasonable measures for safety to life and property from fire and explosion in the operation of manufacturing organic coatings.

1-1.1.4 Provide a means by which plant management and supervisory personnel may evaluate the hazards of operations under their jurisdiction.

1-1.1.5 Provide a guide for design engineers, architects, and others in planning new installations.

1-2 Where unique processes or unusual hazards to life and property are involved, the authority having jurisdiction may require safeguards in addition to those required by this standard or may modify the requirements provided equivalent safety is maintained.

1-3 Existing plants, equipment, buildings, structures, and installations for the storage, handling or use of flammable and combustible liquids that are not in strict compliance with the terms of this standard may be continued in use provided they do not constitute a recognized hazard to life or adjoining property.

1-4 The volatility of liquids is increased by heating. When Class II or Class III liquids are heated above their flash points, ventilation and electrical classification may be necessary in the immediate area. However, the vapors from such heated liquids cool rapidly in the air, limiting the concern to that space in which the temperature of the vapors remains above the flash point of the liquid.

1-5 This standard shall not apply to:

1-5.1 Operations involving the use or application of coatings materials. NFPA 33, *Standard for Spray Application*, and NFPA 34, *Standard for Dipping and Coating Processes Using Flammable or Combustible Liquids*, provide information on this subject.

1-5.2 Storage of organic coatings in locations other than the manufacturing facility. NFPA 30, *Flammable and Combustible Liquids Code*, provides information on this subject.

1-6 Definitions.

Approved. Acceptable to the "authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Closed Container. A container as herein defined, so sealed by means of a lid or other device that neither liquid nor vapor will escape from it at ordinary temperatures.

Container. Any can, barrel, or drum.

Combustible Liquid. A liquid having a flash point at or above 100°F (37.8°C).

Combustible Liquids shall be subdivided as follows:

Class II liquids shall include those having flash points at or above 100°F (37.8°C) and below 140°F (60°C).

Class IIIA liquids shall include those having flash points at or above 140°F (60°C) and below 200°F (93.4°C).

Class IIIB Liquids shall include those having flash points at or above 200°F (93.4°C).

NOTE: This classification does not apply to: (a) liquids without flash points that may be flammable under some condi-

tions, such as certain halogenated hydrocarbons and mixtures containing petroleum fractions and halogenated hydrocarbons, and (b) mists, sprays, or foams.

The volatility of liquids is increased when they are heated. When heated to temperatures equal to or higher than their flash points, Class II and Class III liquids shall be subject to the applicable requirements for Class I or Class II liquids.

Fire Point. The lowest temperature of a liquid in an open container at which vapors are evolved fast enough to support continuous combustion. This shall be determined by ASTM D 92, *Cleveland Open Cup Test Method*.

Flammable Liquid. Any liquid having a flash point below 100°F (37.8°C) and having a vapor pressure not exceeding 40 lb per sq in. (absolute) (2068.6 mm) at 100°F (37.8°C) and shall be known as a Class I liquid.

Class I liquids shall be divided as follows:

Class IA shall include those having flash points below 73°F (22.8°C) and having a boiling point below 100°F (37.8°C).

Class IB shall include those having flash points below 73°F (22.8°C) and having a boiling point at or above 100°F (37.8°C).

Class IC shall include those having flash points at or above 73°F (22.8°C) and below 100°F (37.8°C).

Flash Point. The minimum temperature at which a flammable or combustible liquid will give off sufficient flammable vapors to form an ignitable mixture with air near the surface of the liquid or within the vessel used as determined by the appropriate test procedure and apparatus as specified below:

The flash point of liquids having a viscosity less than 45 SUS (Saybolt Universal Seconds) at 100°F (37.8°C) [approximately 8 centipoise at 77°F (25°C)] and a flash point below 200°F (93.4°C) shall be determined in accordance with the *Standard Method of Test for Flash Point by the Tag Closed Tester*, ASTM D 56.

The flash point of liquids having a viscosity of 45 SUS (Saybolt Universal Seconds) or more at 100°F (37.8°C) [approximately 8 centipoise at 77°F (25°C)] or a flash point of 200°F (93.4°C) or higher shall be determined in accordance with the *Standard Method of Test for Flash Point by the Pensky-Martens Closed Tester*, ASTM D 93.

As an alternate, the *Standard Method of Test for Flash Point of Liquids by Setaflash Closed Tester*, ASTM D 3278 may be used for paints, enamels, lacquers, varnishes, and related products and their components having flash points between 32°F (0°C) and 230°F (110°C), and having a viscosity lower than 150 stokes at 77°F (25°C).

Hot Work. Work involving open flames; cutting and welding using open flames or electric arcs, grinding, buffing, or open unguarded sources of ignition.

Inert Gas. Any gas that is noncombustible, nonreactive, incapable of supporting combustion, noncontaminating for the use intended, and oxygen deficient to the extent required.

Inerting. The use of an inert gas to render the atmosphere of an enclosure or within equipment substantially oxygen free or to reduce the oxygen content to a point at which combustion cannot take place. See NFPA 69, *Standard on Explosion Prevention Systems*.

Liquid. For the purpose of this standard, any material that has a fluidity greater than that of 300 penetration asphalt when tested in accordance with ASTM D 5, *Test for Penetration for Bituminous Materials* (approximately equal to a viscosity of less than 60,000 poise when tested in accordance with ASTM D 2196, *Standard Method of Test for Rheological Properties of Non-Newtonian Materials*). When not otherwise identified, the term liquid shall include both flammable and combustible liquids.

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

Mix Tank. A portable or fixed agitated vessel in which intermediate or finished products are manufactured, adjusted, and held, pending disposition.

Monomers. Unsaturated organic compounds, containing a reactive group, which polymerize by themselves or with other monomers to produce polymers. These monomers may be liquids (styrene, ethyl acrylate), gases (butadiene, vinyl chloride), or solids (acrylamide), and exhibit the same flammability characteristics that would be expected of any organic compound with their physical constants. These monomers represent an additional hazard because of the exothermic heat that would be evolved if uncontrolled polymerization occurred.

Nitrocellulose. A nitrated cellulose (cotton linters or wood pulp) with a nitrogen content ranging from 10.5 percent to 12.6 percent.

(a) **Solvent-Wet Nitrocellulose.** A fibrous, granular, cubed, or flakelike nitrocellulose wetted with not less than 25 percent by weight alcohol, toluene, or other organic liquid having a flash point not lower than 25°F (-40°C).

(b) **Water-Wet Nitrocellulose.** A fibrous, granular, cubed, or flakelike nitrocellulose wetted with not less than 25 percent by weight water.

(c) **Plasticized Nitrocellulose.** A colloidized, chip, or similar-particle-type nitrocellulose plasticized with not less than 18 percent by weight plasticizing substance such as dibutyl phthalate and dioctyl phthalate.

(d) **Dry Nitrocellulose.** Nitrocellulose containing less than the minimum wetting agents described above.

Organic Coatings. Liquid mixtures of binders such as alkyd, nitrocellulose, acrylic, or oil, and flammable and combustible solvents such as hydrocarbon, ester, ketone, or alcohol, which when spread in a thin film convert to a durable protective and decorative finish. These mixtures may contain pigments.

Organic Peroxides. Those organic compounds that are identified by their active oxygen (-O-O-) being combined with the organic radical. This group of reactive chemicals are derivatives of hydrogen peroxides in which one or both hydrogen atoms are replaced by a hydrocarbon or heterocyclic or acid radical. Some peroxides are heat and shock sensitive and are known as "potentially explosive chemicals." Examples of such peroxides are benzoyl peroxide and methyl ethyl ketone peroxide.

Portable Shipping Tank. Any tank having a liquid capacity in excess of 60 U.S. Gallons (227.1 L) and not exceeding 660 U.S. Gallons (2498.1 L), that is readily movable from place to place either with or without special handling equipment and that is not permanently attached to its transporting vehicle.

Safety Can. A listed container, of not more than 5 gal (18.9 L) capacity, having a spring-closing lid and spout cover and so designed that it will safely relieve internal pressure when exposed to external heat.

Unstable (Reactive) Liquid. A liquid that in the pure state or as commercially produced or transported will vigorously polymerize, decompose, or condense, or that will become self-reactive under conditions of shock, pressure, or temperature.

Vapor Pressure. The pressure, measured in pounds per square inch absolute, exerted by a volatile liquid as determined by the *Standard Method of Test for Vapor Pressure of Petroleum Products (Reid Method)*, ASTM D 323.

Chapter 2 Location of Plants and Buildings

2-1 Location.

2-1.1 An organic coatings manufacturing operation shall not be conducted in the same building with other occupancies. Operations incidental to or in connection with organic coatings manufacturing shall not be classed as "other occupancies."

2-1.2 An organic coatings manufacturing operation shall be located so that it is accessible from at least two sides for the purpose of fire control.

2-1.3 Where topographical conditions are such that flammable and combustible liquids may flow from the organic coatings manufacturing operation so as to constitute a fire hazard to other facilities, drainage shall be provided as covered in Section 3-2.

2-2 General Layout and Design.

2-2.1 Congestion shall be avoided in planning an organic coatings manufacturing operation.

2-2.2 Research laboratories, general offices, and storage areas, when located in the same building housing manufacturing operations, shall be cut off from the manufacturing operations by a wall having a fire resistance rating of at least 2 hours, and openings shall be equipped with approved fire doors.

2-2.3 Areas where unstable liquids are handled or processed shall be cut off from the remainder of the plant by a wall having a fire resistance rating of at least 2 hours and openings equipped with approved fire doors.

2-2.4 The location of each processing vessel shall be based upon its flammable or combustible liquid capacity. Processing vessels shall be located, with respect to distances to lines of adjoining property which may be built upon, in accordance with Table 2-2.4(a) and Table 2-2.4(b) except when the processing plant is designed in accordance with 2-2.5.

Table 2-2.4(a)

Processing Vessels With emergency relief Venting to permit pressure	Stable Liquids	Unstable Liquids
Not in excess of 2.5 psig	Table 2-2.4(b)	2½ times Table 2 ¹
Over 2.5 psig	1½ times Table 2-2.4(b)	4 times Table 2 ¹

¹Double distances where protection from exposure is not provided. Protection for exposures shall mean fire protection for structures on property adjacent to tanks. When acceptable to the authority having jurisdiction, such structures located (1) within the jurisdiction of any public fire department or (2) within or adjacent to plants having private fire brigades shall be considered as having adequate protection for exposures.

Table 2-2.4(b)

Capacity Vessel Gal	Minimum Distance in Ft from Property Line Which May Be Built Upon, Including the Opposite Side of a Public Way	Minimum Distance in Ft from Nearest Side of any Public Way or from Nearest Important Building
275 or less	5	5
276 to 750	10	5
751 to 12,000	15	5
12,001 to 30,000	20	5
30,001 to 50,000	30	10

For SI Units: 1 gal = 3.785 L; 1 ft = 0.3048 m

2-2.5 The distances required in 2-2.4 may be waived when the vessels are housed within a building and the exterior wall facing the line of adjoining property which may be built upon is a blank wall having a fire resistance rating of not less than 2 hours.

When Class IA or unstable liquids are handled, the blank wall shall have explosion resistance in accordance with good engineering practice. The balance of the building shall be designed in accordance with Section 3-5.

Chapter 3 Building Construction

3-1 General Construction.

3-1.1* Buildings shall be of fire-resistive or noncombustible construction without basements. The first floor shall be at or above the grade to permit water drainage and vapor diffusion.

3-1.2* Flammable raw materials and finished stock storage shall be detached or cut off from manufacturing buildings by a wall having a fire resistance rating of at least 2 hours, and openings shall be equipped with approved fire doors.

3-1.3 Internal partitions, where used, shall not interfere with ventilation and exit facilities and shall be of noncombustible construction.

3-1.4 In multistory buildings, stairways and elevators shall be enclosed by walls having a fire resistance rating of at least 2 hours and be equipped with approved fire doors.

3-1.5 Each manufacturing room shall have at least two exits, well separated and leading to the outside or other safe area. Access to all exits shall be kept clear, and doors shall open in the direction of exit. Door fastenings shall be equipped with panic hardware. Supervisory management offices and change and locker rooms located in the manufacturing buildings shall be provided with adequate exits. See NFPA 101®, *Life Safety Code*®.

3-2 Drainage.

3-2.1 Drainage facilities shall be provided to direct flammable and combustible liquid leakage and fire protection water to a safe location away from the building, any other items of important value, or adjoining property. This may require pitched floors with drains, curbs, scuppers, impounding basins, or special drainage systems. Traps and special ditch construction may be needed to control the spread of fire where drainage is by an open plant ditch serving other plant areas and possibly offering some fire exposure. NFPA 15, *Standard for Water Spray Fixed Systems*, provides information on this protection.

3-2.2 Emergency drainage systems may contain flammable and combustible liquids. If connected to public sewers or discharged into public waterways, they shall be equipped with traps or separator pits designed to pass water and retain the flammable and combustible liquid.

3-3 Building Heating. Building heating in areas handling Class I liquids, if required, shall be provided by indirect means such as water, steam, or warm air. Ignition

sources such as open flames or electrical heating elements, except units approved for Class I, Group D locations, shall not be used within the hazardous area.

3-4 Ventilation.

3-4.1 Open Containers and Equipment.

3-4.1.1 Enclosed buildings in which Class I liquids are processed or handled in open containers and equipment shall be continuously ventilated at a rate not less than 1 ft³ per minute per sq ft (305 liters per minute per m²) of solid floor area during operation of any equipment. This shall be accomplished by exhaust fans taking suction at floor level and discharging to a safe location outside the building or by natural ventilation. Where there is a potential for vapor emission due to evaporation of Class I liquids, sufficient ventilation shall be provided during a shutdown period to maintain a safe atmosphere.

3-4.1.2 Additional local ventilation may be needed for control of health hazards. Such ventilation, if provided, may be utilized for up to 75 percent of the ventilation recommended in 3-4.1.1. Ventilation shall be arranged to include all pits or other low points where flammable vapors may collect. NFPA 91, *Standard for Blower and Exhaust Systems*, provides information on this subject.

3-4.2 Closed Containers and Equipment.

3-4.2.1 Enclosed buildings in which Class I liquids are processed or handled in closed containers and equipment shall be equipped with a point-of-use and point-of-emission local exhaust ventilation system designed to prevent accumulation of flammable vapors during the operation of the equipment. This shall be accomplished by exhaust fans taking suction at all potential points of flammable vapor release from the equipment. During a shutdown period, when equipment is open and there is a potential for vapor emission, sufficient ventilation shall be provided to maintain a safe atmosphere.

3-4.2.2 Additional floor-level ventilation is required in stagnant areas, such as corners and sumps, pits and other low points where flammable vapors may collect.

3-5 Explosion Venting.

3-5.1 Structures in which Class I liquids, unstable liquids, or finely divided flammable solids are processed shall be provided with explosion venting by one or more of the following methods:

- (a) Open air construction.
- (b) Lightweight noncombustible walls and roof.
- (c) Lightweight noncombustible wall panels and roof hatches.
- (d) Windows of the explosion relief type.

3-5.2 Enclosures shall be vented according to the nature of the materials processed and the type structure. Small enclosures where the whole area may contain an explosive mixture need to be vented more generously than larger areas where only a portion may contain an explosive mixture.

3-5.3 In the selection of suitable venting, the following factors shall be considered:

- (a) Strength of structure or enclosure.
- (b) The maximum explosion pressure.
- (c) The position of the vents with respect to the origin of potential explosions.
- (d) The bursting strength of the vent closure, or the minimum pressure required to open the vent closure if movable as a whole. NFPA 68, *Guide for Explosion Venting*, provides information on this subject.

3-6 Electrical Equipment.

3-6.1 All electrical wiring and equipment shall be installed and maintained in accordance with nationally recognized good practice. NFPA 70, *National Electrical Code*®, provides information regarding such installations.

3-6.2 Where Class I liquids are exposed to the air, the design of equipment and ventilation of buildings shall be such as to limit the Class I, Division 1 location to pits, to the interior of equipment, and to the "immediate vicinity" of pumps or equipment locations such as dispensing stations, sand mills, open centrifuges, plate and frame filters, opened vacuum filters, change cans, and the surfaces of open equipment. Immediate vicinity means a zone extending from the vapor liberation point 5 ft (1.5 m) horizontally in all directions and vertically from the floor to a level 3 ft (1 m) above the highest point of vapor liberation. Beyond the immediate area, it shall be Class I, Division 2, within the confines of the manufacturing room. (See Table 5-7.3 of NFPA 30, *Flammable and Combustible Liquids Code*, and NFPA 497A, *Recommended Practice for Classification of Class I Hazardous (Classified) Locations for Electrical Installations in Chemical Process Areas*.)

3-6.3 If only Class II or Class III liquids are processed and their temperatures are not raised above their flash point, general-purpose electrical equipment is satisfactory.

3-6.4 Where the provisions of 3-6.2 would require the installation of explosionproof switch gear, general-purpose electrical equipment, including switch gear, may be used if located in a nonclassified area or installed in a room or enclosure that is maintained under positive pressure with respect to the classified area. All conduits running from classified to nonclassified areas shall be sealed. Air for pressurization shall be taken from a location where entrainment of flammable vapor is improbable. Refer to NFPA 496, *Standard on Purged Enclosures for Electrical Equipment*.

Chapter 4 Process Equipment and Operations

4-1 Transfer of Flammable and Combustible Liquids.

4-1.1 As far as practical, processes involving the use of flammable and combustible liquids shall be carried out in closed systems of equipment, containers, and piping.

4-1.2 The transfer of large quantities of flammable and combustible liquids shall be through piping, preferably by means of pumps. Where gravity flow is utilized, fail-safe remote-actuated valves shall be provided with emergency shutoffs at points of use and at liquid storage tanks.

4-1.3 The use of compressed air as a transferring or displacement medium shall be prohibited.

4-1.4 Pumps shall be selected that are designed for the flammable and combustible liquid used, the working pressures, and the structural stresses to which they may be subjected.

4-1.5 Where flammable or combustible liquids are pumped from storage to points of use, an emergency switch shall be provided in the processing areas at the normal exit door or at other safe locations outside the fire area and at the pumps to shut down all pumps in cases of fire. The intent is to stop the flow of flammable or combustible liquids.

4-1.6 The dispensing of small quantities of Class I liquids from drums shall be by means of an approved drum pump or by gravity from drums on racks using an approved self-closing faucet and bung vent.

4-1.7 Open containers shall be covered when being transported from one place to another.

4-2 Piping, Valves, and Fittings.

4-2.1 All piping, valves, and fittings in flammable or combustible liquid service shall be designed for the working pressures and structural stresses to which they may be subjected. They shall be of steel or other material approved for the service intended. Cast-iron valves, fittings, and pipe shall not be used.

4-2.2 Valves shall be of an indicating type to show whether open or closed; for example a rising stem, plug, or ball valve. Such valves shall be mounted in a manner that vibration will not cause them to open.

4-2.3 Terminal valves on remote pumping systems shall be of the spring-loaded, self-closing type. They may be manual or held open with a fusible link. The pump shall be controlled by the valve or meter operation.

4-2.4 Piping systems shall be substantially supported and protected against physical damage.

4-2.5 The use of tunnels or stair or elevator towers for flammable and combustible liquid piping shall be avoided. If trenches are unavoidable, they shall be covered with grating trench covers. Trenches shall be filled with sand or bulkheaded at frequent intervals. See Figure A-4-6.2(b) of NFPA 15, *Water Spray Fixed Systems for Fire Protection*, for use of grating trench covers.

4-2.6 A method of relieving trapped liquids, such as relief valves or drainage, shall be provided on piping systems. Approved flexible connectors may be used where vibration exists or where frequent movement is necessary. Approved hose may be used at dispensing stations.

4-2.7 Solvent piping entering equipment such as mixers and kettles shall be bonded to the equipment and designed to minimize the generation of static electricity buildup from free fall or excessive agitation.

4-2.8 Before being placed in service, all piping shall be free of leaks when hydrostatically tested to a minimum of $1\frac{1}{2}$ times the working pressure maintained for a minimum of 30 minutes.

4-3 Kettles, Reactors, and Vessels.

4-3.1 Open-Fire Resin Cooking and Thinning.

4-3.1.1 Adequate fire protection shall be provided based on inert gases or dry chemical. Water shall be avoided.

4-3.1.2 Open-fire kettles shall be located in an outside area, provided with a protective roof, or in a separate building of noncombustible construction, or separated from other areas by means of a wall or partition having a fire resistance rating of 2 hours and openings equipped with approved fire doors.

4-3.1.3 Adequate stacks or other fume disposal system shall be provided to eliminate the fumes or vent them to a safe location.

4-3.1.4 Thinning or reducing operations where portable kettles are used shall be performed in a well-ventilated area separated from the open fires. This area shall be designed so that fumes from the operation are handled in a positive manner to prevent any return to the cooking area. Vapors shall be collected through a vented condenser of adequate size to eliminate any vapor fog.

4-3.2 Closed Reactors and Thin-Down Tanks.

4-3.2.1 Reactors involving the use of solvents are preferably heated by a heat transfer medium. The vaporizer or heat producing equipment shall be remotely located from the process area or otherwise safeguarded as outlined in 4-3.2.2 and 4-3.2.3.

4-3.2.2 The following safeguards shall be provided for all reactors:

(a) Furnace room ventilation shall be maintained with a high-level exit and a low-level entry.

(b) For gas furnaces, there shall be an accessible identified external gas shutoff valve for emergency use.

(c) The reactor shall be provided with a rupture disc located as close as possible to the vessel in case the normal vent becomes inoperative. The discharge piping from the rupture disc shall be directed to a blow-down tank or to a safe location.

4-3.2.3 The following additional safeguards shall be provided:

(a) The fire box shall be instrumented to shut down fuel in case of flame-out to prevent explosions within. For fuel safety controls see NFPA 86, *Standard for Ovens and Furnaces*.

(b) The external area under the kettle where the fire box or furnace is located shall be completely sealed from the process area, particularly the operating floor, to pre-

vent any spills from being ignited. The furnace air intake shall be remotely located from the process area. The exhaust of the hot combustion gases from the fire box shall be piped or ducted away from the process area to prevent its igniting flammable materials due to spills or upsets in process. Under no circumstances shall any combustible material be stored in the furnace room, nor shall the room contain any piping of flammable materials except those connected to the kettle or fire box as part of the process.

(c) The reactor shall be provided with a high temperature limit switch.

4-3.2.4 To prevent a violent foaming or boilover, reactors and thin-down tanks shall be designed and procedures established to avoid uncontrolled introduction of cold liquids into the hot reaction mass.

4-4 Dispersion Equipment.

4-4.1 Two-roll mills or other mills operating with close clearances and which are used for the processing of flammable and heat-sensitive materials, such as nitrocellulose, shall be located in a detached building or in a noncombustible structure without other occupancy. The amount of nitrocellulose or other flammable material brought into the area shall be no more than that required for a batch. A remote manually operated water spray system with an adequate number of heads shall be provided for mill protection.

4-4.2 For the protection of roll mill operators, an emergency shutoff shall be located within easy reach, so that the mill can be stopped if any part of the operator's clothes or body becomes caught in the mill or if the mill should catch fire.

4-4.3 Open mills shall be provided with adequate local ventilation exhausted to outside the building.

4-4.4 High-Speed Dispersers. In a multiple tank installation, the common disperser agitator shall be equipped with a positive locking device. The agitator and tanks shall be bonded and grounded. Covers for the tanks shall be provided.

4-4.5 Pebble Mills and Steel Ball Mills.

4-4.5.1* Ball and pebble mills shall be grounded. Metal chutes or funnels used for adding flammable or combustible liquids to mills shall be extended into the mill as far as possible to minimize free fall and they shall be bonded to the mill or to ground.

4-4.5.2 When pressurizing of pebble and steel ball mills to unload is necessary, inert gas shall be used. Air pressure shall not be used. To protect the mills from overpressure, a relief valve shall be provided and set not to exceed the design pressure of the vessel.

4-5 Mixers and Mixing Tanks.

4-5.1 Processing tanks, day tanks, mix tanks and other vessels needed for processing are permitted in the area and are not to be considered storage tanks.

4-5.2 Mixers used for flammable or combustible products shall be equipped with either full or partial covers consistent with the process being carried out. Such covers shall be closed except for access.

4-5.3 Where gravity flow is used, a shutoff valve shall be installed as close as practical to the vessel being unloaded, and a control valve shall be provided near the end of the discharge pipe. A bond shall be provided between the discharging piping and the receiving container.

Chapter 5 Material Storage and Handling

5-1 Tank Car and Tank Vehicle Unloading and Loading.

5-1.1 Tank vehicle and tank car loading or unloading facilities shall be separated from aboveground tanks, warehouses, other plant buildings, or nearest line of adjoining property which may be built upon by a distance of 25 ft (7.6 m) for Class I liquids and 15 ft (4.5 m) for Class II and Class III liquids, measured from the nearest position of any fill stem. Buildings for pumps or shelters for personnel may be a part of the facility. Operations of the facility shall comply with appropriate portions of NFPA 30, *Flammable and Combustible Liquids Code*. For information on tank vehicles, see NFPA 385, *Standard for Tank Vehicles for Flammable and Combustible Liquids*.

5-2 Flammable and Combustible Liquid Storage.

5-2.1 The storage of flammable or combustible liquids in tanks shall be in accordance with the applicable provisions of NFPA 30, *Flammable and Combustible Liquids Code*.

5-2.2 If the storage of flammable or combustible liquids in outside aboveground or underground tanks is not practical because of temperature considerations or production considerations, tanks inside of buildings or structures shall be in accordance with the applicable provisions of NFPA 30, *Flammable and Combustible Liquids Code*.

5-2.3 Storage tanks inside of buildings shall be permitted only in areas at or above grade which have adequate drainage and are separated from the processing area by construction having a fire resistance rating of at least 2 hours. Openings to other rooms or buildings shall be provided with noncombustible liquidtight raised sills or ramps at least 4 in. (101 mm) in height, or the floor in the storage area shall be at least 4 in. (101 mm) below the surrounding floor. A permissible alternative can be an open-grated trench inside of the room which drains to a safe location. Openings shall be provided with approved self-closing fire doors. The room shall be liquidtight where the walls join the floor.

5-2.4 The storage of flammable or combustible liquids in portable shipping tanks or containers shall be in accordance with the applicable provisions of NFPA 30, *Flammable and Combustible Liquids Code*.

5-2.5 When storing waterborne materials with a flash point but no fire point up to the boiling point of the materials, the reduced fire hazards associated with such storage shall be taken into consideration.

5-3 Storage of Finished Product.

5-3.1 Finished products that are flammable and combustible shall be stored outside of buildings, in a separate building, or in a separate room cut off from the processing area by a wall or partition having at least a 2-hour fire resistance rating, and openings shall be equipped with approved fire doors. The storage of finished products shall be in closed containers or in tanks in accordance with nationally recognized good practice. NFPA 30, *Flammable and Combustible Liquids Code*, provides information on such storage.

5-3.2 Except for custom tinting, flammable and combustible liquids shall not be dispensed, blended, or otherwise exposed in an area used for the storage of finished product.

5-3.3 When storing waterborne materials with a flash point but no fire point up to the boiling point of the materials, the reduced fire hazards associated with such storage shall be taken into consideration.

5-4 Container Storage.

5-4.1 Empty containers previously used for flammable and combustible liquids may be potentially dangerous. Drum plugs shall be replaced, and all empty containers shall be removed to a well-detached, outside location and, if not cleaned on the premises, removed from the plant as soon as practical.

5-4.2 Where containers are stored outside, the area shall be free of grass, weeds, and underbrush.

5-4.3 A maximum of 1100 gal (4163 L) per pile of flammable or combustible liquids, in closed containers, may be stored adjacent to any building located on the same premises and under the same management provided that:

(a) Such a building one or more stories in height has exterior walls of 2-hour fire-resistive construction with no openings above the storage or within 10 ft (3 m) horizontally of such storage pile and,

(b) Each pile of 1100 gal (4163 L) stored along a common wall is separated by 10 ft (3 m).

5-4.3.1 Where the quantity exceeds 1100 gal (4163 L) or provisions of 5-4.3 cannot be met, a minimum distance of 10 ft (3 m) between the building and the nearest container of flammable or combustible liquids shall be maintained. See Chapter 4 of NFPA 30, *Flammable and Combustible Liquids Code*, for further information on container storage.

5-5 Portable Shipping Tanks.

5-5.1 In-Plant Transportation and Storage.

5-5.1.1 The storage of portable shipping tanks shall be in accordance with NFPA 30, *Flammable and Combustible Liquids Code*, and the construction shall comply with NFPA 386, *Portable Shipping Tanks*.

5-5.1.2 Full or part-full portable shipping tanks may be stacked two high, providing they are of the nesting design.

5-5.1.3 All materials-handling equipment used for transporting or lifting portable shipping tanks shall be of ample capacity to lift or transport the full load safely and shall conform to NFPA 505, *Standard for Powered Industrial Trucks*.

5-5.1.4 Floors of buildings and shipping docks shall be structurally able to carry the wheel loads resulting from transporting full portable shipping tanks by means of materials-handling equipment.

5-5.2* Discharging Portable Shipping Tanks.

5-5.2.1 The contents of portable shipping tanks may be discharged by three methods:

(a) The material may be pumped from the top. The portable shipping tanks may or may not have a bottom valve. The pump, pipelines, hoses, or other containers or tanks shall be bonded and grounded.

(b) The material may be pumped from the valve at the bottom of the portable shipping tank. The pump, pipelines, hoses, or other containers or tanks shall be bonded and grounded.

(c) The material may be discharged by gravity from the valve at the bottom of the portable shipping tank. The portable shipping tank, pipelines, hoses, and receiving vessel shall be bonded and grounded.

5-5.2.2 Portable shipping tanks shall not be pressure unloaded.

5-5.3 Filling Portable Shipping Tanks. Portable shipping tanks may be filled by gravity or pump. When filling through an open manhole, bonding shall be provided between the filling pipe and the portable shipping tank.

5-6 Industrial Trucks.

5-6.1 Power-operated industrial trucks that are approved and designated as EX shall be used in areas where flammable vapors exist under normal operating conditions in quantities sufficient to produce ignitable mixtures (Class I, Division 1, Group D electrical classification). Refer to NFPA 70, *National Electrical Code*, for additional information on the interpretation of the electrical classifications referred to herein and NFPA 505, *Standard for Powered Industrial Trucks*, for an explanation of the designations of industrial trucks.

5-6.2 Power-operated industrial trucks that are approved and designated as EX, EE, or DY shall be used in areas where Class I liquids and their vapors are normally within a closed system or container from which the liquid or vapor can escape only in the event of accidental rupture or breakdown of such equipment (Class I, Division 2, Group D electrical classification).

5-6.3 Power-operated industrial trucks that are approved and designated as GS, LPS, DS, ES, EX, EE, or GS/LPS may be used in areas where Class I liquids are

stored in sealed containers if permitted by the authority having jurisdiction.

5-6.4 Power-operated industrial trucks that are approved and designated as EX shall be used in areas where combustible dusts are or may be in suspension in the air continuously, intermittently, or periodically under normal operating conditions in quantities sufficient to produce ignitable mixtures (Class II, Division 1, Group G electrical classification).

5-6.5 Power-operated industrial trucks that are approved and designated as EE, EX, or DY shall be used in areas where combustible dusts are present but not normally in suspension in the air and will not be thrown into suspension in the air by the normal operation of equipment in sufficient quantities to produce ignitable mixtures but where deposits of such dust may be ignited by arcs or sparks originating in the truck (Class II, Division 2, Group G electrical classification).

Chapter 6 Special Hazards

6-1 Nitrocellulose.

6-1.1 Hazards.

6-1.1.1 Nitrocellulose is a flammable material. Its burning rate varies depending on its wetting agent and degree of dryness.

(a) Solvent-wet nitrocellulose, wet with flammable liquids such as alcohol and toluene, has the same degree of hazard as the flammable wetting agent. The burning rate is similar to the wetting agent alone.

(b) Water-wet nitrocellulose is difficult to ignite and, once ignited, is slower burning than solvent-wet nitrocellulose.

(c) Plasticized nitrocellulose burns very intensely and is a more serious fire hazard than solvent-wet nitrocellulose.

(d) Dry nitrocellulose burns rapidly and with intense heat and shall be avoided in all operations.

6-1.1.2 When nitrocellulose burns, toxic gases such as oxides of nitrogen and carbon monoxide are evolved. Personnel shall avoid exposure to these gases.

6-1.2 Handling.

6-1.2.1 The dragging or pushing of drums on hard surfaces shall be avoided because of possible frictional heat.

6-1.2.2 Drums may be moved by means of a two-wheel hand truck fitted with a nonferrous "grab" to hold the top of the drum. A power-driven industrial lift truck of the approved type may also be used as defined in Section 5-6.

6-1.2.3 Drums shall not be dropped. If there is a difference in elevation, the handling equipment shall not drop, puncture, or damage the drums. Always keep drums under control.

6-1.3 Storage.

6-1.3.1 Nitrocellulose shall be stored as follows:

(a) In a room or building attached to the production area, separation shall be by a fire wall with a fire resistance rating of not less than 2 hours with openings equipped with approved fire doors. The fire doors shall be controlled by fusible links mounted on both sides of the wall. The room shall be equipped with an automatic sprinkler system providing a density of 0.35 gpm per sq ft (14.3 L per min per m²) over the entire storage area. A deluge-type system is preferred.

(b) On a detached pad or in a detached noncombustible structure such as a roofed shed, located as shown in Table 6-1.3.1. A sprinkler system providing a density of 0.35 gpm per sq ft (1.3 L/min) is recommended but not mandatory. If, however, the recommended sprinkler system is provided, the distances in Table 6-1.3.1 can be reduced by one-half.

Table 6-1.3.1

Wet Nitrocellulose (Dry Weight)	Distance* of Property Line or Nearest Important Building	
Pounds	Feet	(Meters)
Up to 1000	50	(15)
1000-5000	75	(23)
5000-10,000	100	(30)
10,000-25,000	125	(38)
25,000-50,000	150	(45)
Over 50,000	As Approved by Authority Having Jurisdiction	

For SI Units: 1 lb = 0.454 kg.

*Note: If sprinkler protection is provided as recommended in 6-1.3.1(b) and the other recommendations in Section 6-1.3 are followed, the distances shown can be reduced by one-half.

6-1.3.2* The electrical classification of an attached storage area [see 6-1.3.1(a)] shall be based on the classification of the adjacent process area. In detached storage areas [see 6-1.3.1(b)], a general purpose electrical lighting system is satisfactory. The above is based on the storage areas meeting all the requirements of 6-1.3.

6-1.3.3 Storage of other commodities in the same area as nitrocellulose may be permitted if limited to inert materials that are chemically compatible with the nitrocellulose and the nitrocellulose storage is separated by a distance of 20 ft (6 m). Storage of other flammable liquids shall not be permitted. Nitrocellulose shall be stored only in closed DOT-approved containers. Drums or other containers of nitrocellulose shall not be opened in the main storage area but at the point of use or other location set aside for the purpose.

6-1.3.4 Drums shall be stored in an upright position with the lid up and shall not be tiered more than two high.

6-1.3.5 Nitrocellulose shall be stored in such a manner that the stock will be rotated to assure that the oldest material is used first.

6-1.3.6 Nitrocellulose shall be stored only in approved DOT closed containers. Before storing drums, make sure

their closures are tight in order to prevent loss of wetting agent by evaporation.

6-1.3.7 Heat should be avoided in the storage area. Where heat is necessary, the building should be equipped with low-pressure steam or hot-water radiators. These shall be so located as to avoid contact with the drums of nitrocellulose under any circumstances. Overheating of drums by direct contact with hot surfaces or by storage in an overheated environment may cause pressure buildup in the drums and eventual release of the lid.

6-1.3.8 The storage area shall be marked with a readily visible sign identifying the material and its hazard - i.e., "NITROCELLULOSE - FLAMMABLE - KEEP HEAT, SPARKS, AND FLAME AWAY."

6-1.4 Process Area.

6-1.4.1 The amount of nitrocellulose brought into the operating area shall be kept to a minimum and not exceed that required for a shift. Drums shall remain closed until ready for use. When only part of a drum is used, the lid and ring shall be replaced immediately and the ring tightened.

6-1.4.2 The retaining ring holding the drum cover in place shall be removed by the use of a suitable spark-resistant wrench. If it is necessary to fork or scoop the material out of a barrel, spark-resistant tools shall be used.

6-1.4.3 Any nitrocellulose that may be spilled on the floor or elsewhere shall be promptly wet down with water, swept up, and put into a pail or covered metal container that contains water. The material should be removed at the end of the day or shift and disposed of properly (see 6-1.5.1).

6-1.4.4 After emptying, drums shall be wiped clean with a dry rag or cloth, the cover shall be replaced, and the sealing ring tightened. Rags, after use, shall be placed in a covered waste container, wet down with water, and disposed of daily.

6-1.4.5 Since there is always danger of ignition of nitrocellulose or its solvents, diluents, or solutions from struck sparks, frictional heat, flame, or static electricity, care shall be taken to eliminate these sources of ignition.

6-1.4.6 Solvent wet and plasticized nitrocellulose are free-flowing materials that can generate static electricity while being poured from the drum. To prevent hazardous accumulations of static charge, drums, containers, rings of fiber drums, and vessels shall be bonded and grounded during transfer operations.

6-1.5 Waste Disposal.

6-1.5.1 Sweepings and other small quantities of waste nitrocellulose shall be wet down with water and placed in a covered metal container. Dispose of the waste material by burning in a safe, isolated location or denitrating in an agitated, 5 percent sodium hydroxide aqueous solution in a well-ventilated area. Disposal shall not be by burning in a boiler fire box, incinerator, or other confined equip-

ment. Burning shall only be conducted in accordance with federal, state, or local regulations regarding pollution.

6-1.6 Fire Protection.

6-1.6.1 Water is the most effective fire extinguishing medium for nitrocellulose and shall be used in large quantities.

6-1.6.2 Exposure of drums of nitrocellulose to fire or high heat will cause vaporization of the wetting medium resulting in an increase in pressure which will cause release of the drum lid. Fire fighters shall keep out of range when encountering such situations and avoid breathing fumes given off by burning nitrocellulose. Self-contained breathing apparatus shall be used by fire fighting personnel or others who may be exposed to such fumes in the performance of their duties.

6-2 Monomers.

6-2.1 Hazards.

6-2.1.1 Monomers may be liquids, solids, or gases. They are reactive chemicals and present special hazards because of their chemical composition. They are usually highly flammable, and their vapors, which are normally heavier than air, can form explosive vapor-air mixtures. They usually contain an inhibitor to prevent self-polymerization. At elevated temperatures, such as fire exposure, polymerization may take place. If this occurs in a closed container, a violent rupture may occur.

6-2.1.2 Monomer vapors are usually toxic, and personnel shall avoid exposure to them at all times. Adequate ventilation is mandatory. Personal protective equipment must be used.

6-2.1.3 Suppliers shall be contacted for advice concerning the storage, handling, and use of specific monomers.

6-2.2 Process and Handling.

6-2.2.1 Precautions in handling of monomers shall parallel those outlined for flammable and combustible liquids. Since vapors can be more toxic, the need for adequate ventilation and the availability of respiratory protection for emergencies is of the utmost importance.

6-2.2.2 For specific information on explosion venting and structural design requirements for areas involved with handling of monomers, refer to Section 2-2 ("General Layout and Design") and Section 3-5 ("Explosion Venting") in this standard.

6-2.3 Storage—Liquids and Gases.

6-2.3.1 Aboveground monomer storage tanks shall be located in a remote area. Topography or diversionary diking shall be used to drain spilled monomer from the storage tank area and to prevent exposure from fires in other flammable and combustible liquid storage tanks. Where drainage is impracticable, liquid monomer storage tanks shall be surrounded with an individual dike to contain the monomer in the event of a large leak or overflow. In cases of diversionary diking, an impounding basin is usually required to provide effective fire contain-

ment and minimize contamination problems. NFPA 30, *Flammable and Combustible Liquids Code*, specifies locations for liquid monomer storage and drainage and diking methods.

6-2.3.2 Monomers may need to be individually piped to prevent contamination which may promote polymerization.

6-2.3.3 Monomer storage tanks shall have a normal vent and a separate emergency vent. See NFPA 30, *Flammable and Combustible Liquids Code*, for venting requirements. The emergency vent shall be designed on the basis of the effects of heat or gas resulting from polymerization or self-reactivity.

6-2.3.4 Some monomers are sensitive to temperature extremes. The storage tanks shall be provided with a means to control the temperature. Water spray, cooling coils, reflective paints, overhead cover, and insulation are all methods that can be used.

6-2.3.5 Since monomers are reactive chemicals having inhibitors to prevent reaction in storage, the strength of these inhibitors shall be checked periodically to make sure they are at a safe level. Some systems, such as hydroquinone in styrene, lose their effectiveness to inhibit polymerization under certain time and temperature conditions.

6-2.3.6 Some monomers are not highly flammable and can be stored under an air atmosphere. Others, which have low flash points (Class I liquids), may be stored under an inert gas atmosphere to minimize polymer formation and improve fire safety.

6-2.3.7 Materials of construction for tanks, pipelines, pumps, and auxiliary equipment shall conform to the recommendations of the supplier of the monomer.

6-2.4 Storage—Solid. Solid monomers may be shipped in drums or bags. Normally solid monomers are not subject to self-polymerization unless they are liquefied or subjected to elevated temperatures. Storage therefore shall be at ambient temperature, isolated, where drums and bags will not be damaged, and free from any possibility of contamination with reactive chemicals or moisture.

6-2.5 Waste Disposal.

6-2.5.1 All quantities of waste monomers or material contaminated with monomers shall be disposed of according to federal, state, and local regulations regarding hazardous waste.

6-2.5.2 When a waste disposal problem arises as a result of a major spill or equipment rupture, only properly protected personnel shall remain in the area.

6-2.6 Fire Protection.

6-2.6.1 Fires involving monomers can generally be controlled and extinguished using dry chemical, water spray, proper type foam and carbon dioxide.

6-2.6.2 Self-contained respiratory equipment shall be used to avoid exposure to toxic vapors.

6-3 Organic Peroxides.

6-3.1 Organic peroxides are considered to be "unstable" chemicals and present a serious problem in safe handling. They may be powerful oxidizing agents and may react violently with reducing agents and some on exposure to heat or shock. Only general details can be offered here, and suppliers and the authority having jurisdiction shall be consulted wherever these materials are to be used.

6-3.2 In general organic peroxides are stored in cool locations. In very hot weather artificial cooling may be necessary to prevent decomposition of the peroxide. In cold climates artificial heat may be necessary to prevent the formation of shock-sensitive crystals. For example, acetyl peroxide (25 percent solution in dimethyl phthalate) shall not be exposed to temperatures above 90°F (32.2°C), violent decomposition may occur above 122°F (50°C), and shock-sensitive crystals may be formed below 17°F (-8°C). Further information may be found in NFPA 49, *Hazardous Chemicals Data*.

6-3.3 The storage of organic peroxides shall be isolated from flammable and combustible liquid storage, any important building, or line of adjoining property that may be built upon. Large-quantity storage of organic peroxides in highly populated areas shall be avoided. Only quantities sufficient for one day's operation shall be present in the operating areas.

6-3.4 The size of the package containing the organic peroxide shall be selected so that, as nearly as practical, full packages are utilized at one time, thus minimizing exposure to personnel and contamination of the product. Any peroxide spilled shall be promptly cleaned up and disposed of as recommended by the supplier.

6-3.5 The hazards incident to the storage and use of organic peroxides may be materially reduced when protected by a properly designed automatic sprinkler system.

Chapter 7 Fire Protection

7-1 Ignition Sources.

7-1.1 When electrical equipment is repaired or replaced, caution shall be exercised to assure that the integrity of the area electrical classification is maintained in accordance with Section 3-6.

7-1.2 Relocation, redirection, or replacement of fittings and piping may negate previous bonding and/or grounding arrangements. Piping installations made under any maintenance activity shall conform to Sections 4-1, 4-2, and 7-2.

7-1.3 Open flames and direct-fired heating devices shall be prohibited in areas where flammable vapor-air mixtures may exist.

7-1.4 Smoking shall be prohibited except in designated safe areas.

7-2 Static Electricity.

7-2.1 All equipment such as tanks, machinery, and piping where a flammable mixture may be present shall be bonded and connected to a ground. The bond or ground or both shall be physically applied or shall be inherently present by the nature of the installation. For static dissipation purposes, this electrically conductive path shall not have a resistance of more than one million ohms to ground. NFPA 77, *Recommended Practice on Static Electricity*, provides information on this subject.

7-2.2 Electrically isolated sections of metallic piping or equipment shall be bonded to the other portions of the system or grounded to prevent external ignition hazards.

7-2.3 When flammable liquids are transferred to or from any portable container, all metallic elements, including the container, greater than 1 gal (3.785 L) in size, shall be bonded together and one element shall be grounded.

7-2.4 A bond or ground shall be composed of suitable conductive materials having adequate mechanical strength, corrosion resistance, and flexibility for the service intended. No. 10 AWG wire, preferably uninsulated, is the minimum size that shall be used. Permanent connections may be made with electrical cable lugs, bolted clamps, by brazing, welding, or other suitable means.

7-2.5 Ordinary rubber or leather flat belts generate static. Such belts used to transmit power shall be made of conductive material or treated with a conductive belt dressing. Such coatings shall be checked periodically to assure reliability.

7-2.6 When flammable and combustible liquids are permitted to fall an appreciable distance through space, a static charge may be generated due to the breaking up into a spray or droplets. A method used to reduce this hazard is to extend the fill pipe to the bottom of the equipment or container, or divert the flow to the side of the equipment or container. This will help to keep the flow in a solid stream and reduce splashing.

7-3 Lightning Protection.

7-3.1 High masonry stacks and chimneys shall be provided with approved lightning protection.

7-3.2 Where needed, approved lightning protection shall be provided for buildings, structures, and equipment.

7-3.3 Steel framing of buildings shall be grounded with resistance of not more than five ohms. NFPA 78, *Lightning Protection Code*, provides information on this subject.

7-4 Outside Fire Protection. Where good public fire protection facilities are not readily available, private outside protection facilities shall be provided in accordance with NFPA 24, *Standard for the Installation of Fire Ser-*

vice Mains. Even with good public protection facilities, it may be necessary to provide private outside protection facilities for large or remote facilities.

7-5 Fire Alarm Systems. A method of notifying personnel and the fire brigade of a fire or emergency shall be provided.

7-6 Sprinkler Systems.

7-6.1 Important manufacturing and storage buildings shall be protected by sprinkler systems installed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

7-6.1.1 In sections where large quantities of flammable liquids may be involved or where flammable vapor may be present, the sprinkler system shall be wet pipe, pre-action, or deluge type.

7-6.1.2 Water supply for sprinklers and other water systems shall be of adequate pressure and capacity for the highest fire flow demand in any one fire with ample reserve for necessary hose streams. Where severe hazards are involved, including areas with high-piled stock, the sprinkler systems shall be hydraulically calculated and supplied accordingly. Although fires involving some solvents may not be extinguished by water, a liberal supply of water from sprinklers controls the flames and helps keep the structure, equipment, and the supports cool, thereby preventing collapses. (See NFPA 231, *Indoor General Storage*, and NFPA 231C, *Rack Storage of Materials*.)

7-6.1.3 Adequate drainage facilities shall be provided for water from sprinkler systems or other water extinguishing systems (see Section 3-2).

7-7 Standpipe and Hose Systems. A standpipe and hose system shall be provided in important operating buildings. A system designed for in-plant (Class II or Class III) service in accordance with NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, shall be provided. Only combination nozzles or spray nozzles shall be used. The use of a straight-stream type of nozzle or play pipe shall be avoided as a stream from such a nozzle tends to spread a flammable liquid fire or stir up a dust cloud.

7-8* Portable Fire Extinguishers. An adequate supply of portable fire extinguishers suitable for flammable and combustible liquid fires shall be provided. NFPA 10, *Standard for Portable Fire Extinguishers*, provides additional information.

7-9 Fixed Extinguishing Systems.

7-9.1* Equipment such as mixers, solvent tanks, or fixed open containers may be protected by foam, inert gas, halogenated agent, or dry chemical extinguishing systems.

7-9.2 When desired, a combination automatic sprinkler system and high-expansion foam system properly designed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, and NFPA 11A, *Standard for High Expansion Foam Systems*, may be permitted.

7-9.3 When desired, an automatic sprinkler system may be equipped to inject aqueous film-forming foam (AFFF) into it when properly designed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*, NFPA 11, *Standard for Low Expansion Foam and Combined Agent Systems*, and NFPA 16, *Standard for the Installation of Deluge Foam-Water Spray Systems*.

Chapter 8 Personnel Training

8-1* Fire Brigade. In manufacturing plants, a fire brigade shall be organized and trained to fight fires promptly and efficiently. Fire brigade training shall be conducted at periodic intervals using the various kinds of fire fighting equipment provided. For further information see NFPA 600, *Recommendations for the Organization, Training and Equipment of Private Fire Brigades*.

8-2* Personnel Training.

8-2.1 Personnel shall be made aware of special hazards and shall be trained in proper procedures for safe operation of processes, as well as emergency shutdown procedures for unusual conditions.

8-2.2 Personnel shall be trained in the use of portable fire extinguishers, methods of actuating fixed special extinguishing systems, and methods of notifying plant fire brigade, public fire department, and emergency organization.

8-2.3 Personnel involved shall be periodically instructed as to the identity and potential dangers of hazardous materials.

8-2.4 All employees shall be trained to prevent and contain spills and to report solvent leaks, faulty equipment, missing or worn static bonding lines, and other matters requiring correction.

Chapter 9 Maintenance

9-1 Maintenance of Fire Protection Equipment. All plant fire protection facilities shall be so maintained and periodically inspected and tested as to make sure that they are in satisfactory operating condition to serve their purpose in time of emergency.

9-2 Hot Work and Confined Space Entry Permits.

9-2.1 When necessary to make repairs involving "hot work," the work shall be authorized in writing by the responsible individual in charge before the work is started.

9-2.2 When necessary to enter a tank, pit, manhole, or other confined spaces, such entry shall be authorized by the responsible individual in charge. Another employee shall stand by while the person is in the confined space.

9-2.3 Prior to initiating tank entry or hot work, the following steps shall be taken:

9-2.3.1 Tanks, vessels, piping, and traps shall be emptied of all material, cleaned, and purged. All such materials shall be removed to a safe location.

9-2.3.2 All pipelines except air or cold water attached to the vessel shall be disconnected, blanked off, or capped with suitable material of a construction that will prevent leakage. Where more than one unit is connected by a common duct, the duct openings to the vessel to be entered shall be disconnected or blanked. Steam jets in stacks shall be removed or disconnected if the stack is not disconnected from the vessel.

9-2.3.3 If a vessel is fitted with power-driven internal equipment, the power source shall be disconnected completely before entry; that is, the motor disconnect switch shall be padlocked in the off position and the key of the padlock shall remain in the possession of the person doing the work.

9-3 Cleaning Tanks or Vessels.

9-3.1 The cleaning of tanks or vessels that have contained flammable or combustible liquids shall only be done under the supervision of persons who understand the fire and explosion potential, assisted by properly trained personnel in order to safely carry out the operations. This article is directed towards the cleaning operations of tanks and vessels preparatory to entry by plant personnel or for the performance of "hot work." For hot work permits, see Section 9-2. NFPA 327, *Standard Procedures for Cleaning or Safeguarding Small Tanks and Containers*, provides detailed information on the procedures to be followed for the various methods of cleaning or safeguarding a tank or vessel.

9-3.2 The removal of residues and the cleaning of the tanks or vessels shall be accomplished by one of the following methods:

9-3.2.1 When the solvents that have been used are water soluble, such as ethyl alcohol and methyl ethyl ketone, the cleaning operation may be accomplished by filling with water and draining, repeating the operation several times. Drainage of the contaminated waste water shall be to a safe location.

9-3.2.2 When needed, a suitable hot chemical solution or a nonflammable proprietary cleaning agent may be used. Since these cleaning agents are potentially harmful, suitable protective goggles and clothing shall be worn to protect against possible injury to the eyes or skin. Tanks that have contained reactive or unstable materials shall not be cleaned or repaired until instructions have been obtained from the manufacturer or supplier. Safe cleaning procedures require care in the selection of nonreactive cleaning media or other special precautions. Avoid the use of hot water in making up caustic solutions. In preparing caustic solutions the caustic shall be added at a controlled rate to cold water. When using a proprietary cleaning solution, the manufacturer's instructions shall be followed. The drainage of the solution shall be to a safe location.

9-3.2.3 Where alkali cleaners are not feasible or safe, a suitable flammable solvent agitated or injected in the interior of a closed vessel to be cleaned may be used safely providing the vapor space is reliably inerted prior to adding the solvent by using an inert gas such as carbon dioxide or nitrogen. When carbon dioxide is used for inerting, vaporizing means shall be provided to assure that only gas is applied to the vessel. Carbon dioxide fire extinguishers shall not be used to inert a vessel, as they will produce electrostatic sparks that could cause ignition. The inert gas piping shall be bonded to the vessel into which the gas is to be discharged, making sure the vessel in fact is properly grounded. The cleaning solvent and residue shall be drained to appropriate containers. Such containers shall also be properly bonded to the vessel from which the solvent is being drained.

9-3.2.4 Vapor freeing may be accomplished by purging with air, and a safe atmosphere may be sustained by continued ventilation. When fixed ventilating equipment is not provided, air movers may be attached so that air is drawn into the equipment and discharged through the air mover, or air may be introduced through the air mover and discharged through another opening. Discharge shall be to a safe location. Air movers shall be approved for such locations. In air purging, the concentration of vapor in air usually will go through the flammable range before a safe atmosphere is obtained; therefore, precautions shall be taken to ensure that the air mover is bonded to the equipment in order to minimize the hazard of ignition by static electricity. By first purging the equipment with an inert gas and then ventilating with air, the hazards incident to passing through the flammable range are minimized.

9-3.2.5 The need for personal protective equipment must be evaluated before each tank cleaning operation. Needed personal protective equipment shall be provided, and use enforced, during cleaning operations.

9-3.3 To ensure safe conditions for vessel entry and work, the following tests shall be conducted:

9-3.3.1 A test for oxygen deficiency and, where indicated, for toxicity shall be made before entry. If these conditions are present and cannot be overcome by cleaning and ventilation, then self-contained respiratory equipment shall be used. A minimum allowable oxygen concentration of 18 percent without toxic contaminants shall be indicated by readings taken at varying heights within the vessel to ensure a safe breathable atmosphere.

9-3.3.2 Tests for flammable vapors with a combustible gas indicator or other approved means shall be made: (1) before commencing alterations or repairs, including welding, cutting, or heating operations; (2) immediately after starting any welding, cutting, or heating operations; and (3) frequently during the course of such work. All such work shall be stopped immediately when the presence of solvent vapor is indicated. The source of the vapor shall be located and removed, and the procedure outlined above shall be followed before such work is resumed.

9-3.4 If it is desired to clean a tank solely for the purpose of product purity or change of product, one of the procedures outlined in 9-3.3 may be followed.

9-4 Housekeeping.

9-4.1 Good housekeeping is vital in maintaining a safe plant. Accumulations of debris, rags, sample cups, and similar material shall not be permitted.

9-4.2 Adequate aisles shall be maintained for unobstructed movement of personnel so that fire protection equipment can be brought to bear in all parts of processing and storage areas of buildings.

9-4.3 Floor Cleaning. Whenever possible, floor cleaning shall be done without the use of flammable or combustible liquids. The material being removed shall be evaluated for its potential fire and health hazards before cleaning begins. Adequate fire protection and personal protective equipment must be provided and used during the operation. Residues and cleaning equipment (mops, rags, etc.) shall be disposed of in a safe manner. For further information on floor cleaning, see Health and Safety Bulletin No. 38, *Paint Plant Floor Cleaning*, published by the National Paint and Coatings Association.

Chapter 10 Referenced Publications

10-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference shall be the current edition as of the date of the NFPA issuance of this document. These references shall be listed separately to facilitate updating to the latest edition by the user.

10-1.1 NFPA Publications. National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

NFPA 10-1984, *Standard for Portable Fire Extinguishers*

NFPA 11-1983, *Standard for Low-Expansion Foam and Combined Agent Systems*

NFPA 11A-1983, *Standard for Medium and High Expansion Foam Systems*

NFPA 13-1987, *Standard for the Installation of Sprinkler Systems*

NFPA 14-1986, *Standard for the Installation of Standpipe and Hose Systems*

NFPA 15-1985, *Standard for Water Spray Fixed Systems for Fire Protection*

NFPA 16-1986, *Standard on Deluge Foam-Water Sprinkler and Foam-Water Spray Systems*

NFPA 24-1984, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*

NFPA 70-1987, *National Electrical Code*

NFPA 78-1986, *Lightning Protection Code*

NFPA 86-1985, *Standard for Ovens and Furnaces*

NFPA 91-1983, *Standard for the Installation of Blower and Exhaust Systems for Dust, Stock and Vapor Removal or Conveying*

NFPA 101-1985, *Life Safety Code*

NFPA 327-1987, *Standard Procedures for Cleaning or Safeguarding Small Tanks and Containers*

NFPA 385-1985, *Standard for Tank Vehicles for Flammable and Combustible Liquids*

NFPA 386-1985, *Standard for Portable Shipping Tanks for Flammable and Combustible Liquids*

NFPA 505-1982, *Fire Safety Standard for Powered Industrial Trucks Including Type Designation, Areas of Use, Maintenance and Operation*

Appendix A

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

A-3-1.1 It is recommended that manufacturing buildings be limited to two stories in height and preferably they should be one story or one story with mezzanine.

A-3-1.2 It is recommended that raw material and finished stock storage buildings be confined to one story in height.

A-4-4.5.1 Before adding solvents to the mill, it should be reliably inerted. If a high-pressure cylinder is used to supply the inert gas, it should be equipped with a reducing valve to add the inert gas at low pressure. Provide adequate ventilation to take away the displaced air and vapors.

A-5-5.2 The discharge outlet from the portable shipping tank should be equipped with a spring-actuated fusible link valve or a dead-man valve.

A-6-1.3.2 Although nitrocellulose is classified as a flammable liquid by DOT, it is a solid, wetted with alcohol, and as such, there is no "free" liquid in the drum. This means a leak of a damaged nitrocellulose drum will not result in a solvent spill that could create a serious flammable vapor in the storage area.

A-7-8 If the manufacturing building covers a large area containing several large mixers, change cans, and solvent-measuring tanks handling large quantities of flammable material, it is recommended that several large wheeled units be provided and strategically located near an exit.

A-7-9.1 For further information see NFPA 11, *Standard for Foam Extinguishing Systems*; NFPA 11A, *Standard on High Expansion Foam Systems*; NFPA 12, *Standard on Carbon Dioxide Extinguishing Systems*; NFPA 12A, *Standard on Halon 1301 Fire Extinguishing Systems*; NFPA 12B, *Standard on Halon 1211 Fire Extinguishing Systems*; NFPA 16, *Standard for Deluge Foam-Water Sprinkler and Spray Systems*; and NFPA 17, *Standard for Dry Chemical Extinguishing Systems*. Foam hose streams are valuable in extinguishing fires in tanks and indoor or outdoor fires in case of flammable or com-

bustible liquid spills. Foam powder or foam liquid should be of the type suitable for specific solvent fires. A reasonable amount of foam-producing materials and equipment and adequate water supply, hose, and nozzles should be provided.

A-8-1 Plant Security. In order to keep unauthorized persons from premises with yard area, it is recommended that it be enclosed with an industrial fence or other suitable barrier. Installation of perimeter lighting and use of modern intrusion detection devices may also be warranted.

A-8-2 Safety Committee. It is recommended that a committee with a rotating membership be organized and hold meetings at which safety and fire protection problems are discussed. Such discussions would include the procedure to be followed in carrying out regular as well as unusual work tasks.

Appendix B Operational Practices

This Appendix is not a part of the requirements of this NFPA document, but is included for information purposes only.

B-1 Safety Work Permit.

Where repair work is required in a restricted area by plant or outside personnel, a work permit authorized by the responsible individual in charge should be issued after

inspection is made to assure safe procedures for the work specified. This permit should be restricted as to date and time for each specified job with additional copies as needed (*see Figure 1*).

B-2 Tank or Confined Space Safety Permit.

Before any person is permitted to enter a tank or other confined space, someone in responsible authority should review in detail with those entering the enclosure the hazards of the product and what precautions should be taken before work is started. The procedure (*see Figure 2*) should be completed in detail before any person enters the confined space.

During the time any person(s) is in a tank or confined space, he (they) should wear an approved safety harness with a line outside the tank which is held by a person outside the tank. The persons involved should be in visual and voice communications. At least one other person should be within calling distance.

Portable compressed gas and manually operated horn units to assist in attracting attention of personnel may be desirable for rescue operations.

B-3 Preventive Maintenance.

In most plants a plan of regular scheduled shutdowns is followed. During these periods the repair work is undertaken which cannot be done safely or effectively while the plant is operating. This affords an excellent opportunity for detailed inspection of the equipment in order to detect and correct conditions that may be the cause of unnecessary hazards developing and untimely and costly interruptions in plant operations.

Figure 1

SUGGESTED SAFETY WORK PERMIT

To..... Department.....

For: (a)..... All repair work done by outside departments.
 (b)..... Hot Work — Welding (gas or electric), burning or any work requiring or producing heat, flame, sparks, or electric current.
 (c)..... Entering a vessel.

Good For: Date Time A.M.
 P.M.
 To Date Time A.M.
 P.M.

Area.....
 Describe work to be done.....

NOTE: Write in yes or no. If question does not apply, check it off indicating that it has been given consideration.

1. Can the equipment be removed from the building?
2. Can this work be done other than by the use of flame?
3. Have all process materials (solids, liquids, gases) been removed from the equipment?
4. Can sparks ignite material in vicinity or on lower floors or levels?
5. Have connections been blanked off?
6. Have valves been tagged and/or locked closed?
7. Have switches been tagged open?
8. Has equipment and all attached piping been cleaned?
9. Has equipment been ventilated?
10. Have trenches and sewer openings been covered and steam turned on?
11. Has gas test been made?
12. Is adjacent equipment safe?
13. Has workman been given proper instructions?

NOTE: Equipment or material to be removed for repair or disposal must be passed by Department Supervisor as free from dangerous material.

Are there any special precautions to be observed?

OPERATING SUPERINTENDENT SAFETY FIRE INSPECTOR

 MAINTENANCE FOREMAN
 To Workman

Figure 2

SUGGESTED APPROVAL SHEET FOR WORK IN TANKS OR CONFINED SPACES

LOCATION	EQUIPMENT	MATERIAL IN TANK OR AREA	DATE
Check	PREPARATION OF TANK OR AREA	EXPLAIN IF NOT CHECKED	
<input type="checkbox"/>	Tank steamed for hours.		
<input type="checkbox"/>	Flushed with water.		
<input type="checkbox"/>	Atmosphere tested and approved by Safety Dept. Representative or Supervisor.		
<input type="checkbox"/>	All lines disconnected or blanked off close to tank.		
<input type="checkbox"/>	Ventilated with blower.		
<input type="checkbox"/>	Blower checked by Electrical Department.		
<input type="checkbox"/>	Proper tools provided.		
<input type="checkbox"/>	Revolving tanks or tanks with stirrers or agitators are locked out.		
<input type="checkbox"/>	Fire Permit Issued. No Permit.		
<input type="checkbox"/>	Life line checked and ready for use.		
<input type="checkbox"/>	Air mask ready for use.		
<input type="checkbox"/>	Extra man present to be on hand entire time man is in tank or confined area.		
<input type="checkbox"/>	Ladder to climb out of tank or area available.		
<input type="checkbox"/>	Other work in area that might create hazard to man in tank or area investigated and, if necessary, stopped.		
<input type="checkbox"/>	Reasons for safety measures explained to man about to enter tank.		
<input type="checkbox"/>	Proper Fire Equipment on site.		
What provisions have been made to handle the residue of the tank?			

ADDITIONAL REMARKS:

I understand the hazards present and the precautions to be observed as checked above.

OPER. DEPT. SUPERVISOR ENG. DEPT. SUPERVISOR APPROVED: SAFETY REP.

Appendix C Referenced Publications

C-1 The following documents or portions thereof are referenced within this standard for informational purposes only and thus are not considered part of the requirements of this document. The edition indicated for each reference should be the current edition as of the date of the NFPA issuance of this document. These references should be listed separately to facilitate updating to the latest edition by the user.

C-1.1 NFPA Publications. National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

NFPA 12-1985, *Standard on Carbon Dioxide Extinguishing Systems*

NFPA 12A-1985, *Standard on Halon 1301 Fire Extinguishing Systems*

NFPA 12B-1985, *Standard on Halon 1211 Fire Extinguishing Systems*

NFPA 17-1985, *Standard for Dry Chemical Extinguishing Systems*

NFPA 30-1984, *Flammable and Combustible Liquids Code*

NFPA 33-1985, *Standard for Spray Application Using Flammable and Combustible Materials*

NFPA 34-1987, *Standard for Dipping and Coating Processes Using Flammable or Combustible Liquids*

NFPA 49-1975, *Hazardous Chemicals Data*

NFPA 68-1978, *Guide for Explosion Venting*

NFPA 69-1986, *Standard on Explosion Prevention Systems*

NFPA 77-1983, *Recommended Practices on Static Electricity*

NFPA 231-1987, *Standard for General Storage*

NFPA 231C-1986, *Standard for Rack Storage of Materials*

NFPA 496-1986, *Standard for Purged and Pressurized Enclosures for Electrical Equipment*

NFPA 497A-1986, *Recommended Practice for Classification of Class I Hazardous (Classified) Locations for Electrical Installations in Chemical Process Areas*

NFPA 600-1986, *Recommendations for Organization, Training and Equipment of Private Fire Brigades*

C-1.2 ASTM Publications. American Society for Testing and Materials, 1916 Race St., Philadelphia, PA 19103.

ASTM D 5-73 (1978), *Test for Penetration for Bituminous Materials*

ASTM D 56-79, *Standard Method of Test for Flash Point by the Tag Closed Tester*

ASTM D 92-72, *Cleveland Open Cup Test Method*

ASTM D 93-80, *Standard Method of Test for Flash Point by the Pensky-Martens Closed Tester*

ASTM D 323-72, *Standard Method of Test for Vapor Pressure of Petroleum Products (Reid Method)*

ASTM D 2196-74, *Standard Method of Test for Rheological Properties of Non-Newtonian Materials*

ASTM D 3278-78, *Standard Method of Test for Flash Point by Setaflash Closed Tester*

C-2 Other Publication. The following publication is available from the National Paint and Coatings Association, 1500 Rhode Island Avenue NW, Washington, DC 20005.

Health and Safety Bulletin No. 38, *Paint Plant Floor Cleaning*.

Index

© 1987 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

-A-	-H-
Application of standard 1-1 thru 1-5	Hazards Monomers 6-2 Nitrocellulose 6-1.1 Heating, buildings 3-3 Hot work 9-2 Definition 1-6 Housekeeping 9-4
-B-	-I-
Buildings Construction Chap. 3, A-3-1 Drainage 3-2 Electrical equipment 3-6 Explosion venting 3-5 Heating 3-3 Layout and design 2-2 Location 2-1 Ventilation 3-4	Ignition sources 7-1 Industrial trucks see Trucks, Industrial Inerting Definition 1-6
-C-	-K-
Cleaning Floors 9-4.3 Tanks or vessels 9-3 Confined space, permission to enter 9-2.2, B-2 Containers Closed Definition 1-6 Ventilation 3-4.2 Definition 1-6 Open, ventilation 3-4.1 Storage of 5-4	Kettles 4-3 -L- Lightning protection 7-3 Liquids Definition 1-6 Flammable and combustible Definitions 1-6 Storage 5-2 Transfer of 4-1 Unstable (reactive) Definition 1-6
-D-	-M-
Dispersion equipment 4-4, A-4-4.5.1 Drainage, buildings 3-2	Maintenance, preventive B-3 Material storage and handling Chap. 5 Mills Open 4-4.3 Pebble and steel ball 4-4.5 Roll 4-4.1, 4-4.2 Mixers 4-5 Monomers 6-2 Definition 1-6 Fire protection 6-2.6 Hazards 6-2.1 Process and handling 6-2.2 Storage—liquids and gases 6-2.3 Storage—solids 6-2.4 Waste disposal 6-2.5
-E-	-N-
Electrical equipment 3-6 Explosion venting 3-5 Extinguishers, portable fire 7-8, A-7-8	Nitrocellulose 6-1 Definition 1-6 Fire protection 6-1.6 Handling 6-1.2 Hazards 6-1.1 Process area 6-1.4 Storage 6-1.3 Waste disposal 6-1.5
-F-	-O-
Finished product, storage of 5-4 Fire alarm systems 7-5 Fire brigade 8-1, A-8-1 Fire point Definition 1-6 Fire protection Chap. 3 Monomers 6-2.6 Nitrocellulose 6-1.6 Outside 7-4 Fire protection equipment, maintenance of 9-1 Fittings 4-2.1 Fixed extinguishing systems 7-9, A-7-9.1 Flash point Definition 1-6 Floors, cleaning of 9-4.3	Operational practices App. B
-G-	
Gases, inert Definition 1-6	

Organic coatings	
Definition	1-6
Organic peroxides	6-3
Definition	1-6

-P-

Piping	4-2
Plants	
Layout and design	2-2
Location	2-1
Security	A-8-1
Process area	
Nitrocellulose in	6-1.4
Process equipment and operations	Chap. 4

-R-

Reactors	4-3
Closed	4-3.2
Resin cooking and thinning, open fire	4-3.1

-S-

Safety can	
Definition	1-6
Safety committee	A-8-2
Safety permits	B-1, B-2
Scope of standard	1-1
Sprinkler systems	7-6, 7-9.2, 7-9.3
Standpipe and hose systems	7-7
Static electricity	7-2
Storage	
Containers	5-4
Finished product	5-3
Flammable and combustible liquids	5-2
Monomers	6-2.3, 6-2.4
Nitrocellulose	6-1.3

Organic peroxides	6-3
Portable shipping tanks	5-5

-T-

Tank car and vehicle unloading and loading	5-1
Tanks	
Cleaning	9-3
Mix	4-5
Definition	1-6
Portable shipping	5-2.4, 5-5
Definition	1-6
Discharging	5-5.2, A-5-5.2
Filling	5-5.3
In-plant transportation and storage	5-5.1
Safety permit	B-2
Storing flammable and combustible liquids	5-2
Thin-down	4-3.2
Testing for vessel entry and work	9-3.3
Training of personnel	8-2, A-8-2
Trucks, industrial	5-6

-V-

Valves	4-2
Vapor pressure	
Definition	1-6
Ventilation	3-4
Closed containers and equipment	3-4.2
Open containers and equipment	3-4.1
Venting, explosion	see Explosion venting
Vessels	4-3
Cleaning	9-3

-W-

Waste disposal	
Monomers	6-2.5
Nitrocellulose	6-1.5