

NFPA[®] 36

Standard for Solvent Extraction Plants

2025 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471
An International Codes and Standards Organization

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REVISION SYMBOLS IDENTIFYING CHANGES FROM THE PREVIOUS EDITION

Text revisions are shaded. A **Δ** before a section number indicates that words within that section were deleted and a **Δ** to the left of a table or figure number indicates a revision to an existing table or figure. When a chapter was heavily revised, the entire chapter is marked throughout with the **Δ** symbol. Where one or more sections were deleted, a **•** is placed between the remaining sections. Chapters, annexes, sections, figures, and tables that are new are indicated with an **N**.

Note that these indicators are a guide. Rearrangement of sections may not be captured in the markup, but users can view complete revision details in the First and Second Draft Reports located in the archived revision information section of each code at www.nfpa.org/docinfo. Any subsequent changes from the NFPA Technical Meeting, Tentative Interim Amendments, and Errata are also located there.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

ADDITIONAL IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

Copyright © 2024 National Fire Protection Association®. All Rights Reserved.

NFPA® 36

Standard for

Solvent Extraction Plants

2025 Edition

This edition of NFPA 36, *Standard for Solvent Extraction Plants*, was prepared by the Technical Committee on Solvent Extraction Plants. It was issued by the Standards Council on November 16, 2024, with an effective date of December 6, 2024, and supersedes all previous editions.

This edition of NFPA 36 was approved as an American National Standard on December 6, 2024.

Origin and Development of NFPA 36

This standard was developed at the request of the solvent extraction industry in an effort to achieve greater uniformity in fire protection practices for extraction plants. The purpose of the standard is to provide reasonable standards for the design and operation of solvent extraction processes and extraction plants.

In the development of this standard, the Technical Committee on Solvent Extraction Plants recognized some fundamental differences between the operation of solvent extraction plants and the processing of solvents in other facilities. Many extraction plants are relatively small units in isolated locations; they operated without the benefit of overall fire protection measures, which are customary in large solvent processing facilities.

The operator of a solvent extraction plant must establish and maintain fire safety esprit de corps among a small number of employees, as opposed to relying on the established customs of large-scale operations.

There are certain hazards in the combining and separating of solids and solvents that are peculiar to the solvent extraction industry. Also serving as a complicating problem is the potential dust explosion hazard in some areas of the typical plant. Therefore, the technical committee determined that it would be desirable to give consideration to practices applicable to both dust-laden and flammable vapor-laden atmospheres.

NFPA 36 was tentatively adopted at the 1957 Annual Meeting of the association. A revision of this tentative edition was adopted at the 1958 Annual Meeting. NFPA 36 was officially adopted by the association at its 1959 Annual Meeting. Amendments were adopted in 1962, 1964, 1967, 1972, 1973, 1974, 1978, 1983, 1985, 1988, 1993, 1997, 2001, 2004, and 2008.

The 1997 edition of NFPA 36 incorporated the following amendments:

- (1) New appendix text to 1.1.1 to refer the user to NFPA 30, *Flammable and Combustible Liquids Code*, for solvent extraction processes not covered by NFPA 36
- (2) New 1.1.6, extending the scope of NFPA 36 to any preparation or meal finishing area that is connected to the solvent extraction process by a conveyor, thus establishing a boundary between those operations governed by NFPA 36 and those that might be governed by NFPA 61, *Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Products Facilities*
- (3) Revision of 5.2.5 to require compliance with all stated measures for preventing vapors from migrating beyond the controlled or restricted areas
- (4) New appendix text to 5.5.1 to provide guidance to the user in applying requirements for hazardous (classified) locations
- (5) New 5.8.1.7, which established specific requirements for actions to be taken to remove vapors from the extractor, especially during emergencies
- (6) New 5.8.9.6, which established a requirement for means to automatically sense excess pressure in the extractor or in the desolventizer-toaster and to automatically reduce the excess pressure to a safe level

- (7) Numerous editorial and minor technical improvements

The 2001 edition of NFPA 36 incorporated the following amendments:

- (1) A revised definition of *flame arrester*
- (2) A revision to 2.1.4 to require written authorization for repairs involving hot work
- (3) A revision of 4.1.2 to clarify which provisions do not apply when the liberation of dust is adequately controlled
- (4) A revision of Section 4.5 to better describe when repairs, including those involving hot work, can be performed without shutting down the entire process
- (5) A revision to 5.8.1.1 to clarify the requirements for venting of process equipment
- (6) A new 5.8.1.5 that stated that a flame arrester is not required in the discharge line from an emergency pressure relief valve
- (7) A new 5.8.1.7 that prohibited installing a shutoff valve in the overflow line from a tank or vessel
- (8) A revision to 5.8.1.9 to clarify the means of exhausting vapors from plant equipment

The 2004 edition of NFPA 36 was a complete editorial rewrite of the previous edition to comply with NFPA's *Manual of Style for Technical Committee Documents* and incorporated the following technical amendments:

- (1) Revised definitions of the terms *extraction process*, *flame arrester*, *flammable liquid* (to correlate with NFPA 30, *Flammable and Combustible Liquids Code*), *inert gas*, *lower flammable limit*, and *upper flammable limit*
- (2) Addition of a definition for *noncombustible material*, extracted from NFPA 220, *Standard on Types of Building Construction*
- (3) Revised procedures in 4.5.3 for transfer of solvent, to correlate with NFPA 30
- (4) Revision of 5.3.2 to require the design and construction of solvent storage tanks to comply with NFPA 30
- (5) Revision of Section 7.4, Drainage and Spill Control, to provide more specific design requirements for the separation sump
- (6) Addition of Figure 7.5.2 to illustrate typical locations for providing vent openings in the conveying system
- (7) Revision of Section 7.6, Cooling Towers, allowing flexibility in locating the various types of cooling towers relative to the extraction process
- (8) Addition of an exception to 8.2.6 that allowed a shutoff valve in a normal vent line or an emergency vent line if the shutoff valve meets specified criteria
- (9) Addition of physical property data for isohexane to Annex B to recognize its use as an extraction solvent

The 2009 edition of NFPA 36 incorporated the following technical amendments:

- (1) Revised definitions of the terms *flame arrester*, *inert gas*, and *lower flammable limit*
- (2) Addition of exceptions to 6.2.4 and to 7.9.2 to allow the use of electric space heaters that are approved for Class I, Division 1, Group D or Class II, Division 1, Group G locations
- (3) Revision to Figure 7.2.1 to show correct dimension reference lines for the extent of the hazardous location above a process vent
- (4) Revision to 7.4.2.3 to provide more detailed requirements for the separation sump
- (5) Addition of a new figure, Figure 7.4.2.3, to illustrate a typical separation sump design
- (6) Addition of a new annex item, A.7.4.2.4, to provide suggested means to provide emergency control of outflow from the separation sump, if the liquid seal fails
- (7) Deletion of existing 7.5.3, because it conflicted with 7.5.2
- (8) Removal of an erroneously placed line in Figure 7.7.1
- (9) Addition of requirements to 8.10.4 and 8.10.5 to monitor the discharge of oil for conditions that might present a significant hazard
- (10) Revision of 8.10.6 to correlate with changes made to 8.10.4 and 8.10.5
- (11) Correction to Table B.2(a)
- (12) Deletion of Table B.2(b), because it conflicted with Table B.2(a)

The 2013 edition of NFPA 36 incorporated the following technical amendments:

- (1) Referenced documents in Chapter 2 were updated to current editions.
- (2) Subsection 4.11.1 was expanded to address hand tools and power tools.
- (3) An annex discussion was added to provide guidance on determining whether special tools were needed.
- (4) Subsection 6.4.2 was revised to correlate with NFPA 61, *Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Processing Facilities*, by providing exceptions for dust collectors, centrifugal separators, and bin vent dust collectors located inside buildings.
- (5) Subsection 6.4.3 was broadened to apply to all types of filter media and to require explosion protection if there is a risk of a dust explosion in the enclosure.
- (6) Section 7.7 was revised to include guidance for use of the zone system for electrical area classification.

The 2017 edition of NFPA 36 incorporated the following technical amendments:

- (1) A new subsection was added to address trenches for solid-collecting conveyors.

- (2) A new Annex A subsection provided references to assessment methods for determining the need for lightning protection.
- (3) Section 8.2 was revised to maintain consistency with NFPA 30 and to clarify the normal and emergency venting requirements.
- (4) All exceptions were rewritten in enforceable, mandatory language.

The 2021 edition contained only minor changes to the standard. An alternate standard for spark-resistant construction was added to aid users in applying mechanical ventilation requirements. Portable fire extinguishers were required to be listed (a change from “approved”), and language regarding fixed combustible gas monitoring systems was clarified.

The 2024 edition contains only minor changes to the standard. Chapter 7 requirements are expanded to include ATEX Category 2 as an acceptable spark resistance standard for ventilation. Updates were made to align the extraction process distance diagram in Figure 7.2.1 with the current requirements.

Technical Committee on Solvent Extraction Plants

Richard Clough, *Chair*

Texas A&M Engineer Extension Service Station, TX [RT]

Richard H. Barton, N. Hunt Moore & Associates, Inc., TN [SE]

Jon Rodney Corbett, Locked in Fire and Engineering, Inc., CA [SE]

Alberto Cusimano, Dupont International SA, Switzerland [M]

Benjamin Wayne Floan, Crown Iron Works, MN [M]

Matthew S. Gibbons, Archer Daniels Midland Company, IL [U]

Thomas A. Katalinich, Cargill, Inc., MN [U]
Rep. Corn Refiners Association Inc.

Timothy G. Kemper, Desmet USA, Inc., GA [M]

Brent D. Kooiman, Interstates, Inc., IA [IM]

Mark William Nelson, Kalsec, Inc., MI [U]

John D. Rever, Ag Processing Inc., MO [U]

Rep. International Oil Mill Superintendents Assn.

Douglas D. VanMeter, Consolidated Grain & Barge Company, IN [U]

Rep. National Oilseed Processors Association

Kurt Allan Webster, M&W Contractors, Inc., IL [IM]

Alternates

Amsey Boyd, Archer Daniels Midland Company, IL [U]

(Alt. to Matthew S. Gibbons)

Anibal Demarco, Desmet Ballestra, Argentina [M]

(Alt. to Timothy G. Kemper)

Daniel Michael Flynn, Cargill, Inc., MN [U]

(Alt. to Thomas A. Katalinich)

Daniel Lien, Oxbow Crush, MS [U]

(Alt. to John D. Rever)

Matthew Barker, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on safeguarding against the fire and explosion hazards associated with the design, construction, and operation of solvent extraction plants.

Contents

Chapter 1 Administration	36- 6	6.2 Design and Construction.	36- 12
1.1 Scope.	36- 6	6.3 Electrical Systems.	36- 12
1.2 Purpose.	36- 6	6.4 Dust Removal.	36- 12
1.3 Application (Reserved).	36- 6	6.5 Tramp Metal.	36- 13
1.4 Retroactivity.	36- 6	6.6 Dryer Shutdown.	36- 13
1.5 Equivalency.	36- 6	6.7 Hot Work.	36- 13
1.6 Units and Formulas.	36- 7	6.8 Use of Power Tools.	36- 13
1.7 Code Adoption Requirements (Reserved).	36- 7		
Chapter 2 Referenced Publications	36- 7	Chapter 7 Extraction Process	36- 13
2.1 General.	36- 7	7.1 Scope.	36- 13
2.2 NFPA Publications.	36- 7	7.2 Location and Siting.	36- 13
2.3 Other Publications.	36- 7	7.3 Design and Construction.	36- 14
2.4 References for Extracts in Mandatory Sections. ...	36- 7	7.4 Drainage and Spill Control.	36- 14
		7.5 Conveying Systems.	36- 14
Chapter 3 Definitions	36- 7	7.6 Cooling Towers.	36- 15
3.1 General.	36- 7	7.7 Electrical Systems.	36- 15
3.2 NFPA Official Definitions.	36- 7	7.8 Ventilation Systems.	36- 15
3.3 General Definitions.	36- 7	7.9 Ignition Sources and Heating.	36- 16
		7.10 Flammable Vapor Detection.	36- 16
Chapter 4 General Requirements	36- 9	7.11 Lightning Protection.	36- 16
4.1 Scope.	36- 9	7.12 Static Electricity.	36- 16
4.2 Noncombustible Material.	36- 9		
4.3 Basic Operating Requirements.	36- 9	Chapter 8 Extraction Process Equipment	36- 16
4.4 Sources of Ignition.	36- 9	8.1 Scope.	36- 16
4.5 Housekeeping.	36- 9	8.2 Venting.	36- 16
4.6 Solvent Transfer Equipment.	36- 9	8.3 Conveying Systems for Solids.	36- 17
4.7 Piping, Valves, and Fittings.	36- 9	8.4 Extractors, Desolventizers, Toasters, Dryers, and Spent Flake Conveyors.	36- 17
4.8 Exits.	36- 10	8.5 Grinders.	36- 17
4.9 Fire Protection.	36- 10	8.6 Miscella Filters.	36- 18
4.10 Start-Up of Extraction Process.	36- 10	8.7 Wastewater Evaporation.	36- 18
4.11 Emergency Procedures.	36- 10	8.8 Pressure Vessels and Tanks.	36- 18
4.12 Repairs in Restricted and Controlled Areas When Plant Is Operating or Not Purged.	36- 10	8.9 Heat Exchangers, Condensers, and Flash Drums.	36- 18
4.13 Repairs in Restricted and Controlled Areas When Plant Is Shut Down and Purged.	36- 10	8.10 Process Controls.	36- 18
		Annex A Explanatory Material	36- 19
Chapter 5 Bulk Solvent Unloading and Storage	36- 11	Annex B Description of the Solvent Extraction Process	36- 22
5.1 Scope.	36- 11		
5.2 Location and Siting.	36- 11	Annex C Operational Practices	36- 28
5.3 Design and Construction.	36- 11		
5.4 Fire Protection Equipment.	36- 11	Annex D Informational References	36- 30
5.5 Sources of Ignition.	36- 11		
5.6 Unloading Procedures.	36- 12	Index	36- 31
Chapter 6 Preparation and Meal Finishing Processes ...	36- 12		
6.1 Scope.	36- 12		

NFPA 36

Standard for

Solvent Extraction Plants

2025 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading "Important Notices and Disclaimers Concerning NFPA Standards." They can also be viewed at www.nfpa.org/disclaimers or obtained on request from NFPA.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the "List of NFPA Codes & Standards" at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced and extracted publications can be found in Chapter 2 and Annex D.

Chapter 1 Administration

1.1 Scope.

1.1.1* This standard shall apply to the commercial scale extraction processing of animal and vegetable oils and fats by the use of Class I flammable hydrocarbon liquids, hereinafter referred to as "solvents."

1.1.2 This standard shall also apply to any equipment and buildings that are located within 30 m (100 ft) of the extraction process.

1.1.3 This standard shall also apply to the unloading, storage, and handling of solvents, regardless of distance from the extraction process.

1.1.4 This standard shall also apply to the means by which material to be extracted is conveyed from the preparation process to the extraction process.

1.1.5 This standard shall also apply to the means by which extracted desolventized solids and oils are conveyed from the extraction process.

1.1.6 This standard shall also apply to preparation and meal finishing processes that are connected by conveyor to the extraction process, regardless of intervening distance.

1.1.7* This standard shall not apply to the storage of raw materials or finished products.

1.1.8 This standard shall not apply to extraction processes that use liquids that are miscible with water.

1.1.9 This standard shall not apply to extraction processes that use flammable gases, liquefied petroleum gases, or nonflammable gases.

1.1.10 This standard shall prohibit the use of processes that employ oxygen-active compounds that are heat or shock sensitive, such as certain organic peroxides, within the area defined in 1.1.2.

1.2 Purpose. The purpose of this standard shall be to provide the following:

- (1) Requirements for the design, construction, and operation of extraction processes that utilize Class I flammable hydrocarbon liquids
- (2) Requirements for the prevention of fire and explosion in extraction processes and in associated preparation and meal finishing areas
- (3) A means by which plant fire protection and supervisory personnel can evaluate the processes and operations under their control
- (4) Guidance to regulatory and inspection officials in determining whether a given facility is being operated in accordance with good practice
- (5) A workable set of standards for the use of design engineers, architects, and others in the planning and design of new installations

1.3 Application (Reserved).

1.4 Retroactivity. The provisions of this standard reflect a consensus of what is necessary to provide an acceptable degree of protection from the hazards addressed in this standard at the time the standard was issued. Unless otherwise specified, the provisions of this standard shall not apply to facilities, equipment, structures, or installations that existed or were approved for construction or installation prior to the effective date of the standard. Where specified, the provisions of this standard shall be retroactive. In those cases where the authority having jurisdiction determines that the existing situation presents an unacceptable degree of risk, the authority having jurisdiction shall be permitted to apply retroactively any portions of this standard deemed appropriate. The retroactive requirements of this standard shall be permitted to be modified if their application clearly would be impractical in the judgment of the authority having jurisdiction, and only where it is clearly evident that a reasonable degree of safety is provided.

1.5 Equivalency. Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this standard. Technical documentation shall be submitted to the authority having jurisdiction to demonstrate equivalency. The system, method, or device shall be approved for the intended purpose by the authority having jurisdiction.

1.6 Units and Formulas.

1.6.1 The units of measurement for this standard shall be in accordance with the International System of Units (SI). Measurements and values shall be expressed using the SI unit of measurement. An equivalent inch/pound measurement or value, in parentheses, shall be permitted to follow the SI value.

1.6.1.1 Table 8.2.3.1 shall not be required to meet this requirement.

1.6.2 Where a measurement is given in an SI unit with an equivalent unit following in parentheses, the first stated value shall be regarded as the requirement and the value in parentheses shall be considered to be approximate.

▲ 1.7 Code Adoption Requirements (Reserved).

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 30, *Flammable and Combustible Liquids Code*, 2024 edition.

NFPA 69, *Standard on Explosion Prevention Systems*, 2024 edition.

NFPA 70®, *National Electrical Code®*, 2023 edition.

NFPA 214, *Standard on Water-Cooling Towers*, 2021 edition.

NFPA 220, *Standard on Types of Building Construction*, 2024 edition.

NFPA 780, *Standard for the Installation of Lightning Protection Systems*, 2023 edition.

2.3 Other Publications.

2.3.1 ASME Publications. American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

ASME *Boiler and Pressure Vessel Code*, 2023.

▲ **2.3.2 ASTM Publications.** ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM E136, *Standard Test Method for Assessing Combustibility of Materials Using a Vertical Tube Furnace at 750°C*, 2022.

ASTM E2652, *Standard Test Method for Assessing Combustibility of Materials Using a Tube Furnace with a Cone-shaped Airflow Stabilizer, at 750°C*, 2022.

2.3.3 Other Publications.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2020.

2.4 References for Extracts in Mandatory Sections.

NFPA 30, *Flammable and Combustible Liquids Code*, 2024 edition.

NFPA 69, *Standard on Explosion Prevention Systems*, 2024 edition.

NFPA 101®, *Life Safety Code®*, 2024 edition.

NFPA 550, *Guide to the Fire Safety Concepts Tree*, 2022 edition.

NFPA 5000®, *Building Construction and Safety Code®*, 2024 edition.

Chapter 3 Definitions

▲ 3.1 General.

■ **3.1.1** The definitions contained in this chapter shall apply to the terms used in this standard.

■ **3.1.2** Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used.

■ **3.1.3** *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.4* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.5 Standard. An NFPA standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA manuals of style. When used in a generic sense, such as in the phrases “standards development process” or “standards development activities,” the term “standards” includes all NFPA standards, including codes, standards, recommended practices, and guides.

3.3 General Definitions.

3.3.1 Area.

3.3.1.1 Controlled Area. Any area that is more than 15 m (50 ft) but less than 30 m (100 ft) from the solvent extraction process, measured horizontally.

3.3.1.2* Meal Finishing Area. The area that contains the equipment needed to prepare the extracted and desolventized material for storage.

3.3.1.3 Restricted Area. The area within 15 m (50 ft) horizontally of the extraction process.

N 3.3.2 Automatic. Capable of performing a function without the necessity of human intervention. [101, 2024]

3.3.3 Condensate. Any material that has been condensed from the vapor state to the liquid state.

3.3.4 Condenser. A piece of equipment that lowers the temperature of a vapor to the point where it changes to a liquid.

3.3.5 Controlled Area. See 3.3.1.1.

3.3.6 Conveyor. Equipment that transports material from one point to another either pneumatically or mechanically, by means of a moving belt, a chain, buckets, or flights.

3.3.7 Desolventized Material. See 3.3.24.1.

3.3.8 Desolventizer. Equipment that removes the absorbed solvent from the material being processed.

3.3.9 Evaporator. Equipment that vaporizes the solvent from the oil-bearing miscella.

3.3.10 Extraction Process. See 3.3.29.1.

3.3.11 Extractor. Equipment that removes oil and fat from oil- or fat-bearing material by means of a suitable solvent.

3.3.12 Flakes. Oil- or fat-bearing material that has been rolled in preparation for the extraction process.

3.3.13 Flaking Mill. A piece of equipment that utilizes smooth rollers to prepare material for the extraction process.

3.3.14 Flame Arrester. A device that prevents the transmission of a flame through a flammable gas/air mixture by quenching the flame on the surfaces of an array of small passages through which the flame must pass. [69, 2024]

3.3.15 Flammable Limit.

3.3.15.1* Lower Flammable Limit (LFL). That concentration of a flammable vapor in air below which ignition will not occur. Also known as the lower explosive limit (LEL). [30, 2024]

3.3.15.2* Upper Flammable Limit (UFL). For the purpose of this standard, that concentration of a combustible material in air above which ignition will not occur.

3.3.16 Flammable Liquid. An ignitable liquid that is classified as a Class I liquid. [30, 2024]

3.3.17 Heat Exchanger. For the purpose of this standard, equipment that transfers heat from one vapor or liquid to another vapor or liquid.

3.3.18 Hydrocarbon. A chemical substance consisting of only hydrogen and carbon atoms.

3.3.19* Important Building. A building that is considered not expendable in an exposure fire. [30, 2024]

3.3.20 Inert Gas. A gas that is noncombustible and nonreactive. [69, 2024]

3.3.21 Inerting. For the purpose of this standard, a technique by which a combustible mixture is rendered nonignitable by adding an inert gas.

3.3.22 Lower Flammable Limit (LFL). See 3.3.15.1.

N 3.3.23 Manual. Employing human action. [550, 2022]

3.3.24 Material.

3.3.24.1 Desolventized Material. Material from which all absorbed solvent has been removed.

Δ 3.3.24.2 Noncombustible Material. (See Section 4.2.)

3.3.24.3* Spent Material. Material from which the oil or fat has been extracted but which has not been desolventized.

3.3.25 Meal Finishing Area. See 3.3.1.2.

3.3.26 Miscella. A mixture, in any proportion, of extracted oil or fat and the extracting solvent.

3.3.27 Noncombustible Material. See 3.3.24.2.

3.3.28 Preparation Process. The operations involving the equipment used for the preparation of the material for the extraction process.

3.3.29 Process.

3.3.29.1 Extraction Process. The curbed area that contains the operations involving the extractor and the desolventizer, together with pertinent equipment such as heat exchangers, evaporators, and strippers, and which are contained in an enclosed building or in an open structure.

3.3.29.2 Preparation Process. The operations involving the equipment used for the preparation of the material for the extraction process.

3.3.30 Purging. For the purpose of this standard, the process of displacing flammable vapors from buildings, equipment, or piping.

3.3.31 Restricted Area. See 3.3.1.3.

3.3.32 Separation Sump. A containment basin that is used to separate oils, miscella, or solvent from water by means of the immiscibility of the liquids and their differing densities.

3.3.33 Solvent. For the purpose of this standard, any Class I flammable hydrocarbon liquid that has the ability to extract oils or fats from animal or vegetable material.

3.3.34 Spent Material. See 3.3.24.3.

3.3.35 Stripper. A distillation column or tower, usually operated under vacuum, that is used to remove residual solvent from the extracted oil or fat.

3.3.36 Toaster. Equipment that is capable of producing the desired cooking, toasting, and modification of protein by means of heat and moisture.

3.3.37 Upper Flammable Limit (UFL). See 3.3.15.2.

3.3.38 Vapor Recovery. The process of reclaiming solvent by means of condensation or absorption.

3.3.39 Vapor Scrubber. A device used to wash entrained dust from a vapor stream by means of a liquid spray.

3.3.40 Vapor Seal. Equipment or material that prevents the escape of solvent vapors from process equipment or conveyors.

Chapter 4 General Requirements

4.1 Scope. This chapter shall apply to the general operation of solvent extraction plants. The provisions of this chapter shall apply to all buildings, equipment, and operations in solvent extraction plants.

4.1.1 Limited and specific requirements in this standard shall apply to bulk solvent unloading and storage (*see Chapter 5*), preparation and meal finishing processes (*see Chapter 6*), and the extraction process (*see Chapter 7*), in addition to the general operation requirements of solvent extraction plants.

4.2 Noncombustible Material.

4.2.1* A material that complies with any one of the following shall be considered a noncombustible material:

- (1)* The material, in the form in which it is used, and under the conditions anticipated, will not ignite, burn, support combustion, or release flammable vapors when subjected to fire or heat.
- (2) The material is reported as passing ASTM E136, *Standard Test Method for Assessing Combustibility of Materials Using a Vertical Tube Furnace at 750°C*.
- (3) The material is reported as complying with the pass/fail criteria of ASTM E136 when tested in accordance with the test method and procedure in ASTM E2652, *Standard Test Method for Assessing Combustibility of Materials Using a Tube Furnace with a Cone-shaped Airflow Stabilizer, at 750°C*.

[5000:7.1.4.1.1]

4.3 Basic Operating Requirements.

4.3.1 Safe operating practices, including but not limited to start-up and shutdown procedures, shall be the responsibility of the management operating the extraction plant.

4.3.2 Operating and maintenance employees shall be instructed in plant operations in general.

4.3.3* Applicable plant regulations shall apply to all visitors and others who enter the plant, both during operating periods and during shutdown periods.

4.3.4* Repair Authorization. When it is necessary to make repairs to the areas covered by this standard, the work shall be authorized by the individual in responsible charge of the plant before the work is started. Where hot work is required, this authorization shall be in writing.

4.4 Sources of Ignition.

4.4.1 Electrical installations shall meet all applicable requirements of *NFPA 70*.

4.4.2 Provisions shall be made for protection against static electricity and lightning as required in other chapters of this standard.

4.4.3 Smoking. Smoking or other sources of ignition shall not be permitted within the restricted and controlled areas. Lighters and matches shall not be carried into the restricted or controlled areas of the extraction plant.

4.4.4 Powered vehicles, unless approved for such locations, shall be prohibited within the controlled or restricted area

except by special permission of the individual in responsible charge of the plant.

4.5 Housekeeping.

4.5.1 Flammable liquids not contained in process equipment shall not be stored in the extraction process area except in small quantities, which shall be stored in approved safety cans.

4.5.2 Waste materials, such as oily rags, other wastes, and absorbents used to wipe up solvent, paints, and oils, shall be deposited in approved waste cans and removed from the premises not less than once each day.

4.5.3 Dust originating from material in process shall be kept to a minimum.

4.5.4 The space within the restricted and controlled areas shall be kept free of dry grass, weeds, trash, and all combustible materials, except as allowed for cooling towers in Section 7.6.

4.5.5 Any spills of oil, solvent, or deposits of solvent-bearing material shall be cleaned up immediately and removed to a safe place.

4.5.6 The discharge or removal of solvent-bearing material shall be recognized as a severe hazard, and operating procedures shall be established to minimize such occurrences.

4.6 Solvent Transfer Equipment.

4.6.1 Pumps shall be designed for the solvent, the working pressures, and the structural stresses to which they will be subjected.

4.6.2 Positive displacement pumps shall be provided with bypasses with pressure relief valves discharging back to the tank or to the pump suction.

4.6.3 Transfer of liquids among vessels, containers, tanks, and piping systems by means of air or inert gas pressure shall be permitted only under all of the following conditions:

- (1) The vessels, containers, tanks, and piping systems shall be designed for such pressurized transfer and shall be capable of withstanding the anticipated operating pressure.
- (2) Safety and operating controls, including pressure relief devices, shall be provided to prevent overpressure of any part of the system.
- (3) Only inert gas shall be used to transfer Class I solvents.

4.6.4 Where practicable, all pumps handling solvent in the processing equipment shall be located on the first floor level.

4.6.5 Pump houses, if used, shall be of noncombustible construction and ventilated.

4.7 Piping, Valves, and Fittings.

4.7.1 General. All piping, valves, and fittings shall be designed for the working pressures and structural stresses to which they will be subjected and shall be of steel or other material approved for the service intended.

4.7.2 Pipe Systems. Pipe systems shall be substantially supported and protected against physical damage caused by expansion, contraction, and vibration.

4.7.3 Process Piping.

4.7.3.1 Piping shall be pitched to drain to avoid trapped liquids, or suitable drains shall be provided.

4.7.3.2 Armored hose shall be permitted to be used where vibration exists or where frequent movement is necessary.

4.7.3.3 Aboveground solvent pipe sections 50 mm (2 in.) in size or over shall be welded and flanged. Welding shall conform to good welding practice.

4.7.4 Drain Valves. Drain valves shall be provided with plugs to prevent leakage.

4.7.5 Pipe Connections. Pipe connections 50 mm (2 in.) and larger to all tanks and vessels shall be bolted flanges that can be opened and blanked off.

4.7.6 Testing. After installation and before covering or painting, all piping systems, including suction lines, shall be pressure tested to not less than 1½ times the working pressure, but not less than a gauge pressure of 35 kPa (5 psi) at the highest point in the system. Tests shall continue for not less than 30 minutes without any noticeable drop in pressure.

4.7.6.1 Vapor lines operating at less than 500 mm (20 in.) of water column shall not be required to comply with these requirements.

4.7.7 Identification of Piping and Equipment. All piping and equipment shall be coded for identification.

4.8 Exits.

4.8.1 An extraction building or open process structure over two stories in height shall be provided with at least two remotely located means of egress from each floor, one of which shall be enclosed or separated from the process by a wall that is blank except for doors.

4.8.2 The enclosure or separating wall shall be of masonry or other noncombustible construction.

4.8.3 Self-closing, noncombustible doors, normally kept closed, shall be provided for access to the means of egress.

4.9* Fire Protection.

4.9.1* An approved water spray, deluge, or foam-water system, or a combination of these types of fixed protection systems, shall be provided to protect the extraction process equipment and structure.

4.9.2* An approved system of automatic sprinklers shall be provided in the preparation area.

4.9.3* A system of yard hydrants shall be provided in accordance with accepted good practice.

4.9.4* Listed portable fire extinguishers of appropriate size and type shall be provided.

4.9.5* Where standpipe and hose protection is installed, combination water fog and straight stream nozzles shall be provided.

4.9.6 Where explosion prevention systems are used, they shall be installed in accordance with the provisions of NFPA 69.

4.9.7 Fire alarm signals shall be relayed or sent to a constantly supervised point on or off the premises.

4.9.8 Where service is available, a public fire alarm box shall be located nearby.

4.10 Start-Up of Extraction Process. Procedures for extractor start-up shall be established to minimize the hazards resulting

from passing through the flammable range. Inerting shall be permitted to be used to reduce the oxygen content and meet this requirement.

4.11 Emergency Procedures.

4.11.1 All employees shall be trained in the necessary actions to be taken in time of emergency, including emergency shut-down procedures.

4.11.2 Personnel shall be trained as to the location of exits.

4.11.3 All personnel shall be trained in the use and limitations of each type of firefighting equipment on the premises, including control valves for the water spray systems.

4.11.4 A fire brigade, if established, shall be composed of selected personnel on each shift and shall be trained as a unit with each person assigned definite responsibilities in case of an emergency.

4.11.5 Periodic drills shall be held to ensure that employees can carry out the procedures in 4.11.1 through 4.11.4.

4.11.6 Emergency safety devices or systems provided in the plant shall be periodically tested in accordance with established procedures and a record made thereof.

4.12 Repairs in Restricted and Controlled Areas When Plant Is Operating or Not Purged.

4.12.1* Power and Hand Tools. Maintenance operations involving the use of power tools that can produce sources of ignition shall be prohibited except as provided for in Sections 6.7 and 6.8. Maintenance operations involving the use of hand tools shall be subject to management approval after review to determine whether protective measures or special tools are required.

4.12.2 Electrical Equipment. Repairs on live electrical wiring or equipment shall be prohibited. If it is necessary to replace or repair electrical wiring or equipment, the power shall be disconnected completely, and the switch shall be locked in an open position.

4.12.3 Welding and Cutting Operations. Welding and cutting, including brazing and soldering operations, shall be prohibited except as provided for in Sections 6.7 and 6.8.

N 4.12.4* Opening Desolventizer Toaster and Directly Connected Process Equipment. Procedures for preparing a desolventizer toaster to be opened shall be established to minimize the hazards created by admitting air into the vessel.

4.13 Repairs in Restricted and Controlled Areas When Plant Is Shut Down and Purged.

4.13.1* Repairs or alterations to equipment or buildings that can produce ignition sources shall be performed only when the plant has been shut down and completely purged and has been declared safe by the individual in responsible charge.

4.13.2 Before purging is initiated, the following steps shall be taken:

- (1) Tanks, vessels, piping, and traps shall be emptied of all materials. All such material shall be removed to a safe location.
- (2) All piping and other connections to storage facilities shall be disconnected, plugged, or blanked off.

4.13.3 Purging shall be accomplished by one or more of the methods in 4.13.3.1 through 4.13.3.3.

4.13.3.1 Steam. Vapor freeing shall be permitted to be accomplished by the introduction of steam into the equipment. All of the following requirements shall be met:

- (1) The equipment shall be adequately vented to prevent damage from excessive pressure or vacuum.
- (2) Steam supply lines shall be bonded to the equipment.
- (3) The rate of supply of steam shall exceed the rate of condensation so that the equipment is heated close to the boiling point of water.
- (4) The equipment shall be steamed long enough to vaporize the residues from all portions.
- (5) After steaming, the procedures outlined in 4.13.3.2 shall be followed when hot work is to be performed.

4.13.3.2 Purging with Air. Vapor freeing shall be permitted to be accomplished by purging with air. Continued purging shall be permitted to maintain a safe atmosphere. All of the following requirements shall be met:

- (1) Where fixed ventilating equipment is not provided, air movers shall be permitted to be attached so that air is drawn in and discharged through the air mover, or air can be introduced through the air mover and discharged through another opening.
- (2) Discharge shall be to a safe location.
- (3) Air movers shall be approved for the locations in which they are used.
- (4)* Precautions shall be taken to ensure that the air mover is bonded to the equipment to minimize the hazard of ignition by static electricity. (See also 7.9.5.)

4.13.3.3* Purging with Inert Gas. Vapor freeing shall be permitted to be accomplished by purging with inert gas and then ventilating with air.

4.13.4 To ensure a safe condition, even on units out of service, tests for the presence of flammable vapors shall be made with a combustible gas indicator under each of the following conditions:

- (1) Before commencing alterations or repairs, including welding, cutting, or heating operations
- (2) Immediately after starting any welding, cutting, or heating operations
- (3) Frequently during the course of such work

4.13.4.1 All such work shall be stopped immediately when the presence of flammable vapor is indicated.

4.13.4.2 The source of the vapor release shall be located and removed, and the tests required by 4.13.4 shall be repeated before the work is recommenced.

4.13.5 Upon completion of repairs or alterations, the plant shall be checked by the individual in responsible charge to ensure that operations can be resumed safely. (See Section 4.10.)

Chapter 5 Bulk Solvent Unloading and Storage

5.1 Scope. This chapter shall apply to facilities for bulk unloading, bulk handling, and bulk storage of Class I flammable liquid solvent, as defined in this standard.

5.2 Location and Siting.

5.2.1 Unloading Site.

5.2.1.1 Bulk solvent unloading facilities shall be located so that ignition sources presented by locomotives or tank vehicles are at least 30 m (100 ft) from the extraction process and at least 7.5 m (25 ft) from any building or any property line that is or can be built on.

5.2.1.2 The fill connection to the storage tank shall be at least 7.5 m (25 ft) from the extraction process.

5.2.2 Bulk Solvent Storage Tanks.

5.2.2.1 Bulk solvent storage tanks shall be located outside of any building.

5.2.2.2 Underground solvent storage tanks shall be located at least 0.3 m (1 ft) from any building foundation or support and at least 0.9 m (3 ft) from the nearest property line that is or can be built on. The loads carried by the building foundations or supports shall not be transmitted to the tanks.

5.2.2.3 Aboveground solvent storage tanks shall be located in accordance with the following:

- (1) Within the restricted area, at least 7.5 m (25 ft) from the extraction process and at least 7.5 m (25 ft) from any important building
- (2) Within the controlled area, at least 7.5 m (25 ft) from any important building and at least 7.5 m (25 ft) from any property line that is or can be built on
- (3) Outside the controlled area, at least 7.5 m (25 ft) from any important building and at least 7.5 m (25 ft) from any property line that is or can be built on

5.2.2.4 Aboveground storage tanks shall be enclosed by the fence already provided for in the restricted area or by a separate fence.

5.3 Design and Construction.

5.3.1 Unloading Stations. Unloading structures and platforms shall be constructed of noncombustible material and shall be designed and installed in accordance with accepted practice.

5.3.2* Storage Tanks. Storage tanks shall be designed, constructed, installed, and tested in accordance with NFPA 30.

5.4 Fire Protection Equipment.

5.4.1* Listed portable fire extinguishers of appropriate size and type shall be provided.

5.4.2 Additional fire protection for the unloading structure and bulk storage tanks shall be provided where an exposure hazard exists.

5.5 Sources of Ignition.

5.5.1 Electrical Equipment. All electrical utilization equipment and electrical wiring shall be suitable for Class I, Division 1 or 2, Group C or D hazardous (classified) locations and shall be designed and installed in accordance with NFPA 70.

5.5.1.1 Where enclosures that house solvent-handling equipment such as solvent pumps or valves are provided or where solvents are transferred to individual containers, these enclosures shall be considered to be Division 1 locations.

5.5.1.2* In outdoor locations, areas adjacent to loading racks or platforms or to aboveground tanks shall be considered to be Division 2 locations. The Division 2 locations shall extend 7.5 m (25 ft) horizontally from such racks or tanks, and 4.5 m (15 ft) upward from adjacent ground level.

5.5.2 Static and Stray Currents.

5.5.2.1 All storage tanks, solvent transfer equipment, tank cars or tank trucks, and unloading structures shall be bonded effectively.

5.5.2.2 Transfer or storage tanks, unloading structures, tank cars, and tank trucks shall be electrically interconnected with supply piping or containers during the transfer of liquids.

5.5.2.3* Static protection shall be installed in accordance with accepted good practice.

5.5.3 Smoking. Smoking and open flames shall be prohibited, and appropriate “No Smoking” and “Keep Fire Away” signs shall be posted in conspicuous locations.

5.6 Unloading Procedures.

5.6.1 Adequate precautions shall be taken to relieve excessive pressure in cargo tanks before unloading.

5.6.2 Tank cars shall be unloaded in accordance with accepted good practice.

5.6.3* Tank vehicles for solvents shall be unloaded in accordance with accepted good practice.

Chapter 6 Preparation and Meal Finishing Processes

6.1 Scope.

6.1.1 This chapter shall apply to processes that are used to prepare raw material for the extraction process and are connected by conveyor or other materials-handling equipment to the extraction process, regardless of intervening distance.

6.1.2 This chapter shall also apply to processes used to prepare extracted and desolventized product for storage.

6.1.3 Where the processing operations do not involve liberation of combustible dusts, the requirements of 6.2.2, 6.2.3, and 6.3.1 shall not apply.

6.2 Design and Construction.

6.2.1 The building shall be of fire-resistive or noncombustible construction and shall be without basement or pits below grade.

6.2.1.1 Trenches for solids-collecting conveyors shall be permitted.

6.2.2 The building shall be designed to provide at least 1 m² of explosion relief for every 15 m³ of volume (1 ft² per 50 ft³).

6.2.3* The roof and exterior wall construction shall provide explosion relief by one or more of the following methods:

- (1) Open air construction with a minimum area enclosed
- (2) Light noncombustible walls and roof lightly attached to steel frame
- (3) Light noncombustible wall panels and roof hatches
- (4) Top-hinged windows with explosion relief hatches

6.2.4 Space heating, if required, shall be provided by indirect means. Temperatures on heated surfaces shall be limited to 120°C (250°F).

6.2.4.1 Electric space heaters that are suitable for Class I, Division 1, Group D locations and Class II, Division 1, Group G locations shall be permitted.

6.3 Electrical Systems.

6.3.1* In areas where combustible dust presents a hazard, all electrical wiring and equipment shall conform to the requirements for Class II, Division 1, Group G locations.

6.3.2* Static protection shall be provided in equipment located in areas where combustible dust presents a hazard.

6.4 Dust Removal.

6.4.1* A dust collecting system shall be provided where necessary.

6.4.2 Where fabric filters are used for the collection of dust, they shall be located outside of the building.

6.4.2.1 A dust collector shall be permitted inside of a building if located as close as practical to an exterior wall, vented to the outside through a straight duct not exceeding 6 m (20 ft) in length, and designed so that the explosion pressures will not rupture the ductwork or the collector.

6.4.2.2 A dust collector shall be permitted to be located inside a building if equipped with an explosion suppression system designed according to NFPA 69.

6.4.2.3 Centrifugal separators, without bags, used for removing moisture from coolers that handle pelleted, extruded, or flaked grain and feed products shall be permitted inside or outside of buildings without explosion protection.

6.4.2.4 A bin vent dust collector directly mounted without a hopper on a tank or bin, whose primary function is to filter air displaced during filling or blending operations and return dust directly to the bin, shall be permitted inside or outside of a building without explosion protection. Filters that return air to the inside of the building shall be capable of a minimum efficiency of 99.9 percent at 10 µm.

6.4.2.5 Filters used for classifying food products with air (product purifiers) shall be permitted to be located inside or outside of buildings without explosion protection.

6.4.3 Filter media-type dust collectors shall be protected with an automatic sprinkler system; if a dust explosion hazard exists within the enclosure, they shall be protected by containment, suppression, inerting, or explosion venting.

6.4.3.1 Suppression, containment, or inerting systems shall be designed according to NFPA 69.

6.4.3.2 Venting shall be directed to a safe, outside location away from platforms, means of egress, or other potentially occupied areas or directed through a listed flame-arresting and particulate retention device.

6.4.4 Dust accumulations on floors, ledges, structural steel members, machinery, spouting, and other surfaces shall be removed concurrently with operations. This shall be done by vacuum cleaning or by other means that will not suspend dust in the air.

6.4.5 The use of compressed air or other means to blow dust from ledges, walls, and other areas shall not be permitted unless all machinery in the area has been shut down and all sources of ignition have been removed.

6.5 Tramp Metal. Means shall be provided to remove tramp metal from the process stream to protect rolling and grinding machinery.

6.6* Dryer Shutdown. Provisions shall be made to shut down any process dryer, and the air flow to it, that is a part of the preparation or meal finishing process in the event of a fire inside the dryer. Provisions shall also be made to inject smothering steam into the dryer.

6.7* Hot Work. Any repairs or alterations to preparation and meal finishing equipment that require welding, cutting, or other hot work shall be permitted, provided that either of the following applies:

- (1) The extraction equipment has been shut down and cooled to prevent the release of vapor.
- (2) The equipment being repaired has been isolated from any conveyor or duct through which a fire might be conveyed to or otherwise brought into contact with solvent vapors.

6.8* Use of Power Tools. Electric power tools and grinders shall be permitted to be used while process equipment is operating, provided no combustible dusts, ignitable vapors, or accumulations of combustible materials are present in the work area and the process equipment is completely closed off to prevent any sparks from entering the process.

Chapter 7 Extraction Process

7.1 Scope. This chapter shall apply to the solvent extraction process.

7.2 Location and Siting.

7.2.1 The extraction process shall be located in the open or in a building suitable for the purpose, as shown in Figure 7.2.1.

7.2.2 Fencing.

7.2.2.1* An industrial-type fence shall be placed at the perimeter of the control area.

7.2.2.2 All entrances and exits into the fenced area shall be secured to prohibit unauthorized entrance.

7.2.2.3 Provisions shall be made for emergency ingress and egress.

7.2.3 A restricted area shall extend horizontally outward from the extraction process area 15 m (50 ft) in all directions.

7.2.3.1 A controlled area shall extend horizontally outward from the restricted area to an industrial-type fence not less than 30 m (100 ft) from the extraction process or to a vapor barrier as permitted in 7.2.8.

7.2.4 The restricted and controlled areas shall be posted with signs around the perimeter warning of the possible flammable vapor hazard.

7.2.5 Basements, tunnels, pipe trenches, and pits shall be prohibited within 30 m (100 ft) of the extraction process.

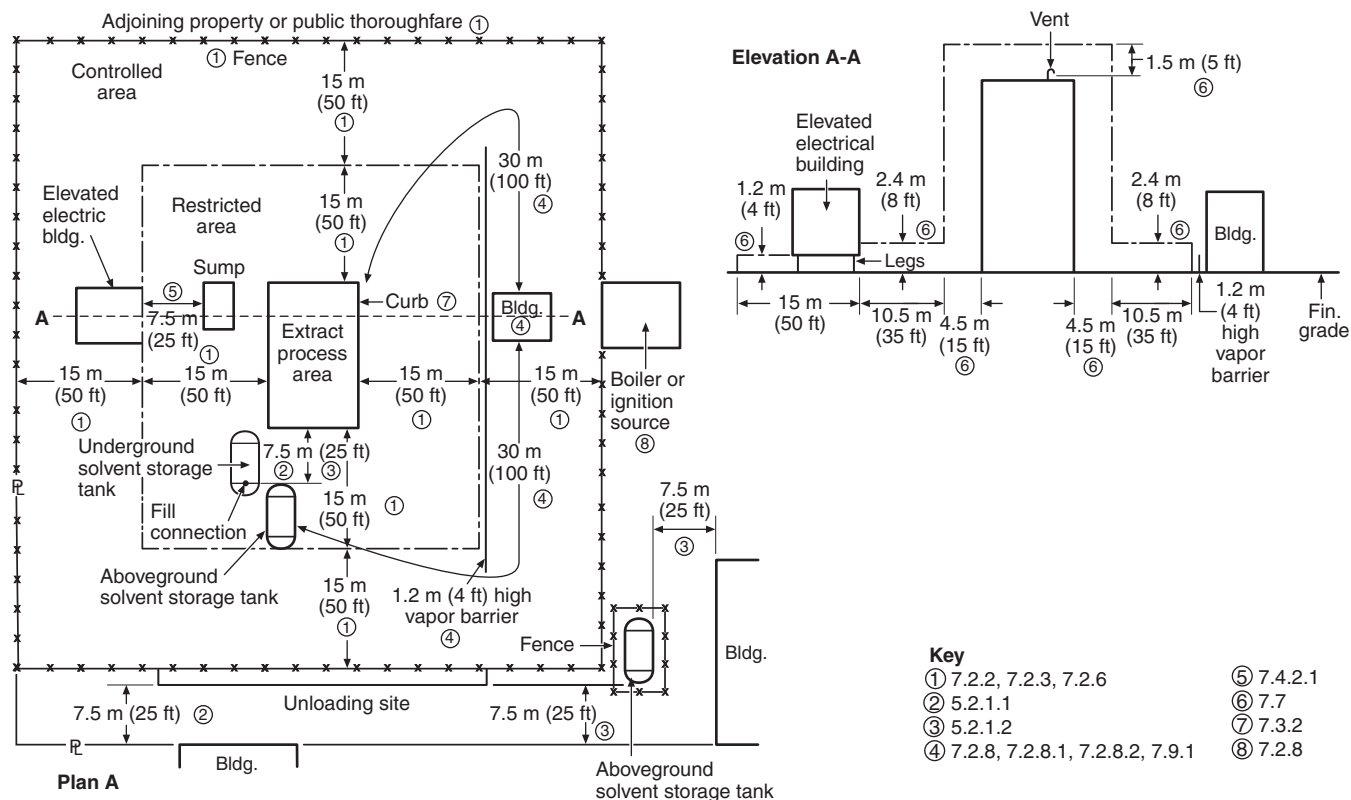


FIGURE 7.2.1 A Typical Distance Diagram.

7.2.5.1 This requirement shall not apply to separation sumps and the drainage troughs connected to them.

7.2.6 Except as permitted in 7.2.8, the extraction process shall be at least 30 m (100 ft) from any public way, any building, or any property line that is or can be built on.

7.2.7 The slope of the terrain and the prevailing winds shall be considered in locating the extraction process.

7.2.8 Structures and equipment essential to the operation of the extraction process, other than boilers and other open flame operations, shall be permitted to be located less than 30 m (100 ft) but not less than 15 m (50 ft) from the extraction process, provided that a vapor barrier is erected in accordance with the requirements of 7.2.8.1 and 7.2.8.2.

7.2.8.1 The barrier shall be located between the extraction process and the possible source of vapor ignition and shall be at least 15 m (50 ft) from the extraction process.

7.2.8.2 The barrier shall be of noncombustible vaportight construction without gates or other openings and shall be at least 1.2 m (4 ft) high and designed so that there is at least 30 m (100 ft) of vapor travel around its ends to possible sources of ignition.

7.2.9* Where the circumstances or conditions of any particular installation are unusual and in such a manner as to render the strict application of the distances specified in this standard impractical, the authority having jurisdiction shall be permitted to allow such deviation as will provide an equivalent degree of safety and be consistent with good engineering practice.

7.3 Design and Construction.

7.3.1 The building or structure housing the extraction process shall be of fire-resistive or noncombustible construction with the first floor at or above grade.

7.3.2* Solid sections of upper floors of the extraction process and concrete pads under the entire extraction process shall be curbed and sloped to drain directly to an outside separation sump.

7.3.3 Drainage lines under the ground floor slab of the extraction process shall be prohibited.

7.3.4* Explosion relief of at least 1 m² for each 15 m³ of building volume (1 ft² per 50 ft³) shall be provided by one or more of the following methods:

- (1) Open air construction with a minimum area enclosed
- (2) Light noncombustible wall panels and roof hatches
- (3) Light noncombustible walls and roof lightly attached to steel frame
- (4) Top-hinged windows with explosion relief latches

7.4 Drainage and Spill Control.

7.4.1 Provisions shall be made to guard against the introduction of solvent into the sewer systems.

7.4.2 A separation sump shall be provided to effect separation of water from oil, solvent, or miscella.

7.4.2.1 The separation sump shall be located within the restricted area but not closer than 7.5 m (25 ft) to the boundary surrounding the restricted area.

7.4.2.2 The separation sump shall be concrete or of equivalent noncombustible construction.

7.4.2.3* The separation sump shall consist of one or more retention sections, a water seal, and a final water discharge section and shall meet the following requirements:

- (1) The retention section(s) shall be sized to retain a design solvent spill volume equal to the largest spill of solvent from a single vessel/piping break in the solvent/water separator and work tank system, plus an additional 50 percent of that volume.
- (2) The retention section(s) shall be sized to retain a design miscella spill volume equal to the largest spill of miscella from a single vessel/piping break in the extractor and miscella tank system, plus an additional 50 percent of that volume.
- (3) The water seal shall receive underflow water from the retention section(s) and shall overflow water to the final water discharge section.
- (4) The water seal section shall be open to the atmosphere to prevent siphon flow.
- (5) The water seal water overflow elevation shall be designed to allow the retention section(s) to contain either the entire design solvent spill volume determined in 7.4.2.3(1), or the entire miscella spill volume determined in 7.4.2.3(2), without overflowing or underflowing the retention section(s).
- (6) The final water discharge section shall be designed to safely release overflow water from the water seal to the sewer.
- (7) The water discharge shall be trapped to prevent the flow of vapors to the sewer.

7.4.2.4* Means shall be provided to prevent the outflow of oil, solvent, or miscella from the separation sump to the sewer system under emergency conditions or if the liquid seal fails. In the event of any flow of fire protection water, provisions shall be made to contain the flow of oil, solvent, and miscella in a safe location.

7.4.2.5 A pump shall be provided to recover oil, solvent, or miscella collected in the separation sump.

7.4.2.6 Approved fixed automatic fire protection shall be provided above the separation sump.

7.5 Conveying Systems.

7.5.1 Conveyors and spouts from or to other buildings shall be located and protected so that passage of solvent vapors or liquid to other areas is prevented. In addition to the requirements of this subsection, all of the requirements of 8.3.2 and 8.3.3 shall be met.

7.5.2 Conveying systems to the extraction area shall have one or more openings on the extraction side of the system, after the highest point of conveyance entering the controlled area, to allow dense solvent vapors to escape rather than flow back to the preparation area. See Figure 7.5.2.

7.5.2.1 The opening(s) shall be located so that any escaped vapors are retained within the controlled or restricted area and must travel at least 30 m (100 ft) to the nearest source of ignition.

7.5.2.2 Alternate means shall be permitted if an equivalent degree of safety is provided.

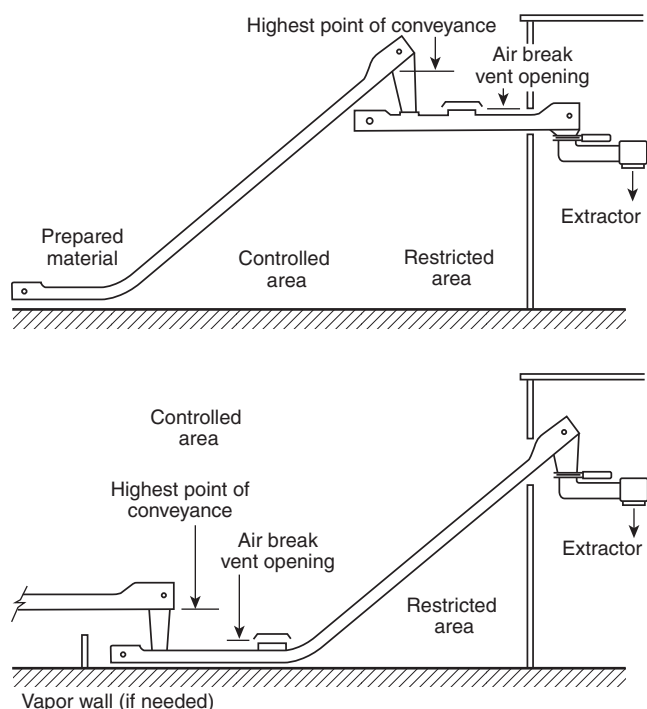


FIGURE 7.5.2 Typical Locations for Air Break Vent Opening.

7.5.3 The air intakes of pneumatic conveyors shall be located outside of any area that is classified as Class I, Division 1, Group C or D or Class I, Division 2, Group C or D, as described in Figure 7.7.1.

7.5.4 Conveyors and spouts shall be permitted to be enclosed in adequately supported, noncombustible bridge structures equipped with open grate floor sections for ventilation.

7.6* Cooling Towers. If a cooling tower provides service to the extraction process, it shall be located, based on its construction and fire protection, in accordance with this subsection.

7.6.1 If the tower is of noncombustible exterior construction and the fill of the tower is of limited-combustible construction, as these terms are defined in NFPA 220, then the tower shall be permitted to be located in the restricted area and shall not be required to have a fire protection system.

7.6.2 If the tower is of noncombustible exterior construction but the fill of the tower is of combustible construction, the tower shall not be located in the restricted area. The tower shall be permitted to be located in the controlled area, if it is protected by automatic sprinklers in accordance with NFPA 214.

7.6.3 If the tower is of combustible construction and is protected by interior and exterior automatic deluge fire protection systems in accordance with NFPA 214, the tower shall not be located in the restricted area but shall be permitted to be located in the controlled area.

7.6.4 If the tower is combustible and unprotected, the tower shall not be located in the restricted or controlled area.

7.7 Electrical Systems.

7.7.1* Class I, Division 1 or Zone 1 Locations. Electrical wiring and electrical utilization equipment of the extraction process shall be installed in accordance with the requirements for Class I, Division 1 or Zone 1 locations, whichever is applicable, as specified by NFPA 70. The Class I, Division 1 location shall extend outward from the extraction process and into the restricted area for a horizontal distance of not less than 4.5 m (15 ft) and a vertical distance of not less than 1.5 m (5 ft) above the highest vent, vessel, or equipment containing solvent, as shown in Figure 7.7.1.

7.7.1.1 In instances of areas within the same facility classified separately, Zone 2 locations shall be permitted to abut, but not overlap, Class I, Division 2 locations. Zone 1 locations shall not abut Class I, Division 1 or Division 2 locations, as specified in NFPA 70.

7.7.2 Electrical wiring and electrical utilization equipment within the restricted area beyond the 4.5 m (15 ft) distance specified in 7.7.1 and to a height of 2.4 m (8 ft) above the extraction process grade level shall be installed in accordance with the requirements of Class I, Division 2 or Zone 2 locations, whichever is applicable, as specified in NFPA 70 and as shown in Figure 7.7.1.

7.7.3 Electrical wiring and electrical utilization equipment within the controlled area and to within a height of 1.2 m (4 ft) above grade level shall be installed in accordance with the requirements of Class I, Division 2 or Zone 2 locations, whichever is applicable, as shown in Figure 7.7.1.

7.7.3.1 This requirement shall not apply to the preparation process. (See 7.2.8.)

7.7.4 Permanent luminaires (lighting fixtures) shall be installed where needed.

7.7.5 Flashlights approved for Class I, Group D locations shall be provided.

7.8 Ventilation Systems.

7.8.1 Enclosed plants shall have sufficient ventilation to change the volume of air at least six times per hour.

7.8.2 Ventilation shall be accomplished using exhaust fans, preferably with suction at floor levels and discharging vertically, without obstruction to a safe location outside the building.

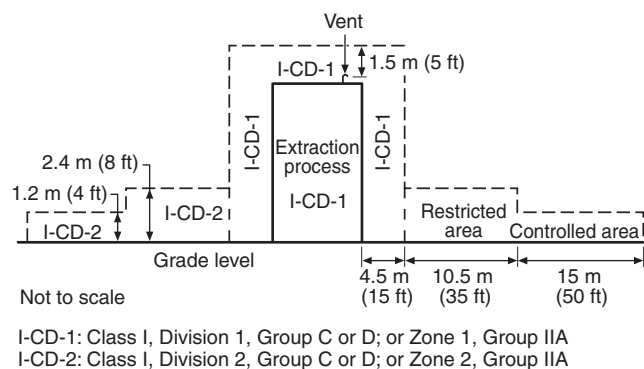


FIGURE 7.7.1 Type and Extent of Hazardous Areas.

N 7.8.3 The arrangement shall be such that all portions of solid floor areas are subjected to continuous positive movement of air.

7.8.4 Ventilation fans intended to handle solvent vapors shall be designed with the increased horsepower necessary to handle higher density vapors.

7.9 Ignition Sources and Heating.

7.9.1 Ignition sources shall not be permitted within the extraction process building or within 30 m (100 ft) of the process unless the unit and building are purged except as provided for in 4.4.4 and 7.2.8.

7.9.2 Space heating, if required, shall be provided by indirect means. Temperatures on heated surfaces shall be limited to 120°C (250°F).

7.9.2.1 Electric space heaters that are suitable for Class I, Division 1, Group D locations shall be permitted.

7.9.3 If steam tracing or jacketing is provided, temperatures on both internal and external heated surfaces shall not exceed 120°C (250°F).

Δ 7.9.3.1* Surface temperatures shall be permitted to exceed 120°C (250°F) provided the temperature is automatically reduced to 120°C (250°F) during shutdown periods.

7.9.4 Power transmission belts shall not be used in any area that is classified as a Class I, Division 1 or Class I, Division 2 location as shown in Figure 7.7.1.

7.9.5 Process vent fans, purge fans, and building ventilation fans that might handle solvent vapors, including any fans that have air intakes located in Class I, Division 1 or Class I, Division 2 locations, as shown in Figure 7.7.1, shall be of AMCA Type B spark-resistant construction, or ATEX Category 2 spark-resistant construction, or better.

N 7.9.5.1* Means shall be provided to prevent motor-induced voltage from accumulating in the fan shaft.

7.10 Flammable Vapor Detection.

7.10.1 Approved portable combustible gas indicators shall be provided and maintained in good working order.

7.10.2* Provisions shall be made for monitoring the atmosphere in areas where flammable vapors can present a hazard. Monitoring shall be accomplished by an approved, fixed combustible gas detection system with audible and visual alarms. Such detection systems shall be tested and maintained in accordance with the manufacturer's instructions.

N 7.10.3* If the fixed combustible gas detection system detects flammable gases, then automatic means to minimize the concentration or source of those flammable gases shall be initiated based on their concentration level and location.

7.11* Lightning Protection. Where required, an approved lightning protection system, installed in accordance with NFPA 780, shall be provided for the extraction process.

7.12 Static Electricity.

7.12.1 All tanks, vessels, motors, pipes, conduit, grating, and building frames within the process shall be electrically bonded together.

7.12.2* Building frames and metal structures shall be grounded and tested periodically to determine electrical continuity.

7.12.3 All hose, except hose used in water service, shall be electrically bonded to the supply line and to the tank or vessel where discharge takes place.

7.12.4 Grounding wires or bonding connections shall be provided between any dispensing vessel and any receiving vessel used for the transfer of solvent or mixtures of solvent and oil where bonding is not achieved through fixed connections. This shall include all sampling cocks.

7.12.5* If steam purging, cleaning, or sparging is used, all pipes or nozzles through which steam is discharged shall be bonded to the equipment being purged, cleaned, or sparged, or the objects shall be connected to ground.

Chapter 8 Extraction Process Equipment

8.1 Scope. This chapter shall apply to extraction process equipment.

8.2 Venting.

8.2.1 The extraction process shall be a closed system and shall be vented to the outside atmosphere through an approved flame arrester installed in accordance with the conditions of its approval.

8.2.1.1 Manifolding of vents upstream of the flame arrester shall be permitted.

8.2.1.2 Vents shall terminate at least 6 m (20 ft) above ground level and shall be located so that vapors will not re-enter buildings.

8.2.1.3 Flame arresters shall be protected against freezing and shall be accessible for inspection and repair.

8.2.2 All vessels and tanks containing solvent in the solvent extraction process shall have a normal venting capacity, independent of any emergency venting, sufficient to prevent rupture of the vessel or tank during normal operation.

8.2.3* Vessels or tanks containing liquid solvent, including extractors, solvent work tanks, miscella tanks, and solvent-water separating tanks, shall be protected with emergency venting to relieve excessive internal pressure caused by fire exposure. If the calculated required emergency vent capacity is less than that provided by the normal vent, no additional emergency venting shall be required.

8.2.3.1* The total capacity of both normal and emergency venting for vessels and tanks in the extraction process, which are protected in accordance with 4.9.1, shall not be less than that given in Table 8.2.3.1.

8.2.3.2 The wetted surface area of the vessel or tank shall be calculated as follows:

- (1) Seventy-five percent of the total exposed area of a horizontal vessel or tank
- (2) One hundred percent of the exposed shell and floor area of a rectangular vessel or tank, but excluding the top surface of the tank
- (3) The first 9 m (30 ft) above grade of the exposed shell area of a vertical vessel or tank

Table 8.2.3.1 Minimum Total Emergency Vent Capacity in ft³ of Free Air/Hr (Absolute Pressure of 14.7 psi and 60°F) for Vessels and Tanks Protected in Accordance with 4.9.1

Wetted Surface Area (ft ²)	Vent Capacity (ft ³ /hr)	Wetted Surface Area (ft ²)	Vent Capacity (ft ³ /hr)	Wetted Surface Area (ft ²)	Vent Capacity (ft ³ /hr)
20	6,300	160	50,400	900	147,900
30	9,480	180	57,000	1,000	157,200
40	12,630	200	63,300	1,200	167,100
50	15,810	250	71,700	1,400	176,100
60	18,960	300	79,500	1,600	184,200
70	22,110	350	86,400	1,800	191,700
80	25,260	400	93,600	2,000	198,600
90	28,440	500	106,200	2,400	211,200
100	31,500	600	117,600	2,800	222,600
120	37,800	700	128,400	and over	
140	44,100	800	138,600		

(1) For SI units, 10 ft² = 0.93 m²; 35.3 ft³ = 1.0 m³.

Notes:

(2) Interpolation should be used for intermediate values not specified in the table.

(3) CFH is flow capacity at absolute pressure of 14.7 psi (101 kPa) and 60°F (15.6°C). (See NFPA 30.)

8.2.3.3* A vent capacity reduction factor of 0.5 shall be allowed for vessels or tanks protected by a water spray system in accordance with 4.9.1 if the exposed surface is protected by approved insulation.

8.2.3.4 For vents from independent vessels or tanks that are joined together in any manner to a common emergency relief device, the minimum total emergency vent capacity shall be determined by totaling the vent capacity required by each independent vessel or tank.

8.2.4* All emergency vents shall terminate vertically, without obstruction at least 6 m (20 ft) above ground level.

8.2.4.1 All emergency relief vents shall be located so that vapors do not re-enter the building or create a hazard from localized overheating of any part of a tank or structure.

8.2.5 Flame arresters shall not be required in discharge lines from emergency pressure relief valves that are provided for vessels and tanks covered by 8.2.3.

8.2.6 Shutoff valves shall not be installed in normal or emergency vent lines.

8.2.6.1 An automatic pressure control valve shall be permitted to be installed to regulate the pressure in the extractor if all of the following requirements are met:

- (1) The valve shall be located in the vent line from the extractor or in the vent line from the extractor condenser.
- (2) The valve shall be actuated by the extractor pressure controller.
- (3) The valve shall be installed so that it fails in the open position.

- (4) The valve shall have a mechanical stop, a parallel small vent, or an equivalent feature to prevent complete shut-off.

- (5) The valve shall provide a safe minimum venting capacity.

8.2.7 Shutoff valves shall not be installed in overflow lines from vessels and tanks.

8.2.8 The extractor shall be provided with means to remove solvent vapors so that the concentration of vapors inside the unit in the area where work is required can be maintained at or below 25 percent of the lower flammable limit.

8.2.8.1 If a purge fan system is used to meet 8.2.8, it shall comply with all of the following:

- (1) The system shall take suction from the lower sections of the extractor to facilitate removal of vapors and shall discharge to a safe location outside the extractor building.
- (2) The system shall be capable of changing the air in the empty extractor at least 20 times per hour.
- (3) The system shall be designed and operating procedures developed to allow the normal process vent system to cool the equipment to a temperature below 38°C (100°F) prior to high-volume air purging where this is practical depending on the ambient temperature.
- (4) The fan shall meet or exceed the requirements for an AMCA Type B spark-resistant construction or ATEX Category 2 spark-resistant construction.
- (5) The fan and its ducting shall be electrically bonded to the extractor and shall itself be electrically grounded to prevent the accumulation of electrostatic charge.
- (6) The purge fan vent shall discharge vertically, without obstruction, at an elevation high enough to allow sufficient vapor dispersion to minimize the potential of flammable vapors flowing beyond the controlled area.

8.3 Conveying Systems for Solids.

8.3.1 An adequate vapor seal designed to prevent the escape of solvent or solvent vapors shall be provided at the point where the solids enter the system.

8.3.2 An adequate vapor seal shall be used on the final discharge of material from the extraction system.

8.3.3 Gaskets, if used in these systems, shall be of a material that does not decompose or soften in the presence of oil, solvent, or steam.

8.3.4 Pneumatic systems for handling solids shall be permitted to be used when material and air being handled are solvent-free.

8.4 Extractors, Desolventizers, Toasters, Dryers, and Spent Flake Conveyors.

8.4.1 Extractors, desolventizers, toasters, dryers, and spent flake conveyors shall be of a design that minimizes the possibility of ignition of product deposits.

8.4.2 Extractors, desolventizers, toasters, dryers, and spent flake conveyors shall be protected by extinguishing systems using inert gas, steam, or a combination of the two, controlled from a safe remote location. (See 8.10.1.)

8.5 Grinders. Finished meal grinding processes located after the drying-cooling operation shall not be located in the restricted area. Such operations shall be permitted in the controlled

area only when conforming to the provisions of 7.2.8. Finished meal grinding of materials as discharged from the desolventizer shall not be permitted.

8.6 Miscella Filters. Only totally enclosed filters shall be used. Ventilation shall be provided to remove residual solvent vapors when filters are open.

8.7 Wastewater Evaporation. Process wastewater shall pass through an evaporator before entering the separation sump. (See 8.10.7.)

8.8 Pressure Vessels and Tanks.

8.8.1 Unfired pressure vessels such as desolventizers and evaporators shall be constructed in accordance with the ASME *Boiler and Pressure Vessel Code*.

8.8.2 All large vessels shall be equipped with bolted and gasketed plates for inspection or repairs.

8.8.3 Where sight glasses are installed, they shall be of the high-pressure type protected against breakage and loss of product.

8.8.4 Hydraulic transmission or hydrostatic gauges shall be used for remote observation of liquid levels.

8.8.5 Tanks shall be equipped with manual shutoff valves at the bottom.

8.8.6 Armored-type liquid level gauges shall be used.

8.9 Heat Exchangers, Condensers, and Flash Drums.

8.9.1 The water side of condensers and heat exchangers shall be kept at a greater pressure than the solvent or vapor side.

8.9.2 Provisions shall be made to ensure safe shutdown in the event of loss of primary cooling water. This shall be accomplished by one or more of the following methods:

- (1) An automatic emergency gravity water supply tank of sufficient capacity
- (2) A connection to an equally reliable water supply
- (3) A provision to automatically shut off steam other than smothering steam, to immediately reduce steam-heated jacket pressure to atmospheric pressure, and to stop the flow of miscella to the distillation system

8.9.3 All steam condensate from the extraction process that is to be returned to the boiler shall be reduced to practically atmospheric pressure in a vessel where any entrained solvent will be flashed off.

8.10 Process Controls.

Δ 8.10.1 Provision shall be made for **automatic** emergency shut-off of steam and shutdown of process equipment.

N 8.10.1.1 The requirement in 8.10.1 shall be accomplished by steam and power shutoffs both near the process equipment and at a safe remote location.

N 8.10.1.2 A manual shutdown shall be available in the event of process control failure.

Δ 8.10.1.3 Smothering steam, cooling water, exhaust fans, and lights shall **maintain operation** during an emergency.

N 8.10.2* Systems shall be monitored continuously and upset conditions addressed immediately.

N 8.10.3 Sensors shall provide a visual and an audible alarm, report locally, and report to a central plant location.

N 8.10.4 Automated actions shall be implemented as appropriate to mitigate the escalation of the hazardous circumstances mentioned in this section.

Δ 8.10.5 All motor controls for process equipment shall be interlocked so that the stoppage of any piece of solids-handling equipment will also stop **feeding** material to the stopped equipment and so that equipment conveying material away from the stopped unit will continue to operate.

8.10.5.1 This interlock system shall be designed to require the proper start-up sequence and shutdown procedures.

8.10.6 Centrally located audible alarms, visual alarms, or both shall be provided to indicate abnormal and hazardous conditions such as loss of steam, loss of cooling water flow, loss of compressed air pressure, failure of process pumps, aspirating and ventilating fans, fire, and stopped motors.

Δ 8.10.7 Temperature-sensing devices arranged to actuate audible and visual alarms shall be installed in the desolventizer, the **steam condensate atmospheric flash vessel, and the water outlet from the wastewater evaporator** to indicate when the temperature drops to a point where solvent carryover could create a hazard.

N 8.10.8 Sensing devices arranged to actuate audible and visual alarms shall be installed to monitor the discharge of oil under any combination of conditions of temperature, vacuum, or sparging steam where solvent carryover could create a hazard.

Δ 8.10.9* Means shall be provided to automatically **and manually** stop the discharge of meal or water at temperatures below which there would be a significant hazard.

N 8.10.9.1 Means shall be provided to automatically and manually stop the discharge of oil under any combination of conditions of temperature, vacuum, or sparging steam where there would be a significant hazard.

8.10.10 Means shall be provided to automatically prevent excess pressure in the extractor or the desolventizer-toaster from leading to a hazardous condition. This shall be accomplished by both of the following methods:

- (1) Pressure-sensing devices shall be installed on both the extractor and the desolventizer-toaster. These devices shall be arranged to actuate audible and visual alarms if the pressure in the extractor or desolventizer-toaster rises toward a point where the release of solvent vapors from the process can create a hazard.
- (2) Means shall be provided on both the extractor and the desolventizer-toaster to automatically reduce the excess pressure and lead to a safe condition if the pressure in the extractor or desolventizer-toaster reaches a point where a significant hazard is created.

8.10.11 Unless solvent tanks are equipped with adequate overflow return lines, solvent flow from bulk storage to the work tank or from the work tank to bulk storage shall be remotely controlled by momentary switches or by other devices that provide for "dead man" controls to prevent overfilling of tanks.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1.1 Extraction processes that use flammable liquids but are not within the scope of NFPA 36 might be within the scope of NFPA 30, and the user is referred to that document for guidance. (See Chapter 3 for definitions of terms, including “extraction process” and “solvent.”)

A.1.1.7 See NFPA 61.

Δ A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment, or materials, the “authority having jurisdiction” may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The “authority having jurisdiction” may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase “authority having jurisdiction,” or its acronym AHJ, is used in NFPA standards in a broad manner because jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.2.4 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.1.2 Meal Finishing Area. Facilities for storage and shipment of finished meal are within the scope of NFPA 61, not NFPA 36.

A.3.3.15.1 Lower Flammable Limit (LFL). This term is also known as the lower explosive limit (LEL). Mixtures below this limit are said to be “too lean.”

A.3.3.15.2 Upper Flammable Limit (UFL). This term is also known as the upper explosive limit (UEL). Mixtures above this limit are said to be “too rich.”

A.3.3.19 Important Building. Examples of important buildings include occupied buildings where egress within 2 minutes cannot be reasonably expected, and control buildings that require presence of personnel for orderly shutdown of impor-

tant or hazardous processes. Important buildings can also include unprotected storage where products from fire can harm the community or the environment or buildings that contain high-value contents or critical equipment or supplies. [30, 2024]

A.3.3.24.3 Spent Material. This term is also referred to as extracted material.

A.4.2.1 The provisions of 4.2.1 do not require inherently noncombustible materials to be tested in order to be classified as noncombustible materials. [5000:A.7.1.4.1]

A.4.2.1(1) Examples of such materials include steel, concrete, masonry, and glass. [5000:A.7.1.4.1.1(1)]

A.4.3.3 See Annex C for further information.

A.4.3.4 See Annex C for a suggested safety work permit.

A.4.9 Water spray or deluge systems that are used to protect solvent extraction process equipment or structures should be designed to provide a density of not less than 10.3 mm/min (0.25 gpm/ft²) of protected surface area. See NFPA 13 and NFPA 15 for additional information. Foam-water sprinkler or deluge systems that are used for the same purposes should be designed to provide a density of not less than 6.5 mm/min (0.16 gpm/ft²) of protected surface area. See NFPA 11 and NFPA 13 for additional information. Preparation buildings should be protected with automatic sprinkler systems designed for Ordinary Hazard (Group 2), in accordance with NFPA 13.

A.4.9.1 See NFPA 11, NFPA 13, and NFPA 15.

A.4.9.2 See NFPA 13.

A.4.9.3 See NFPA 24.

A.4.9.4 See NFPA 10.

A.4.9.5 See NFPA 14.

A.4.12.1 Maintenance or cleanup operations require analyses, such as job safety analyses or activity hazard analyses, of the hazards and risk of a given task and the application of appropriate protective measures to prevent or mitigate the hazards and risk. This includes identification and mitigation of ignition risk from multiple sources, including hand tools. Due to the complexity of the numerous operations involving flammable liquids, this standard cannot address all conditions in which spark-resistant tools should be made mandatory, might be advisable, or are unnecessary to help control the ignition risk of the given operation.

N A.4.12.4 When opening a desolventizer toaster, there is potential for both a solvent and an ignition source to be present. A flash fire or deflagration can occur when the vessel is opened and air is introduced. The facility should have a procedure to address this risk. Procedures to consider include the following:

- (1) Steaming the vessel for sufficient time to purge solvent to desolventize any material remaining in the vessel and displace solvent vapor in the vessel with water vapor.
- (2) Isolating and removing heat sources from the vessel to prevent ignition of meal residue exposed to hot surfaces. For indirect heating steam, the supply must be closed and a blowdown of the steam in the steam chambers should be used to promptly remove built-up heat.

- (3) Where applicable, isolating the vessel from other equipment containing solvent to avoid solvent (liquid or vapor) re-entering the vessel.
- (4) Isolating other energy sources, such as compressed air and electrical power to drives, that pose a hazard to people once the vessel is opened.
- (5) Identifying the conditions in which the vessel can be opened.
- (6) If cooling is provided, identifying when and how that should be done. Examples could be a purge fan or passing water through the steam chambers.
- (7) Entry to the vessel should require a confined space entry permit per regulatory requirements.

A.4.13.1 See Annex C for a suggested work permit form.

A.4.13.3.2(4) In air purging, the concentration of vapor in air usually will go through the flammable range before a safe atmosphere is obtained; therefore, it is important that precautions be taken against static electric discharge. See NFPA 77 for additional information.

A.4.13.3.3 The use of inert gas minimizes the hazards inherent in passing through the flammable range.

A.5.3.2 NFPA 30 provides information on tank design and construction, venting, foundations and supports, installation of underground tanks, anchorage, spacing, dikes and walls for aboveground tanks, and testing of tanks.

A.5.4.1 See NFPA 10.

A.5.5.1.2 See Chapter 7 of NFPA 30 and NFPA 70.

A.5.5.2.3 See NFPA 77.

A.5.6.3 See NFPA 385.

A.6.2.3 See NFPA 68 for further information.

A.6.3.1 See NFPA 70.

A.6.3.2 See NFPA 77.

A.6.4.1 See NFPA 91.

A.6.6 NFPA 86 contains information on steam smothering.

A.6.7 See Annex C for additional information.

A.6.8 See Annex C for additional information.

N A.7.2.2.1 Where a vapor barrier is used to define the far boundary of the controlled area, the vapor barrier should be considered equivalent to an industrial-type fence. There is no requirement to place an industrial-type fence in addition to or above the vapor barrier.

A.7.2.9 For distance deviations, vapor cloud modelling is recommended as a tool to help provide an equivalent degree of safety.

Factors having a bearing on distance deviations could include topographical conditions, the nature of the occupancy, proximity to buildings on adjoining property, the character of the construction of such buildings, and the adequacy of public fire protection facilities.

Any vapor barrier should extend to a height equal to or greater than the elevation of the hazardous area as defined in Figure 7.7.1.

N A.7.3.2 The plant should have a plan in the case of a simultaneous spill and discharge of fire protection water in the extraction process area to limit the hazards so that the flow rate does not overwhelm the separation capability of the sump allowing solvent to reach the sewer and limit spill impacts to mitigate vapor cloud hazards.


A.7.3.4 See NFPA 68 for further information.

A.7.4.2.3 A conceptual diagram of a separation sump is shown in Figure A.7.4.2.3, which illustrates a normal condition and a spill containment (emergency) condition. The design solvent spill height or the design miscella spill height in the retention section(s) can be determined by dividing the design solvent spill volume or the design miscella spill volume by the horizontal cross-sectional area of the retention section(s). In a spill (emergency) condition, the pressure head of the upper solvent layer (specific gravity about 0.66) or the miscella layer (specific gravity about 0.73), plus the pressure head of the lower water layer (specific gravity of 1.0) in the retention section(s), will equal the pressure head of the water in the water seal (specific gravity of 1.0). Calculation is required for the upper and lower elevations of the spill layer to ensure that no underflow or overflow of the retention section(s) will occur.

A.7.4.2.4 Acceptable means to meet the requirement of 7.4.2.4 include, but are not limited to, a gravity outlet with an emergency shutoff valve or a pump with a means of shutoff.

A.7.6 See NFPA 214.

A.7.7.1 Electrical equipment and wiring systems that are installed in areas classified as hazardous (classified) locations in accordance with this standard and NFPA 70 should meet certain specific requirements to ensure that they will not provide a means of ignition for any ignitable atmosphere that might be present. Usually, this is accomplished by using explosionproof electrical equipment and wiring methods that are listed for use in such locations. Installation of such equipment and wiring should meet the requirements of Chapter 5 of NFPA 70. Due to their nature, explosionproof electrical devices and wiring methods are costly. Other means of providing equivalent safety are available.

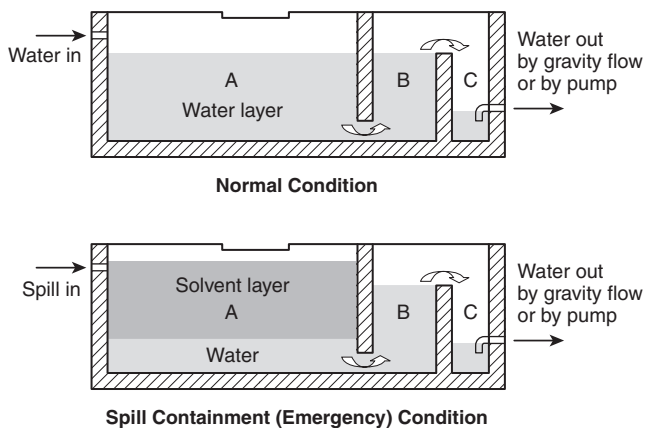

A = retention section(s) B = water seal C = water discharge section

FIGURE A.7.4.2.3 Typical Sump Sketch.

One alternate method is to use purged or pressurized enclosures. Purged and pressurized enclosures are built to be relatively tight and are supplied with clean air from a compressed air system or from a fan taking suction from an uncontaminated source. The air supply is arranged to maintain a slight positive pressure inside the enclosure. Clean air leaks out, but contaminated air cannot leak in. General purpose electrical equipment that otherwise would not be allowed in the hazardous location can be installed in these enclosures, and the slight positive pressure that is maintained in the enclosure prevents ignitable atmospheres from entering the enclosure and reaching a source of ignition. NFPA 496 provides design and performance requirements for such systems. Note that purging and pressurization can be used for small enclosures, large enclosures, and even control rooms.

For low-energy process control systems, intrinsically safe and nonincendive devices can be used. These electrical devices are typically of such low voltage, amperage, and capacitance that they cannot release ignition-capable energy. Nonincendive devices can only be used in Division 2 locations, while intrinsically safe devices can be used in either Division 1 or Division 2 locations.

Finally, moving some electrical devices and equipment to other areas of the plant that are not classified is always an option.

A.7.9.3.1 The recommended practice is to stop process heat by closing an automated steam supply valve and opening an automated steam blowdown valve on the process vessel heating chambers to promptly reduce hot surface temperatures where meal or dust residue can self-ignite. For example, this practice can be applied at desolventizer toasters, meal dryer vessels, and meal dryer air heaters.

A.7.9.5.1 Motors driven by variable frequency drives (VFDs) with inadequate conductors can develop induced voltage in the motor output shaft. Such induced voltage could create a spark if the current jumps from the motor shaft to a grounded conductive surface. A non-conductive, elastomeric shaft coupling can prevent the induced motor voltage from passing from the motor shaft to the fan shaft. An alternative is a continuous shaft grounding apparatus applied to continually dissipate the induced motor voltage from the shaft.

A.7.10.2 Areas where routine sampling has been found desirable include the following:

- (1) Raw material conveyor
- (2) Desolventized material conveyor
- (3) Finished oil or fat containers
- (4) Wastewater discharge
- (5) Solvent and miscella pumps

A.7.10.3 Possible alarm response options could include additional hazardous area ventilation, shutdown of pumps or solvent handling equipment, isolation of equipment, or other appropriate responses based on alarm location and flammable gas concentration.

A.7.11 Assessment methods for determining the need for lightning protection are provided in Section L.6 of NFPA 780, and IEC 62305-2, *Protection Against Lightning — Part 2: Risk Management*.

A.7.12.2 See NFPA 70 and NFPA 77.

A.7.12.5 See NFPA 77.

A.8.2.3 A desolventizer toaster does not have sufficient liquid solvent in contact with the exposed surface to be considered for additional emergency venting.

A.8.2.3.1 See Annex B of NFPA 30 for background information.

A.8.2.3.3 Insulation performance criteria is stated in 22.7.3.8 of NFPA 30.

A.8.2.4 A vent terminating above the roof elevation of the extraction process building is generally necessary to prevent vapors from re-entering the building or creating a hazard due to localized overheating of any part of a tank or structure. Vertical discharge is necessary for adequate dispersion to prevent flammable vapors from flowing beyond the controlled area.

Figure A.8.2.4 indicates the travel distance of a flammable vapor cloud from a typical pressure safety vent at full discharge flow. The illustration indicates the boundary of the 100 percent LEL vapor cloud from the pressure safety vent discharging vertically at 19.5 m (64 ft) elevation above the extraction process building roof and the pressure safety vent discharging horizontally at 6 m (20 ft) elevation through the extraction process building wall.

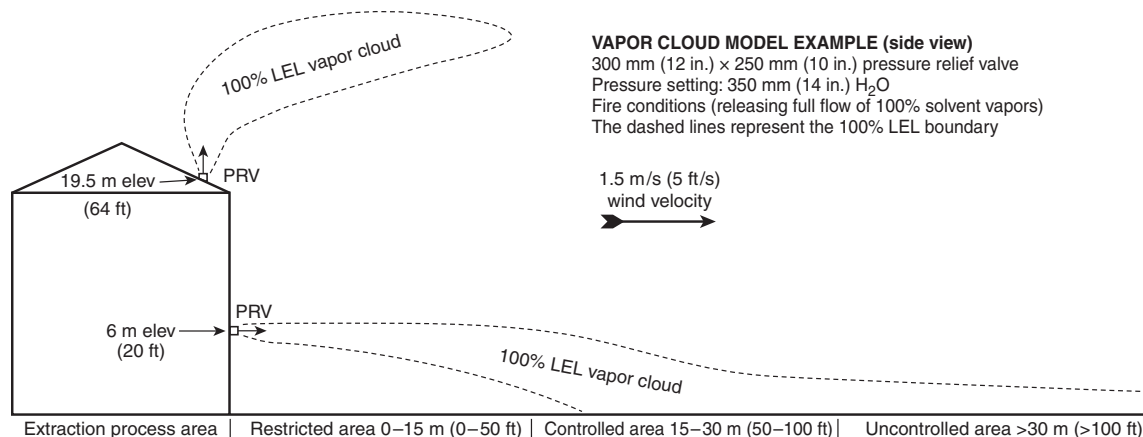


FIGURE A.8.2.4 A Typical Distance Diagram.

A.8.10.2 Different upset conditions can be addressed in different manners. Upsets can be categorized into key unit operations and subunit operations. Examples of process utility alarms include steam, water, power, and compressed air. Mechanical failure due to breaks or leaks should trigger an alarm.

A.8.10.9 Low water temperature from the wastewater evaporator is often due to an imbalance (surge) of flow in the solvent water separator. The imbalance often occurs during start-up after a brief shutdown.

Annex B Description of the Solvent Extraction Process

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

B.1 General. The removal of vegetable oils from oil-bearing materials by solvent extraction involves almost exclusively the use of solvents. The preparation processes that are employed depend on the oil content of the seed, the physical characteristics of the seed, the type of extraction system used, and the desired end products.

B.2 Extraction Solvents and Their Properties. The primary solvents used for the extraction of vegetable oils are the petroleum hydrocarbon fractions sold commercially as “hexane” and “isohexane.” These solvents are used because of their low cost, stability, excellent thermal characteristics, and selectivity for oils and fats. Other solvents, such as pentane, heptane, and trichloroethylene, have been tried but have not been widely used. Table B.2 shows physical properties for typical commercial hexane and isohexane.

Two of hexane’s more important properties also present safety concerns of its flash point and its vapor density. As shown in Table B.2, the flash point is -26°C (-15°F) and the boiling range is 67°C to 69°C (153°F to 159°F), making hexane a Class IB Flammable Liquid. The vapors of hexane are about three times more dense than air, which accounts for their tendency to flow across a surface and to collect in low spots and confined areas.

B.3 Preparation and Pretreatment. Oilseeds that have a high oil content, such as sunflower seed, rapeseed (canola), peanut, and corn germ, are difficult to prepare and do not allow economical direct extraction. Experience has shown that it is less costly to remove some of the oil by first pressing the seeds prior to solvent extraction. This prepressing is done in screw presses. The oil from prepressing is screened to remove fine material called *foots* and is then filtered or centrifuged to produce a clear oil. The foots are returned to the inlet of the screw press. Before pressing, the oilseeds are sometimes cracked, then flaked. Generally, the seeds must be cooked before pressing. This cooking step varies widely, depending on the variety of seed and the type of press. Some screw presses are able to handle whole, uncooked seeds. In any case, the cake produced by the prepressing is the raw material for the solvent extraction process. This cake can be granulated prior to the extraction step.

There are many ways to prepare soybeans for solvent extraction, although certain operations are common to all preparation processes. Soybeans generally bypass the prepressing step. The four major steps in preparing soybeans for solvent extraction invariably follow a sequence of cleaning, cracking, heating, and flaking. The demand for high-protein soybean meal for

Table B.2 Physical Properties of Typical Commercial Hexane and Isohexane

Property	Hexane	Isohexane, Mixed Isomers
Flammable limits (percent by vol.)	1.2–7.7	1.0–7.0
Ignition temperature ($^{\circ}\text{C}$)	225	264
Flash point ($^{\circ}\text{C}$), closed cup	-26	-18
Molecular weight	86.2	86.2
Melting point ($^{\circ}\text{C}$)	-94	-154
Coefficient of expansion	0.00135	NA
Boiling range at 1.0 bar (1 atm) ($^{\circ}\text{C}$)	67–69	56–60
Specific gravity at 15.6°C (60°F)	0.68	0.66
API gravity at 15.6°C (60°F)	77.2	82.9
Pounds per gal at 15.6°C (60°F)	5.63	5.52
Vapor density (air = 1)	≈ 3	≈ 3
Cubic feet vapor per gal liquid at 15.6°C and 1.0 bar (60°F and 1 atm)	25.5	NA
Vapor weight (kg per m^3 at 15.6°C)	3.48	NA
Vapor weight (m^3 per kg at 15.6°C)	0.29	NA
Latent heat of vaporization at 1.0 bar (1 atm) (kcal/kg)	79.6	NA
Heat of combustion (kcal/kg) (gross)	11,652	NA
kcal per m^3 vapor (gross)	10,791	NA
kcal per kg vapor (net)	45,171	NA
Vapor pressure at 37.8°C (kPa)	38.1	49.4
Specific heat liquid (kcal per $\text{kg}^{\circ}\text{C}$ at 15.6°C)	0.531	NA
Specific heat vapor (kcal per $\text{kg}^{\circ}\text{C}$ at 15.6°C)	0.339	NA
Solubility in water [moles per L at 15.6°C (60°F)]	Negligible	Negligible

NA = Data not available.

poultry feed has led some extraction plants to add a process to remove the hulls from the cracked beans by using air separation. Sometimes the soybeans are dried to a relatively low moisture level and then dehulled before any heating takes place. Another method processes the beans at their normal moisture content, preheats them quickly in a fluidized bed drier, then cracks and dehulls the beans while they are still hot. The resulting meats are then conditioned in a second fluidized bed drier, prior to flaking.

Some processors, whether they dehull the beans or not, add an additional step that uses an extrusion device called an expander to produce pellets from the flakes. This process is said to improve the extractability of the flakes and to reduce the amount of hexane holdup in the flakes that leave the extractor.

Cottonseed and other soft seeds are prepared both with and without prepressing. Some processors consider the prepressing step to be essential, while others consider it costly and unnecessary. The preparation of cottonseed by the direct extraction method, that is, without prepressing, consists of cleaning,

delinting, cooking, and flaking. The last two steps can be adjusted to optimize the efficiency of the extraction step and to overcome the toxic effects of a pigment gland, called *gossypol*, that is usually present in the seed. Prepressing of cottonseed produces higher-than-normal temperatures because of the cooking step prior to the prepressing and the frictional heat developed in the press. As with other soft seeds, moisture adjustment and granulation, flaking, or both, of the press cake usually follows.

B.4 Extraction. Modern systems for the extraction of vegetable oils and fats by solvents appear rather complex. This complexity, however, is largely due to the systems for control, safety, automation, and energy recovery. The basic extraction process, as shown in Figure B.4, is rather simple.

Despite the seemingly complicated array of equipment, the process consists of just four major functions:

- (1) Extraction
- (2) Desolventizing
- (3) Distillation
- (4) Solvent recovery

In the extraction step, the oil is removed from the oil-bearing material. The extraction of the oil or fat leaves the oil-bearing material saturated with solvent. This solvent is removed in the desolventizer, which drives off the solvent by direct and indirect steam heating. The miscella, or oil-bearing solvent, goes to the evaporation or distillation system, where the solvent is removed from the oil by means of heat, direct steam, and vacuum. The evaporation of the solvent from the miscella is not difficult because the solvent has the relatively low boiling point of about 69°C (156°F), compared to the boiling point of the oils, which can usually withstand temperatures as high as 121°C (250°F) without discoloration or polymerization. Thus, a wide temperature differential between the solvent and the oil, plus the use of stripping steam and vacuum in the final stage, facilitates desolventizing of the oil. The solvent recovered in this process is reused.

B.5 Basket-Type Extractors. Basket extractors are of the following types:

- (1) Vertical
- (2) Rectangular
- (3) Horizontal

The material to be extracted is carried through the extractor in individually suspended, perforated, or screen-bottomed baskets. The baskets are hung on longitudinal shafts located just above the center of gravity of the basket. The shaft ends are affixed to bearing brackets that are part of endless chains. The chains are supported and guided by large sprockets at the top and bottom of vertical extractors and at each end of horizontal extractors. This configuration is shown for a vertical extractor in Figure B.5.

The baskets are guided by pins at the end of each basket that slide in a track fastened to the inside of the extractor. The track and pin arrangement prevents the basket from tipping until it reaches a point over a discharge hopper, where a mechanism inverts the basket and discharges the extracted material. As the basket passes the discharge position, it is righted and immediately recharged with oil-bearing material.

The number of baskets in the extractor depends on the throughput, the extraction time, and the design balance: 24 baskets to 36 baskets would be normal. The most common type of charging system is a continuous screw conveyor that feeds a

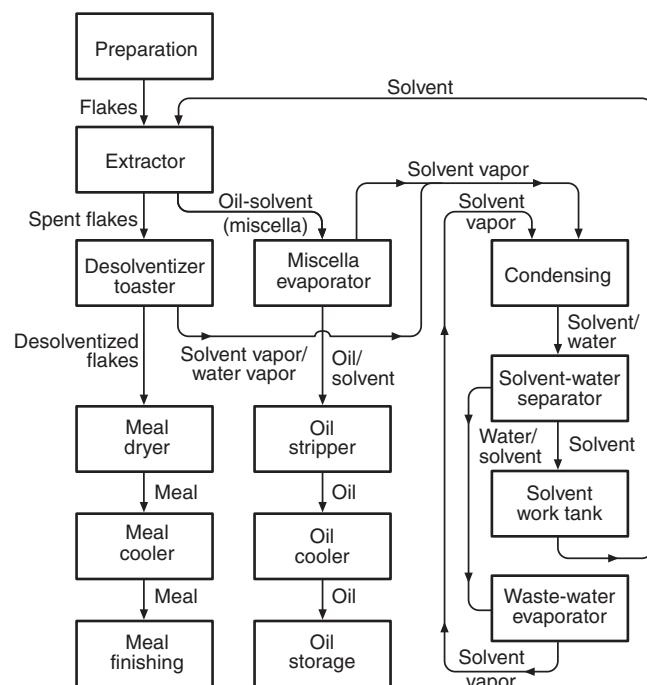


FIGURE B.4 Flow Diagram of Extraction Process.

mixture of oil-bearing material and half-miscella to the baskets. The extracted material is removed from the discharge hopper by a paddle conveyor or a mass-flow type of conveyor that is set in the bottom of the hopper.

Vertical and rectangular basket extractors have both ascending and descending baskets traveling through a shower of solvent and miscella. A concurrent phase takes place from the time the baskets are filled until they reach the bottom of the extractor on the downward leg. Half-miscella from the bottom of the ascending side of the extractor is pumped to a basket near the top of the descending side and percolates down through the baskets to the full-miscella chamber at the bottom. Raw solvent is sprayed onto one or more of the baskets near the top of the ascending side and flows concurrently through the baskets to the half-miscella chamber at the bottom of the ascending side.

Rectangular and horizontal basket-type extractors are quite similar to the vertical type, with the exception that a series of pumps continuously pump miscella to spray pipes above the baskets.

B.6 Rotary Extractors. A rotary extractor [see Figure B.6(a)] consists of a series of concentrically arranged cells supported from a vertical shaft. Extraction is effected in a manner similar to horizontal basket extractors, where the baskets pass beneath fixed nozzles fed from stage pumps recirculating various concentrations of miscella, as shown in Figure B.6(b). A primary difference is that the bed of material is much deeper in the rotary extractor; hence, the term *deep bed extractor* is sometimes applied to this type. Each cell has an open top and a hinged, perforated bottom door. As the cells travel around the track and pass beneath the feeding device, a slurry of oil-bearing material and half-miscella fills each cell. The rotation speed of the cells is variable to ensure that a continuous flow of slurry fills each cell to the desired level. While the cells are

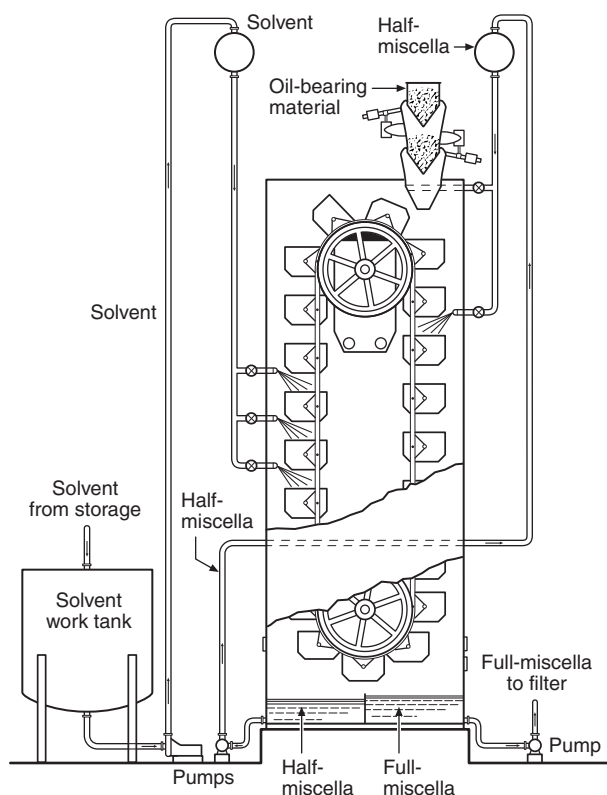


FIGURE B.5 Vertical Basket Extractor.

completing a revolution of the extractor, increasingly stronger concentrations of miscella, collected from the drain compartments that form the bottom of the extractor, are sprayed back onto the top of the cells. At approximately two-thirds of the distance around from the slurry inlet, raw solvent is sprayed onto the top of the cells, and the cells are allowed to drain free of excess solvent. After the drainage section, the cells pass over a discharge hopper. When each cell is directly over the hopper, a cut-out section of the track permits the cell bottom to be released, and the spent material drops into the hopper. Immediately after passing this position, the cell bottom is mechanically raised back to the closed position and is ready to be recharged. The spent material is continuously conveyed from the discharge hopper to the desolventizer at a uniform rate. This rate is regulated so that the discharge hopper is nearly empty when the next cell discharges.

Stationary-bottom and sliding-plate extractors [see Figure B.6(c)] are variations of the deep bed rotary extractor. These extractors have concentric cells affixed to a central axis that is powered by a variable speed drive. The cells slide over a self-cleaning slotted bottom plate. Because of this feature, no doors are required to support the flakes. The cells are uniformly filled to a desired level. Several stage pumps are provided to recycle the solvent and gradient miscellas countercurrent to the mass as it is extracted. A drainage section is provided after the fresh solvent is added, and the extracted material drops into a discharge hopper, where it is conveyed to the desolventizer.

The stationary cell extractor is another type of rotary extractor. This type provides countercurrent extraction without

moving the cells. Instead, the fill spout, spray nozzles, bottom screens, and miscella collection compartments rotate on a central shaft. The thrust load is carried on a circular track mounted on the bottom of the extractor shell. The oil-bearing material remains in the stationary basket until drained. As the bottom screen rotates under the basket, the material discharges into the internal discharge hopper from which it is conveyed from the extractor.

B.7 Perforated Belt Extractor. Another type of extractor is the horizontal perforated belt extractor [see Figure B.7(a)]. In this type of extractor, the flakes are fed in a uniform depth onto one end of a slowly moving perforated belt. As the oil-bearing material, which is not as deep as in the rotary-type extractor, travels the length of the extractor, gradient miscellas are sprayed over the moving bed from stage pumps, in much the same fashion as the horizontal basket and rotary extractors. The belt consists of a pair of endless chains running on a set of large sprockets at each side of the extractor. Attached across the chains and forming a flat surface are a series of perforated plates or screens. Chambers or pans are arranged beneath the

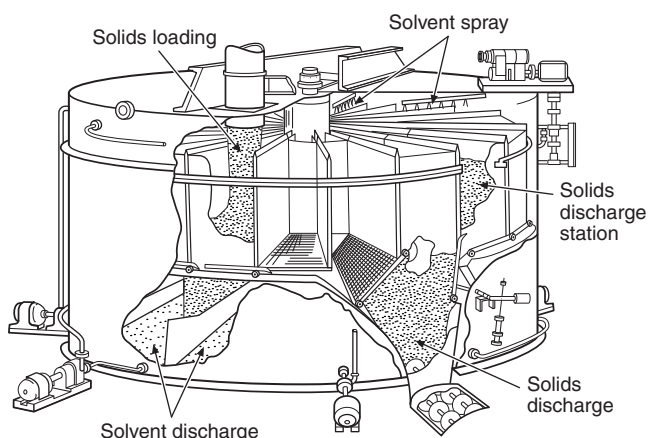


FIGURE B.6(a) Rotary or Deep Bed Extractor. (Courtesy of Chemical Engineering)

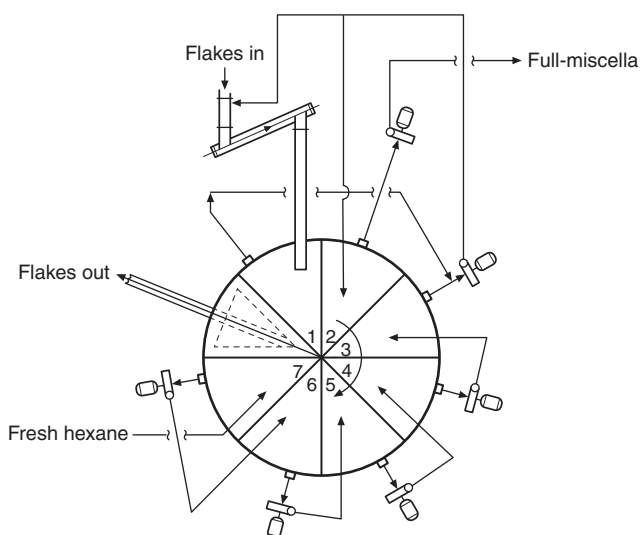


FIGURE B.6(b) Schematic of Operation of Rotary Extractor.

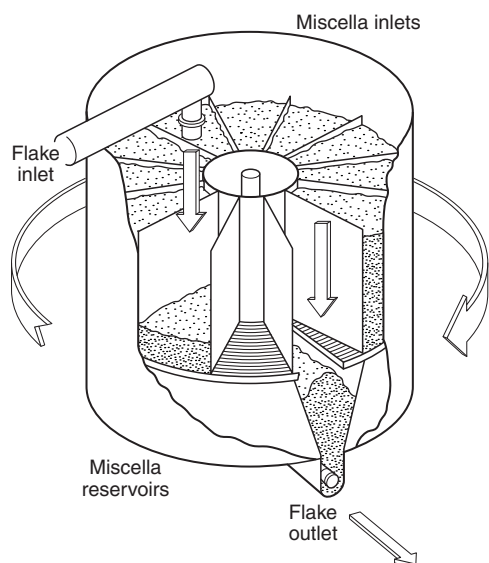


FIGURE B.6(c) Stationary-Bottom or Sliding-Plate Extractor.

belt for the entire length of the extractor for collection of various concentrations of miscellas. The spent material is continuously discharged from the end of the belt into a hopper, from which it is conveyed to the desolventizer.

Another type of perforated belt extractor, the sliding cell extractor [see Figure B.7(b)], provides two extraction surfaces where the flakes are separated by rectangular compartments while traveling along the moving slotted screens or stationary vee-bar screen plates. This unit achieves countercurrent extraction by employing stage pumps and a series of collecting pans to direct the flow of the various miscella concentrations. Because there is an upper and a lower screen belt or plate, the

filling device can be located over, but separated from, the discharge hopper.

When the partially extracted material reaches the end of the top belt, it falls from the upper cell into a similar compartment on the lower belt. The mass continues to be sprayed with miscella from the stage pumps until it reaches the fresh solvent wash prior to draining and feeding into the discharge hopper.

B.8 Rectangular Loop Extractor. The same basic principles are used in the rectangular loop extractor (see Figure B.8) as in the sliding cell extractor. However, the overall shape of this extractor utilizes an “en masse”-type conveyor instead of individual baskets. The bottom part of the conveyor uses stationary, linear vee-bar screens. Flakes enter near the top of the extractor at the inlet hopper. A conveyor chain carries the flakes away from this hopper and down the first leg of the loop, where the flakes receive their first wash. In the bottom horizontal run of the loop, the flakes are washed with progressively weaker concentrations of miscellas. As the flakes travel up the vertical part of the loop, they are further extracted by a countercurrent wash of miscella flowing down the loop. On the sloping top run of the extractor, they receive a fresh solvent wash, are allowed to drain, and are discharged continuously from the unit.

The extractor conveying chain is open at the top, bottom, and sides. This allows easy loading and emptying of the material and for passage of the solvent through the flake bed as it is turned during its extraction wash cycle. The speed of the chain is automatically controlled by the level of flakes in the inlet hopper. A sensor in the feed hopper measures the level of flakes in the hopper and sends a signal to the extractor's variable speed drive.

B.9 Other Types of Extractors. Other types of extractors for extracting oil from oil-bearing materials are available, but they are not in general use. These other types include vertical immersion, filtration, and batch extractors. Some are used only for special applications.

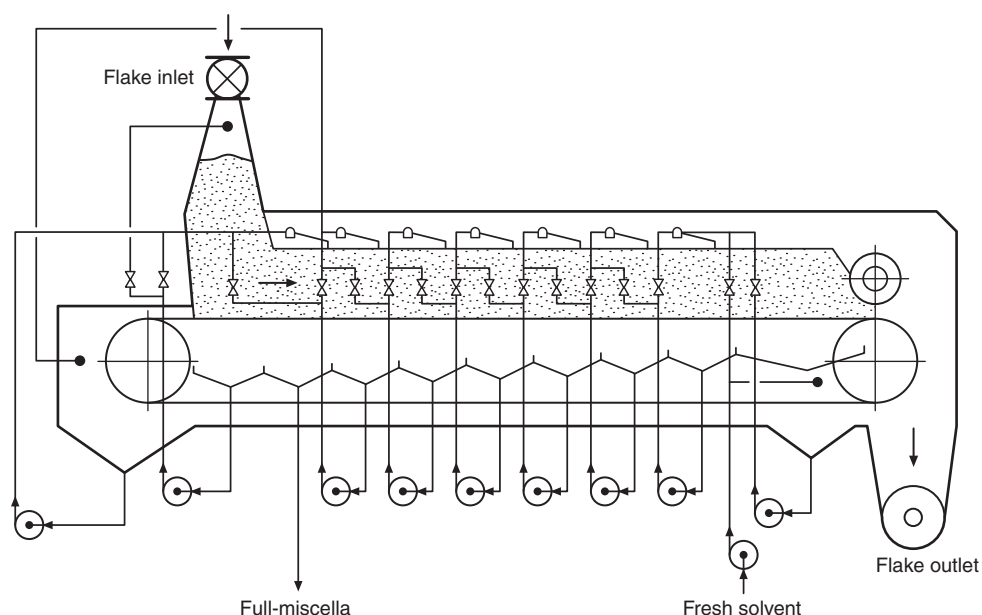


FIGURE B.7(a) Perforated Belt Extractor.

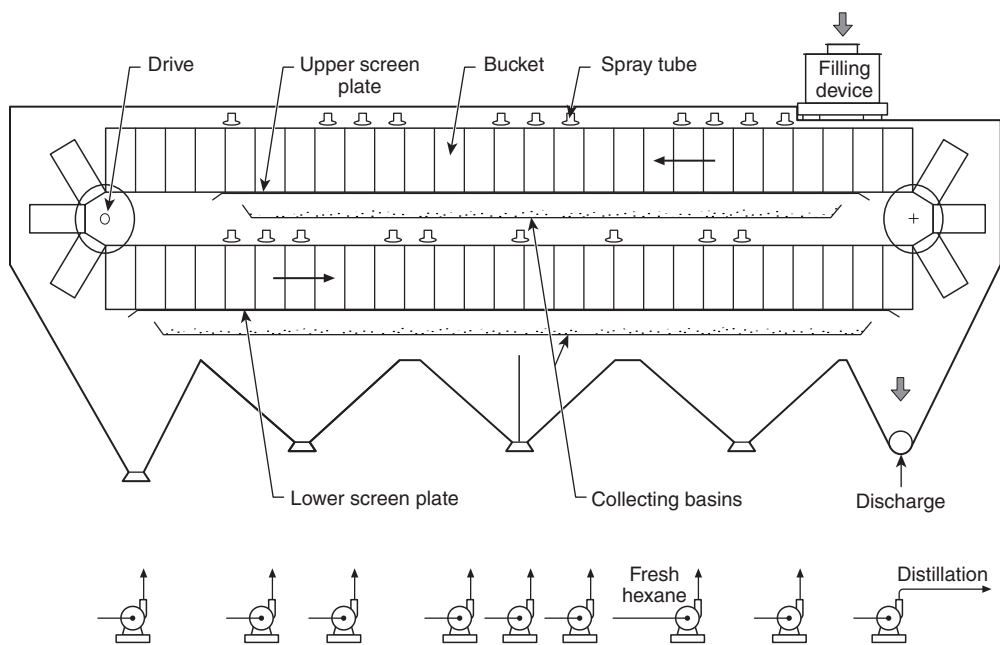


FIGURE B.7(b) Sliding Cell Extractor.

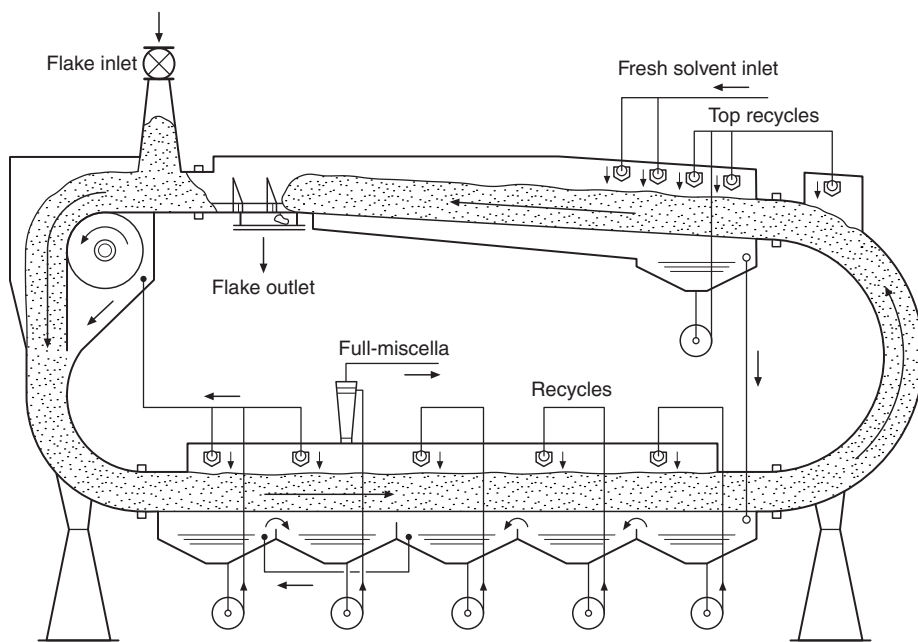


FIGURE B.8 Rectangular Loop Extractor.