

NFPA 90B
Warm Air
Heating and
Air Conditioning
Systems
1993 Edition



NOTICE

All questions or other communications relating to this document should be sent only to NFPA headquarters, addressed to the attention of the Committee responsible for the document.

For information on the procedures for requesting Technical Committees to issue Formal Interpretations, proposing Tentative Interim Amendments, proposing amendments for Committee consideration, and appeals on matters relating to the content of the document, write to the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Users of this document should consult applicable federal, state and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Policy Adopted by NFPA Board of Directors on December 3, 1982

The Board of Directors reaffirms that the National Fire Protection Association recognizes that the toxicity of the products of combustion is an important factor in the loss of life from fire. NFPA has dealt with that subject in its technical committee documents for many years.

There is a concern that the growing use of synthetic materials may produce more or additional toxic products of combustion in a fire environment. The Board has, therefore, asked all NFPA technical committees to review the documents for which they are responsible to be sure that the documents respond to this current concern. To assist the committees in meeting this request, the Board has appointed an advisory committee to provide specific guidance to the technical committees on questions relating to assessing the hazards of the products of combustion.

Licensing Provision—This document is copyrighted by the National Fire Protection Association (NFPA).

1. Adoption by Reference—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

2. Adoption by Transcription—**A.** Public authorities with lawmaking or rule-making powers only upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

3. Scope of License Grant—The terms and conditions set forth above do not extend to the index to this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Statement on NFPA Procedures

This material has been developed under the published procedures of the National Fire Protection Association, which are designed to assure the appointment of technically competent Committees having balanced representation. While these procedures assure the highest degree of care, neither the National Fire Protection Association, its members, nor those participating in its activities accept any liability resulting from compliance or noncompliance with the provisions given herein, for any restrictions imposed on materials or processes, or for the completeness of the text.

NFPA has no power or authority to police or enforce compliance with the contents of this document, and any certification of products stating compliance with requirements of this document is made at the peril of the certifier.

Copyright © 1993 NFPA, All Rights Reserved

NFPA 90B

Standard for the Installation of

Warm Air Heating and Air Conditioning Systems

1993 Edition

This edition of NFPA 90B, *Standard for the Installation of Warm Air Heating and Air Conditioning Systems*, was prepared by the Technical Committee on Air Conditioning, released by the Correlating Committee on Building Construction, and acted on by the National Fire Protection Association, Inc. at its Fall Meeting held November 16-18, 1992, in Dallas, TX. It was issued by the Standards Council on January 15, 1993, with an effective date of February 12, 1993, and supersedes all previous editions.

The 1993 edition of this document has been approved by the American National Standards Institute.

Origin and Development of NFPA 90B

This standard dates from 1899, when Committee attention was first given to blower and exhaust systems. Prior to 1936, the subject of air conditioning was covered in NFPA standards on blower systems. In 1937 it was decided to prepare a separate *Standard on Air Conditioning, Warm Air Heating and Ventilating Systems*. This standard was initially adopted in 1937 with subsequent amendments in 1938, 1939, 1940, 1942, 1950, 1952, 1955, 1956, 1960, 1961, 1963, 1964, 1965, 1968, 1971, 1973, 1976, 1980, 1984, and 1989.

The 1993 edition is a reconfirmation of the 1989 edition.

For *Standard for the Installation of Air Conditioning and Ventilating Systems*, see NFPA 90A.

Committee on Building Construction

Correlating Committee

Donald W. Belles, Chairman
Donald W. Belles & Assoc. Inc., TN

John G. Degenkolb, Carson City, NV
Kenneth A. Kander, K. A. Kander & Assoc., WA
Jack L. Kerin, State of California, CA

Harold E. Nelson, Nat'l Inst. of Standards & Technology (NIST), MD
Chester W. Schirmer, Schirmer Engineering Corp., NC
William A. Schmidt, Bowie, MD

Nonvoting

Jonas L. Morehart, Nat'l Inst. of Health, MD
Rep. Technical Committee on Safety to Life

Technical Committee on Air Conditioning

William A. Schmidt, Chairman
Bowie, MD

Michael D. Ahern, Vice Chairman
Harbridge Inc., WI
Rep. SMACNA

Jack B. Buckley, I. A. Naman + Assoc., TX
Frederic B. Clarke, Benjamin/Clarke Assoc., Inc., MD
David A. de Vries, Schirmer Engineering Corp., IL
Michael Earl Dillon, Dillon Consulting Engr., Inc., CA
S. E. Egesdal, Honeywell Inc. Minneapolis, MN
Rep. Nat'l Electrical Mfrs. Assn.
Daniel Fragnito, United Technologies Carrier, NY
Rep. Air Conditioning and Refrigeration Inst.
Richard G. Gewain, Hughes Assoc. Inc., MD
Winfield T. Irwin, CertainTeed Corp., PA
Rep. Thermal Insulation Mfrs. Assn.
Michael L. Jorgenson, Underwriters Laboratories Inc., IL
Philip R. Jose, U.S. Department of Veterans Affairs, NY
Rep. American Hospital Assn.
John H. Klotz, Building and Fire Research Laboratory (NIST), MD
Marvin A. Koerber, Atco Rubber Products Inc., TX
Rep. Air Diffusion Council

Kenneth S. Lewison, NY State Bldg Codes Bureau, NY
Richard E. Masters, Jaros Baum & Bolles, NY
Henry Omson, U.S. Department of Housing & Urban Development, DC
Lyman L. Parks, Bellcore, NJ
Donald J. Roszak, IRM Insurance Inc., IL
Sylvester A. Sampson, Jr., HHS/OES VI, TX
Todd E. Schumann, Industrial Risk Insurers, IL
J. Brooks Semple, Smoke/Fire Risk Mgmt Inc., VA
Rep. American Society for Heating, Refrigeration & Air Cond. Engr.
Robert Van Becelaere, Ruskin Manufacturing Div., MO
Rep. Air Movement & Control Assn. Inc.
William A. Webb, Rolf Jensen & Assoc Inc., IL
Robert A. Wessel, Gypsum Assn., DC
Ralph E. Williams, Southwestern Vermont Medical Ctr., VT
Rep. NFPA Health Care Section
Robert J. Wills, American Iron & Steel Institute, AL

Alternates

Delbert F. Boring, Jr., American Iron & Steel Inst., OH
(Alt. to R. J. Wills)
John Clukey, Air Conditioning & Refrigeration Inst., VA
(Alt. to D. Fragnito)
Jerome E. Cunningham, Rolf Jensen & Assoc., CA
(Alt. to W. A. Webb)
Douglas S. Erickson, American Hospital Assn., IL
(Alt. to P. R. Jose)

Richard A. Gross, Industrial Risk Insurers, CT
(Alt. to T. E. Schumann)
Geraldine Massey, Dillon Consulting Engr., Inc. CA
(Alt. to M. E. Dillon)
Jayendra S. Parikh, Underwriters Laboratories Inc., IL
(Alt. to M. L. Jorgenson)
Thomas E. Ponder, CertainTeed Corp., PA
(Alt. to W. T. Irwin)

Nicholas L. Talbot, Pompano Beach, FL
(Alt. to D. J. Roszak)
James Tatum, Controlled Air Mfr. Ltd., Ontario
(Alt. to R. Van Becelaere)

Chris Thomaidis, Sheet Metal & Air Cond Cont Nat'l
Assn., VA
(Alt. to M. D. Ahern)
Ed Thorp, System Sensor Division, IL
(Alt. to S. E. Egesdal)

L. Charles Smeby, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred.

NOTE: Membership on a Committee shall not in and of itself constitute an endorsement of the Association or any document developed by the Committee on which the member serves.

Committee Scope: The construction, installation, operation, and maintenance of systems for air conditioning, warm air heating, and ventilating including filters, ducts, and related equipment to protect life and property from fire, smoke, and gases resulting from fire or from conditions having manifestations similar to fire.

Contents

Chapter 1 General	90B- 5	3-2 Firestopping	90B-13
1-1 Scope	90B- 5		
1-2 Purpose	90B- 5		
1-3 Definitions	90B- 5		
Chapter 2 System Components	90B- 6	Chapter 4 Equipment, Wiring, and Controls	90B-13
2-1 Supply Systems	90B- 6	4-1 Equipment	90B-13
2-2 Return Systems	90B- 7	4-2 Electric Wiring and Equipment	90B-14
2-3 Common Requirements	90B- 8	4-3 Controls	90B-14
Chapter 3 Fire Integrity of Building		Chapter 5 Referenced Publications	90B-15
Construction	90B- 9	Appendix A Referenced Publications	90B-15
3-1 Clearances to Combustible Material	90B- 9	Index	90B-16

NFPA 90B
Standard for the Installation of
Warm Air Heating and Air Conditioning
Systems
1993 Edition

NOTICE: For information on referenced publications, see Chapter 5 and Appendix A.

Chapter 1 General

1-1 Scope. This standard applies to all systems for the movement of environmental air in structures that:

- (a) Serve one- or two-family dwellings, or
- (b) Serve spaces not exceeding 25,000 cu ft (708 m³) in volume in any occupancy.

Exception: Buildings of combustible construction over three stories in height are covered by NFPA 90A, Standard for the Installation of Air Conditioning and Ventilating Systems.

NOTE: For other type systems, see NFPA 90A. For installation of blower and exhaust systems, see NFPA 91. For removal of smoke and grease-laden vapors from commercial cooking equipment, see NFPA 96.

1-2 Purpose. This standard is intended to prescribe reasonable provisions based on minimum requirements for safety to life and property. Nothing in this standard is intended to prevent the use of methods or devices, provided that sufficient technical data is submitted to the authority having jurisdiction to demonstrate that the proposed method or device is equivalent in quality, strength, fire endurance, effectiveness, durability, and safety to that prescribed by this standard.

1-3 Definitions.

Air Filter. A device used to reduce or remove airborne solids from heating, ventilating, and air conditioning systems.

Approved. Acceptable to the "authority having jurisdiction."

NOTE: The National Fire Protection Association does not approve, inspect or certify any installations, procedures, equipment, or materials nor does it approve or evaluate testing laboratories. In determining the acceptability of installations or procedures, equipment or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization concerned with product evaluations which is in a position to determine compliance with appropriate standards for the current production of listed items.

Authority Having Jurisdiction. The "authority having jurisdiction" is the organization, office or individual responsible for "approving" equipment, an installation or a procedure.

NOTE: The phrase "authority having jurisdiction" is used in NFPA documents in a broad manner since jurisdictions and "approval" agencies vary as do their responsibilities. Where public safety is primary, the "authority having jurisdiction" may be a federal, state, local or other regional department or individual such as a fire chief, fire marshal, chief of a fire prevention bureau, labor department, health department, building official, electrical inspector, or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the "authority having jurisdiction." In many circumstances the property owner or his designated agent assumes the role of the "authority having jurisdiction"; at government installations, the commanding officer or departmental official may be the "authority having jurisdiction."

Central Warm Air Heating System. A heating system consisting of a heat exchanger with an outer casing or jacket, a solar collection system, or an electric heating unit, connected to a supply system and a return system.

Combustible Material. Material made of or surfaced with wood, compressed paper, plant fibers, or other material that will ignite and burn, whether flameproofed or not or whether plastered or unplastered.

Duct Covering. Duct covering includes materials such as adhesive, insulation, banding, coating(s), film, and jackets used to cover the outside surface of a duct, fan casing, or duct plenum.

Duct Lining. Duct lining includes materials such as adhesive, insulation, coating, and film used to line the inside surface of a duct, fan casing, or duct plenum.

Forced Air System. A central warm air heating system that is equipped with a fan or blower that provides the primary means for circulation of air.

Gravity System. A central warm air heating system through which air is circulated by gravity. It may also use an integral fan or blower that is used only to overcome the internal furnace resistance to airflow.

Heat Exchanger. A chamber in which heat resulting directly from combustion of fuel, or heat from a medium such as air, water, or steam, is transferred through the walls of the chamber to the air entering the supply system or in which heat from electrical resistors is transferred to the air entering the supply system.

Heat Pump. A refrigeration system arranged to accomplish either (a) heating or (b) heating and cooling.

Listed. Equipment or materials included in a list published by an organization acceptable to the "authority having jurisdiction" and concerned with product evaluation, that maintains periodic inspection of production of listed equipment or materials and whose listing states either that the equipment or material meets appropriate standards or has been tested and found suitable for use in a specified manner.

NOTE: The means for identifying listed equipment may vary for each organization concerned with product evaluation, some of which do not recognize equipment as listed unless it is also labeled. The "authority having jurisdiction" should utilize the system employed by the listing organization to identify a listed product.

Noncombustible Material. A material that, in the form in which it is used and under the conditions anticipated, will not ignite, burn, support combustion, or release flammable vapors when subjected to fire or heat. When tested in accordance with ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*, materials that successfully pass the test shall be considered noncombustible.

Plenum. An air compartment or chamber to which one or more ducts are connected and that forms part of either the supply or return systems.

Return System. An assembly of connected ducts, air passages, or plenums and fittings through which air from the space or spaces to be conditioned is conducted back to the heat exchanger.

Rooms Large in Comparison with the Size of the Application. Rooms having a volume equal to at least 12 times the total volume of the furnace and at least 16 times the total volume of a boiler. Total volume of furnace or boiler is determined from exterior dimensions and is to include fan compartments and burner vestibules, when used. When the actual ceiling height of a room is greater than 8 ft (2.44 m), the volume of a room shall be figured on the basis of a ceiling height of 8 ft (2.44 m).

Shall. Indicates a mandatory requirement.

Should. Indicates a recommendation or that which is advised but not required.

Supply Systems. An assembly of connected ducts, air passages, or plenums and fittings through which air is conducted from the heat exchanger to the space or spaces to be conditioned.

Chapter 2 System Components

2-1 Supply Systems.

2-1.1 Duct Materials.

2-1.1.1 Supply ducts shall be:

(a) Class 0 or Class 1 rigid or flexible air ducts tested in accordance with UL 181, *Standard for Factory-Made Air Ducts and Connectors*, or

NOTE: Air duct materials are classified in UL 181 as follows:

Class 0 — Air duct materials having a fire hazard classification of zero (flame spread and smoke developed).

Class 1 — Air duct materials having a flame-spread rating of not over 25 without evidence of continued progressive combustion and a smoke-developed rating of not over 50.

(b) Of sheet metal having a nominal thickness as shown in Table 2-1-1. Furnace plenums shall be constructed of metal of minimum thickness as shown in Table 2-1-1 for a minimum of 36 in. (914 mm) from the heat exchanger measured along the center line of airflow. Other plenums shall conform to the requirements for supply ducts.

Exception No. 1: Supply ducts that are completely encased in not less than 2 in. (51 mm) of concrete in a floor slab need not meet the requirements of 2-1.1.1 except within 2 ft (0.61 m) of the furnace supply plenum and within 2 ft (0.61 m) of a vertical connection to a riser or register.

Exception No. 2: Supply ducts for a separate air cooling system, not interconnected to any warm air heating system, serving a single-family dwelling need not meet the requirements of 2-1.1.1, provided that they are not closer than 2 ft (0.61 m) to any furnace or its supply plenum, boiler, or other heat producing appliances and that they comply with 2-2.1.1, 2-2.1.3, 2-2.2, 2-2.3, and 2-2.4 as specified for return ducts.

Exception No. 3: Vibration isolation connectors in duct systems shall be made of approved flame retardant fabric or shall consist of sleeve joints with packing of approved noncombustible material. The fabric shall not exceed 10 in. (254 mm) in length in direction of airflow.

Exception No. 4: Class 0 or Class 1 rigid or flexible air ducts shall not be used as a vertical air duct that is more than two stories in height.

Exception No. 5: Class 0 or Class 1 rigid or flexible air ducts shall not be used in air ducts containing air at temperatures in excess of 250°F (121°C).

2-1.1.2 Supply ducts shall be installed in conformance with:

- (a) Conditions of their listing,
- (b) SMACNA *Fibrous Glass Duct Construction Standard*, Fifth Edition,
- (c) SMACNA *HVAC Duct Construction Standards*, First Edition, 1985, or
- (d) SMACNA *Installation Standards for Residential Heating and Air Conditioning Systems*, Sixth Edition, 1985.

2-1.2 Air Connectors. Air connectors are limited-use, flexible air ducts that need not conform to the requirements for air ducts if they conform to the following provisions:

- (a) Air connectors shall conform to the requirements for Class 0 or Class 1 connectors when tested in accordance with UL 181, *Standard for Factory-Made Air Ducts and Connectors*.
- (b) Class 0 or Class 1 air connectors shall not be used in ducts containing air at temperatures in excess of 250°F (121°C).
- (c) An air connector run shall not exceed 14 ft (4.3 m) in length.
- (d) Air connectors shall not pass through any wall, partition, or enclosure of a vertical shaft that is required to have a fire-resistance rating of 1 hour or more.
- (e) Air connectors shall not pass through floors.

Table 2-1.1 Nominal Thickness of Sheet Metal Ducts

Diam. or Width, inches/mm	Nominal Thickness inches/mm	Galvanized Sheet	Aluminum	Tin Plate
		Min. Thickness inches/mm	Thickness inches/mm	Min. Wt. (lb/kg) per base box
(a) Round Ducts & Enclosed Rectangular Ducts:				
14 (356) or less	0.016/0.406	0.013/0.330	0.016/0.406	135/61
Over 14 (356)	0.019/0.483	0.016/0.406	0.020/0.508	—
(b) Exposed Rectangular Ducts:				
14 (356) or less	0.019/0.483	0.016/0.406	0.020/0.508	—
Over 14 (356)	0.022/0.559	0.019/0.483	0.023/0.584	—

2-1.3 Furnace Plenums. Furnace plenums shall be constructed of metal of minimum thickness as shown in Table 2-1.1 for a minimum of 36 in. (914 mm) from the heat exchanger measured along the center line of airflow. Other plenums shall conform to the requirements for supply ducts.

2-1.4 Use of Under Floor Space as Supply Plenum. Where heated air is discharged downward into an air chamber that forms a plenum of an under floor space, the following shall apply:

(a) Use of such spaces shall be restricted to one-story portions of single-family dwellings.

(b) Such spaces shall be cleaned of all combustible material, shall be tightly and substantially enclosed, and shall not be used for storage or habitation.

(c) The enclosing material of the under floor space including the side wall insulation and ground cover shall not be more flammable than 1-in. (25.4-mm) (nominal) wood boards. Ground cover not complying with this requirement shall be covered over with at least 2 in. (50.8 mm) of sand or other noncombustible material.

(d) Access, if provided to such spaces, shall be through an opening in the floor and shall not be greater than 24 by 24 in. (610 × 610 mm).

(e) Units supplying warm air to such space shall be equipped with an automatic control that will start the air circulating fan when the air in the unit bonnet reaches a temperature not higher than 150°F (66°C). Such control shall be one that cannot be set higher than 150°F (66°C).

(f) Units supplying warm air to such space shall be equipped with an approved temperature limit control that will limit outlet air temperature to 200°F (93°C).

(g) A noncombustible receptacle shall be placed below each floor type opening into the air chamber. Such receptacles shall conform to the following:

(1) The receptacle shall be securely suspended from the floor members and shall not be more than 18 in. (457 mm) below the floor opening.

(2) The size of the horizontal projected area of the receptacle shall extend 3 in. (76 mm) beyond the opening.

(3) The perimeter of the receptacle shall have a vertical lip at least 1 in. (25.4 mm) high at the open sides if it

is at the level of the bottom of the joists, or 3 in. (76 mm) high if the receptacle is suspended.

(h) Floor registers shall be designed for easy removal in order to give access for cleaning the receptacles.

(i) Exterior walls and interior stud partitions shall be firestopped at the floor.

(j) Each wall register shall be connected to the air chamber with a duct or boot complying with 2-1.1, 3-1.3.1, and 3-1.3.2.

(k) Supply ducts to the air chamber shall comply with the provisions of 2-1.1, 3-1.1, and 3-1.2 and shall terminate approximately under the center of a room above, at a distance of not less than 6 ft (1.83 m) from the plenum chamber.

(l) Furnaces, boilers, or other heat-producing appliances shall not be installed in such a supply plenum. (See NFPA 31, *Standard for the Installation of Oil-Burning Equipment*, and NFPA 54, *National Fuel Gas Code*.)

2-2 Return Systems.

2-2.1 Duct Material.

2-2.1.1 Return ducts may be constructed of metal, of 1-in. (25.4-mm) (nominal) wood boards, or of other suitable material, provided that no material more flammable than 1-in. (25.4-mm) boards shall be used.

Exception: As required by 2-2.1.2.

2-2.1.2 Portions of return ducts directly above the heating surface or closer than 2 ft (0.61 m) from the outer jacket or casing of the heater shall be constructed in accordance with provisions of 2-1.1 for supply ducts.

2-2.1.3 The interior of combustible ducts shall be lined with noncombustible material at points where there might be danger from incandescent particles dropped through the register or heater, such as directly under floor registers and the bottom of vertical ducts or directly under heaters having a bottom return.

2-2.2 Duct Openings. In buildings where vertical openings are required to be enclosed by walls or partitions having a fire-resistance rating, openings in the enclosures for

connections to vertical ducts carrying return air from more than one story shall be protected by approved fire dampers in such openings.

2-2.3 Continuous Ducts.

2-2.3.1 Return air shall be conducted to the appliance through continuous ducts, except as indicated in 2-2.3.2 and 2-2.3.3.

2-2.3.2 Under floor spaces may be used as plenums for return of air from rooms directly above, provided such spaces are cleaned of all combustible material, are tightly and substantially enclosed, and are not used for storage or habitation. Furnaces, boilers, and other heat-producing appliances shall not be installed in such a return plenum. (See *NFPA 31, Standard for the Installation of Oil-Burning Equipment*, and *NFPA 54, National Fuel Gas Code*.)

2-2.3.3 In a single-story residence, the return air may travel through the first floor living space to the return air inlet on the furnace. (See 4-3.3.)

2-2.4 Public Corridors. Public corridors shall not be used as a portion of a supply, return, or exhaust air system serving adjoining areas other than toilet rooms, bathrooms, shower rooms, sink closets, and similar auxiliary spaces opening directly on the corridor.

Exception: This requirement shall not prohibit the use of a corridor as:

(a) *A source of make-up air through normal leakage around doors for interior exhaust fans in kitchens, appliances, bathrooms, and toilets.*

(b) *A portion of a smoke control system, subject to the approval of the authority having jurisdiction.*

2-2.5 Negative Pressure from Circulating Fan. The return system and circulating fan shall be arranged so that negative pressure from the circulating fan cannot affect the air supply for combustion or act to draw products of combustion from joints or openings in the furnace or flue.

2-3 Common Requirements.

2-3.1 Duct Coverings and Linings.

2-3.1.1 Duct coverings (see Section 1-3), duct linings (see Section 1-3), and tapes used in duct systems shall have a flame spread rating not over 25 without evidence of continued progressive combustion and a smoke developed rating no higher than 50. If coverings and linings are to be applied with adhesives, they shall be tested as applied with such adhesives, or the adhesives used shall have a flame spread rating not over 25 and a smoke developed rating no higher than 50 when in the final dry state.

Exception: Duct coverings (see Section 1-3) shall not be required to meet these requirements where they are located entirely outside of a building, do not penetrate a wall or roof, and do not create an exposure hazard.

2-3.1.2 Duct coverings and linings shall not flame, glow, smolder, or smoke when tested in accordance with ASTM C411, *Test Method for Hot-Surface Performance of High-*

Temperature Thermal Insulation, at the temperature to which it is exposed in service. In no case shall the test temperature be below 250°F (121°C).

2-3.1.3 Appliances, such as fan coil units, self-contained air conditioning units, furnaces, etc., shall be considered to meet the requirements of 2-3.1.1 if they are listed. Unlisted solar energy air distribution system components shall be accompanied by supportive information showing they have flame spread and smoke developed characteristics not exceeding those of the duct system to which they are connected.

2-3.1.4 Duct coverings shall not extend through walls or floors required to be firestopped or required to have a fire-resistance rating.

2-3.1.5 Duct coverings and linings shall be interrupted at the immediate area of operation of heat sources in a duct system involving electric resistance, fuel burning heaters, or heat exchangers connected to solar energy collection systems and shall be in accordance with the manufacturer's instructions.

Exception: Solar energy heat exchangers not capable of creating sustained operating temperatures higher than 200°F (93°C).

2-3.1.6 Duct coverings shall not conceal any service opening.

Exception: When a label is permanently attached to the covering indicating the exact location of the opening.

2-3.2 Joints. Joints and seams shall be securely fastened and made substantially airtight. Slip joints shall have a lap of at least 1 in. (25.4 mm) and shall be individually fastened. (See Figure 2-3.2.) Tape may be used for sealing joints but, where exposed to the air in the system, it shall not be more combustible than fabric complying with NFPA 701, *Standard Methods of Fire Tests for Flame-Resistant Textiles and Films*. (See *Flame-Retarded Fabrics in the Building Materials Directory*, published by Underwriters Laboratories Inc.)

2-3.3 Duct Hangers. Ducts shall be securely supported by metal hangers, straps, lugs, or brackets. No nails shall be driven through the duct walls, and no unnecessary holes shall be cut therein.


2-3.4 Protection of Vertical Ducts. Where vertical ducts are installed within closets or rooms, they shall be enclosed with materials equivalent to those used in the closet or room construction. (See 3-1.3.)

2-3.5 Registers for Ducts and Plenums.

2-3.5.1 Registers shall be constructed of metal or conform with the following:

(a) Registers shall be made of a material classified "(94 HB)" when tested as described in UL 94, *Standard for Tests for Flammability of Plastic Materials for Parts in Devices and Appliances*.

(b) Floor registers shall resist without structural failure a 200-lb (90.7-kg) concentrated load on a 2-in. (51-mm) diameter disc applied to the most critical area of the

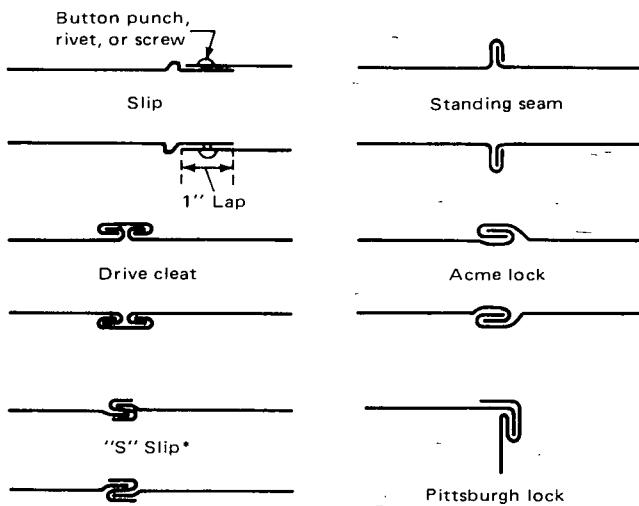

*Used where the joint is otherwise fastened on two sides.

Figure 2-3.2 Types of duct joints.

exposed face of the register. For this test the register shall be at a temperature not less than 165°F (74°C) and shall be supported in accordance with the manufacturer's instructions.

2-3.5.2 Electric or fuel-fired furnace systems shall have at least one register or grill without closeable shutter, and the duct leading thereto shall be without a damper.

Exception: Where dampers and shutters cannot shut off more than 80 percent of the duct area.

2-3.5.3 Fittings connecting the registers to the duct system shall be constructed of metal or material that complies with the requirements of Class 0, Class 1, or Class 2 ducts under UL 181, *Standard for Factory-Made Air Ducts and Connectors*.

2-3.6 Pipeless Furnace Registers. Where registers are installed in the floor over the furnace (as in the "pipeless" furnace) the register box shall be constructed double with an air space not less than 4 in. (102 mm) between, except where the warm air passage is surrounded by a cold air passage.

2-3.7 Use of Concealed Ceiling Spaces as Supply or Return Plenums. Where concealed ceiling spaces are to be used for air chambers or plenums, the following shall apply:

(a) Such installations shall be limited to detached single-family dwellings, and no concealed ceiling space plenum shall serve more than one story of such residence. This shall not preclude separate installations on each floor.

(b) The concealed space plenum shall be separated from any other concealed spaces and shall be completely enclosed with construction not more flammable than 1-in. (25.4-mm) (nominal) wood boards.

(c) Such spaces shall not be used for storage.

(d) No ventilating system shall discharge into such spaces.

(e) Units supplying such spaces shall be designed to limit the temperature of the air discharged into the supply plenum or chamber to 165°F (74°C).

(f) Where units incorporate heating elements, heated surfaces, or combustion chambers, developing temperatures higher than 165°F (74°C), such components shall be shielded so as to prevent direct radiation onto combustible material when the unit is installed.

(g) The installation of the unit supplying such spaces shall not produce negative pressure in the attic where the attic is the source of air for combustion for fuel-fired equipment.

Chapter 3 Fire Integrity of Building Construction

3-1 Clearances to Combustible Material.

3-1.1 General. Where ducts are adjacent to plaster on metal lath, or to other noncombustible finish attached to a combustible material, the clearance shall be measured to the combustible material, except that the clearance shall be measured to the surface of the plaster or other noncombustible finish where a clearance of 2 in. (51 mm) or less is specified above a bonnet or plenum chamber or above supply ducts. This shall not be construed to prohibit closure of openings with noncombustible material where ducts pass through walls and partitions, as provided in 3-1.2.

Exception: Where an appliance, duct work, or chimney or vent connection is listed for different clearances, the listed clearances shall apply.

3-1.2 Clearances from Horizontal Supply Ducts. Minimum clearances from horizontal supply ducts shall be as follows:

(a) Within a distance of 3 ft (0.91 m) of the plenum of a system classified under A, C, or G of Table 3-1.3, the clearance shall be not less than that specified above the bonnet or plenum.

(b) Within a distance of 6 ft (1.83 m) of the plenum of a system classified under B or D of Table 3-1.3, the clearance shall be not less than 6 in. (152 mm). From ducts of furnaces classified under D, the clearance shall be not less than 1 in. (25.4 mm) beyond 6 ft (1.83 m) from the plenum to a point where there is a change in direction equivalent to 90 degrees or more.

(c) From ducts of furnaces classified under Item F of Table 3-1.3, the clearance shall be not less than 18 in. (457 mm) out to 3 ft (0.91 m) from the bonnet or plenum, not less than 6 in. (152 mm) from 3 ft (0.91 m) to 6 ft (1.83 m), and not less than 1 in. (25.4 mm) beyond 6 ft (1.83 m).

(d) Beyond the distances from the plenum or change in direction specified in 3-1.2(a) and (b), no clearance is required.

(e) Where a horizontal supply duct passes through or pierces a partition or enclosure constructed of combustible material, within the distances, or point of change in direction specified in 3-1.2(a), (b), and (c), the clearance shall be not less than that specified in those paragraphs. The ends of the space providing this clearance may be closed with a

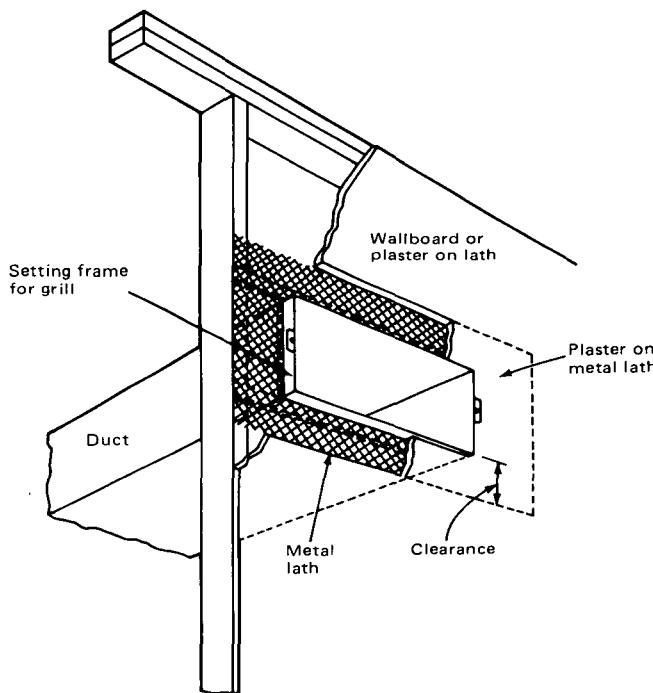


Figure 3-1.2(a) An arrangement for closing ends of clearance space around a supply duct. A similar arrangement can be used where a duct continues on through the partition.

thimble and collar or the wall surfaces extended to the duct with noncombustible building material such as plaster on metal lath. [See Figures 3-1.2(a) and (b).]

(f) Separate air cooling system ducts that are made of other than noncombustible material shall be installed with clearances to warm air ducts as required in 3-1.2(a), (b), and (c).

3-1.3 Clearances from Vertical Ducts, Risers, Boots, and Register Boxes.

3-1.3.1 Where a duct, riser, boot, or box on a system that does not require 18 in. (457 mm) clearance above the supply plenum or bonnet enters a floor, partition, or enclosure constructed of combustible material within the distance from the plenum specified in 3-1.2(a) and (b), the clearance from such duct, riser, or boot shall be not less than the distance required above the furnace bonnet or plenum (see Table 3-1.3) or the duct shall change direction equivalent to at least two 90-degree turns before entering such floor, partition, or enclosure. The above does not apply to pipeless furnaces covered in 2-3.5.

3-1.3.2 Where a supply duct enters the floor of the first story above that in which the furnace is located, the space around the duct at such points shall be sealed with noncombustible material.

3-1.3.3 Where a duct, riser, boot, or box on a system that requires 18 in. (457 mm) clearance above the supply plenum or bonnet enters a floor, partition, or enclosure

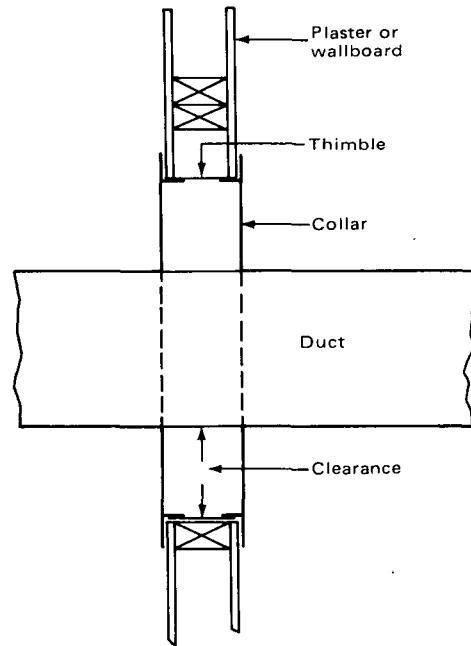


Figure 3-1.2(b) An arrangement for passing ducts through combustible walls or partitions as specified in 3-1.2(e).

constructed of combustible material within a horizontal distance of 6 ft (1.83 m) of the furnace, the duct shall be so arranged that heated air must travel at least 6 ft (1.83 m) from the closest primary heating surface and change direction equivalent to at least one 90-degree turn before entering such floor, partition, or enclosure.

3-1.3.4 Where a duct, riser, boot, or box on a system that requires 18 in. (457 mm) clearance above the supply plenum or bonnet enters the floor of the first story above that in which the furnace is situated, the clearance shall be at least $\frac{3}{16}$ in. (4.76 mm) from all combustible material in the floor construction, unless the duct is of double wall construction with a continuous air space of not less than $\frac{3}{16}$ in. (4.76 mm) between the inner and outer walls.

3-1.3.5 Where a duct or riser on a system that requires 18 in. (457 mm) clearance above the supply plenum or bonnet is enclosed in a partition, wall, or concealed space, constructed in whole or in part of combustible material:

(a) It shall be installed with an air space of not less than $\frac{3}{16}$ in. (4.76 mm) between the duct and combustible material, unless a noncombustible insulating covering of cellular type at least $\frac{1}{8}$ in. (3.175 mm) thick is provided (in metal lath and plaster partitions no air space is needed except from wood studs);

(b) Or, such duct shall be made double with a continuous air space of not less than $\frac{3}{16}$ in. (4.76 mm) between the inner and outer walls.

3-1.3.6 Where a register on a system that requires 18 in. (457 mm) clearance above the supply plenum or bonnet is placed in a floor or wall constructed of combustible material, the register box shall be installed with a clear space of not less than $\frac{3}{16}$ in. (4.76 mm) between the top and sides of the box and any combustible material.

Table 3-1.3 Clearances to Combustible Material for Furnaces, Boilers, Solar Energy Heating Devices, and Heat Exchangers Installed in Rooms that are Large in Comparison with Size of Appliance

	Minimum Clearance, inches (For SI Units: 1 in. = 25.4 mm)				
	Above & Sides of Bonnet or Plenum	Jacket Sides & Rear	Front ¹	Projecting Flue Box or Draft Hood	Chimney or Vent Connector
A. Listed automatically fired, forced air or gravity system, with 250°F (121°C) temperature limit control.					
Burning Liquid Fuel	2 ⁶	6	24	18	18
Burning Gas Fuel	2 ⁶	6	18	6	6
Utilizing Electricity.....	2 ⁶	6	18	—	—
B. Unlisted automatically fired, forced air or gravity system, with temperature limit control that cannot be set higher than 250°F (121°C).					
Burning Liquid Fuel	6	6	24	18	18
Burning Gas Fuel	6	6	18	18 ⁴	18 ⁴
Utilizing Electricity.....	6	6	18	—	—
C. Steam or Hot Water Heat Exchanger—Steam not over 15 psi (103 kPa) pressure and hot water not more than 250°F (121°C).					
D. Automatically stoker fired, forced air system equipped with 250°F (121°C) temperature limit control and with a barometric draft control in accordance with Note 2.	2	2	2	—	—
Burning Solid Fuel	6	6	48	18	18
E. Heating Boilers Used in Central Warm Air Heating Systems — Steam boiler operating at not over 15 psi (103 kPa) gauge pressure and hot water boilers operating at not in excess of 250°F (121°C) of the water-wall type or having a jacket or lining of masonry or other satisfactory material.					
Burning Liquid Fuel	6 ³	6	24	18	18
Burning Gas Fuel.....	6 ³	6	18	9 ³	9 ³
Burning Solid Fuel	6 ³	6	48	18	18
Utilizing Electricity.....	6 ³	6	18	—	—
F. Furnaces and Heating Boilers Used in Central Warm Air Heating systems, other than above.					
Burning Liquid Fuel	18	18	48	18	18
Burning Gas Fuel	18	18	18	18 ⁴	18 ⁴
Burning Solid Fuel	18	18	48	18	18
G. Solar Energy Heat Exchangers operating at a temperature not in excess of 250°F (121°C).	2 ⁷	2 ⁷	2 ⁷	—	—

Notes for Table 3-1.3:¹ Front clearance shall be sufficient for servicing the burner and furnace or boiler.² Barometric draft control operated by draft intensity and permanently set to limit the draft to a maximum intensity of 0.13 in. (32.4 Pa) of water gage.³ This clearance may be reduced to 6 in. (152 mm) for listed gas burning furnaces and boilers.⁴ For unlisted gas appliances equipped with an approved draft hood, this clearance may be reduced to 9 in. (229 mm).⁵ This clearance is above top of boiler.⁶ This clearance may be reduced to 1 in. (25.4 mm) for a listed forced air or gravity furnace equipped with a limit control that will limit outlet air temperatures to 200°F (93°C).⁷ This clearance also applies to ducts from solar collectors to heat exchangers or thermal storage systems.**3-1.4 Clearances from Furnaces, Boilers, Heat Exchangers, Heat Pumps, and Cooling Units.**

3-1.4.1 Minimum clearances from furnaces, boilers, heat exchangers and their flue box, draft hood, or chimney or vent connectors installed in rooms that are large in comparison with the size of the appliance shall be as given in Table 3-1.3.

Exception: As provided in 3-1.1 and 3-1.4.2.

3-1.4.2 Heating furnaces and boilers used in residence-type central warm air heating systems may be installed in rooms that are large in comparison with the size of the

appliance with clearances reduced as designated in Table 3-1.4 where combustible material is protected in the manner specified. Such reductions shall not apply to installations in alcoves or closets.

3-1.4.3 Furnaces and boilers used in residence-type central warm air heating systems shall not be installed in a confined space such as an alcove or closet.

Exception: Furnaces and boilers specifically approved for such installations, when installed in compliance with the approval and with the clearances from the walls and ceiling of the alcove or closet not less than specified, regardless of the type of construction.

Table 3-1.4 Reduction of Clearances with Specified Forms of Protection

Type of Protection	Where the required clearance with no protection from appliance, vent connector, single wall metal pipe is:									
	36 inches		18 inches		12 inches		9 inches		6 inches	
Allowable Clearance with Specified Protection, inches:										
	Sides & Rear	Above	Sides & Rear	Above	Sides & Rear	Above	Sides & Rear	Above	Sides & Rear	Above
Applied to and covering all surfaces of combustible material within the distance specified as the required clearance with no protection.	Above		Above		Above		Above		Above	
(a) 3 1/2 in. thick masonry wall without ventilated air space	—	24	—	12	—	9	—	6	—	5
(b) 1/2 in. insulation board over 1 in. glass fiber or mineral wool batts	24	18	12	9	9	6	6	5	4	3
(c) 0.024 in. (24 gauge) sheet metal over 1 in. glass fiber or mineral wool batts reinforced with wire on rear face, with ventilated air space	18	12	9	6	6	4	5	3	3	3
(d) 3 1/2 in. thick masonry wall with ventilated air space	—	12	—	6	—	6	—	6	—	6
(e) 0.024 in. (24 gauge) sheet metal with ventilated air space	18	12	9	6	6	4	5	3	3	2
(f) 1/2 in. insulation board with ventilated air space	18	12	9	6	6	4	5	3	3	3
(g) 0.024 in. (24 gauge) sheet metal with ventilated air space over 0.024 in. (24 gauge) sheet metal with ventilated air space	18	12	9	6	6	4	5	3	3	3
(h) 1 in. glass fiber or mineral wool batts sandwiched between two sheets 0.024 in. (24 gauge) sheet metal with ventilated air space	18	12	9	6	6	4	5	3	3	3

Notes for Table 3-1.4:

NOTE 1: Reduction of clearances from combustible materials shall not interfere with combustion air, draft hood clearance and relief, and accessibility of servicing.

NOTE 2: All clearances shall be measured from the outer surface of the combustible material to the nearest point on the surface of the appliance, disregarding any intervening protection applied to the combustible material.

NOTE 3: Spacers and ties shall be of noncombustible material. No spacer or tie shall be used directly opposite an appliance or connector.

NOTE 4: With all clearance reduction systems using a ventilated air space, adequate provision for air circulation shall be provided as described. [See Figures 3-1.4(b) and (c).]

NOTE 5: There shall be at least 1 in. (25 mm) clearance between reduction system and combustible walls and ceilings for reduction systems using ventilated air space.


NOTE 6: If a wall protector is mounted on a single flat wall away from corners, adequate air circulation may be provided by leaving only the bottom and top edges, or only the side and top edges open, with at least 1 in. (25 mm) air gap.

NOTE 7: Mineral wool batts (blanket or board) shall have a minimum density of 8 lb/ft³ (128 kg/m³) and a minimum melting point of 1500°F (816°C) >

NOTE 8: Insulation material used as part of clearance reduction system shall have a thermal conductivity of 1.0 (Btu-in.)/(sq ft-hr-°F) or less.

NOTE 9: There shall be at least 1 in. (25 mm) between the appliance and the protector. In no case shall the clearance between the appliance and the combustible surface be reduced below that allowed in the table.

NOTE 10: All clearances and thicknesses are minimum; larger clearances and thicknesses are acceptable.

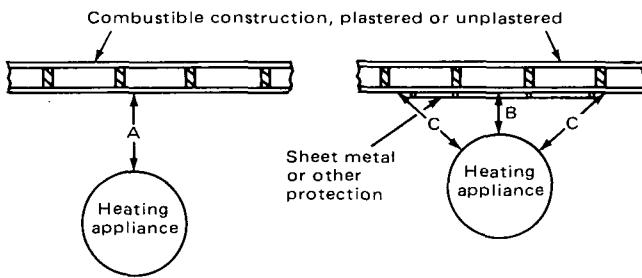


A equals the required clearance with no protection specified in Table 3-1.3. B equals the reduced clearance permitted in accordance with Table 3-1.4. The protection applied to construction using combustible material is required to extend far enough in each direction to make "C" equal to "A."

Figure 3-1.4(a) Sheet metal or other protection to reduce required clearance from heating appliance.

3-1.4.4 Cooling units, heat pumps, and equipment involving furnaces, boilers, or electric resistance heating shall not be installed in an attic or in any other space in the building construction used as a supply or return plenum.

Exception: Cooling units, heat pumps, and heating equipment may be installed in such a supply or return plenum when specifically approved for such use as a result of tests and listing by an approved testing laboratory. Such units or equipment shall be installed in accordance with the conditions of such approval.

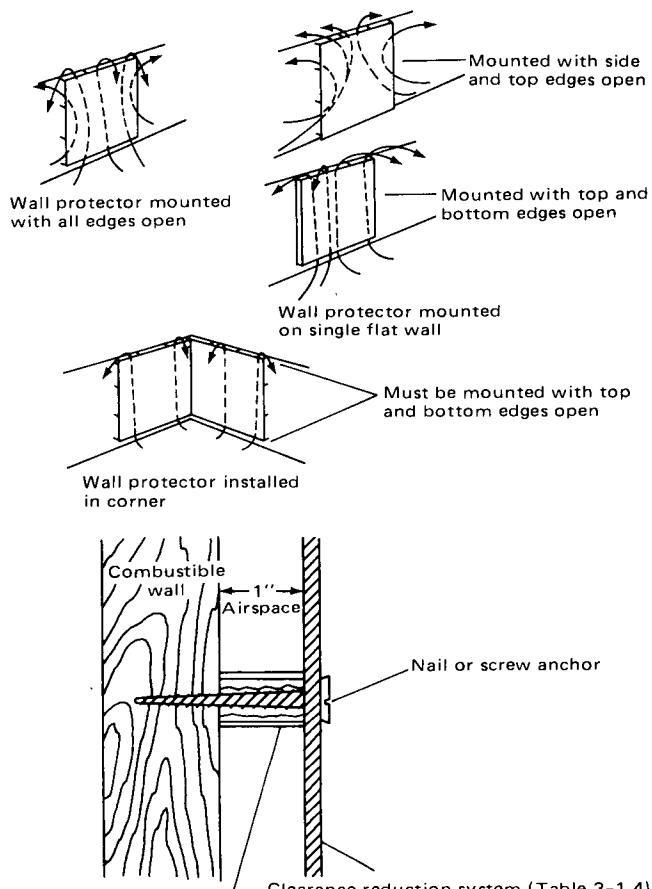

1" Noncombustible spacer such as stacked washers, small diameter pipe, tubing, or electrical conduit.

Masonry walls may be attached to combustible walls using wall ties.

Do not use spacers directly behind appliance or connector.


Figure 3-1.4(b) Wall protector clearance reduction system.

3-1.4.5 Furnaces, boilers, heat exchangers, heat pumps, solar energy system components, and air conditioning and cooling units shall be installed so as to provide reasonable accessibility for cleaning heating surfaces, removing and replacing burners, motors, compressors, controls, air filters, draft regulators, and other working parts and for adjusting, cleaning, and lubricating parts requiring such attention.

3-2 Firestopping.

3-2.1 Where the installation of ducts in walls, floors, or partitions requires the removal of any firestopping, the spaces around the duct at such points where firestopping was removed shall be sealed with noncombustible insulating material.

3-2.2 Where spaces between studs in walls or partitions are used as return ducts, the portions of such spaces so used shall be cut off from all remaining unused portions by tight-fitting stops of sheet metal or of wood not less than 2 in. (51 mm) (nominal) thickness. Such spaces shall not be used as a supply duct.

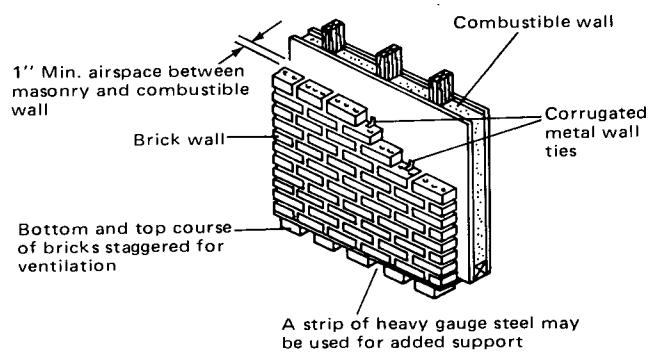

NOTE: Do not place masonry wall ties directly behind appliance or connector



Figure 3-1.4(c) Masonry clearance reduction system.

Chapter 4 Equipment, Wiring, and Controls

4-1 Equipment.

4-1.1 Heating Panels.

4-1.1.1 Air chambers having one or more external surface designed for use as heating panels shall be used only with:

(a) Automatically fired gas or oil burning forced warm air systems equipped with temperature limit controls that will limit furnace outlet air temperature to 200°F (93°C), or,

(b) Forced warm air systems equipped with heat exchangers utilizing steam that cannot exceed 15 lb (103 kPa) gauge pressure or hot water that cannot exceed a temperature of 250°F (121°C).

4-1.1.2 Connection. Heating panels shall be connected to supply and return air ducts conforming to this standard.

4-1.1.3 Construction.

(a) Where warm air supply is from a warm air furnace, heating panels shall be enclosed on all sides with material that is wholly noncombustible or that possesses a flame spread classification of not over 25 as determined in accordance with NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*. This enclosing material shall be securely attached to the building structure; joints and seams shall be substantially airtight. Braces and hangers inside the chamber shall be noncombustible.

(b) Where warm air supply is from a steam or hot water heat exchanger, heating panels shall either comply with 4-1.1.3(a) or shall be enclosed on all sides with material not more flammable than 1-in. (25.4-mm) (nominal) wood

boards. This enclosing material shall be securely attached to the building structure; joints and seams shall be substantially airtight. No single vertical heating panel shall serve more than one story.

4-1.2 Down-Flow Systems.

4-1.2.1 General. Down-flow heating equipment shall be designed or equipped so that the outlet air temperature will not exceed 200°F (93°C).

Exception: For systems installed under the provisions of 2-3.7, the outlet air temperature shall be limited to 165°F (74°C).

4-1.2.2 Equipment shall be designed to prevent unsafe temperature in event of reverse flow or fan failure.

4-1.3 Air Filters.

4-1.3.1 Air filters shall have either a Class 1 or Class 2 rating in accordance with UL 900, *Standard for Test Performance of Air Filter Units*.

4-1.3.2 An evaporative cooler containing a combustible filter and water evaporation medium, such as excelsior, shall not be used.

4-1.3.3 Liquid adhesive coatings used on filters shall have a flash point not less than 325°F (163°C), per ASTM D93, *Test for Flashpoint by Pensky-Martens Closed Tester*.

4-1.4 Air Cooling Equipment. Mechanical refrigeration used with air duct systems shall be installed in accordance with ANSI/ASHRAE 15, *Safety Code for Mechanical Refrigeration*.

4-1.4.1 Evaporative coolers containing a combustible evaporating medium, such as excelsior, shall not be used. This does not preclude the use of evaporation media meeting the requirements of 4-1.3.1.

4-1.5 Furnaces Used with Cooling Units.

4-1.5.1 Combination units in which a refrigeration coil is provided shall have the refrigeration coil located downstream from the heating furnace, or the coil shall be located parallel to the heating furnace.

Exception: Where the heating furnace is specifically approved for installation downstream from the coil.

4-1.5.1.1 Where the heating furnace is located upstream from the coil, the coil shall be designed or equipped so as not to develop excessive temperatures or pressures. In those cases where the coil is located parallel to the heating furnace, dampers or other means used to control flow of air shall be adequate to prevent chilled air from entering the furnace section. If the dampers are manually operated, means shall be provided to prevent operation of either unit unless the damper is in the full heat or cool position. Adequate means shall be provided for disposal of condensate and to prevent dripping of condensate on the heating element.

4-1.5.2 Furnaces (including duct furnaces) may be installed downstream from evaporative coolers or air washers provided that condensate will not fall into any portion

of burners, pilots, or burner carry-over arms and provided that the heating element is made of corrosion-resistant material, such as stainless steel, ceramic-coated steel, or an aluminum-coated steel in which the bond between the steel and the aluminum is an iron-aluminum alloy. Air washers operating with chilled water that delivers air below the dew point of the ambient air at the appliance are considered as refrigeration systems.

4-1.5.3 The capacity of the blower shall be adequate to overcome the external static resistance imposed by the combined heating and cooling units at the air throughput required for heating or cooling, whichever is greater.

4-1.6 Boilers Used with Cooling Units.

4-1.6.1 Where the same coil is used for both heating and cooling, valves shall be provided to prevent chilling of the boiler during the operation of the cooling system.

4-1.6.2 Where hot water heating boilers are connected to heating coils located in air handling units where they may be exposed to refrigerated air circulation, such boiler piping systems shall be equipped with flow control valves or other automatic means to prevent gravity circulation of the boiler water during the cooling cycle.

4-1.7 Heat Pump Systems. Heat pump systems involving units or equipment installed in attics or in a space in the building construction used as a supply or return plenum shall conform to the appropriate provisions of 2-3.7 and 3-1.4.

4-1.8 Solar Systems.

4-1.8.1 Solar systems or solar assisted systems shall be designed, constructed, and controlled so that the air temperature in the supply system shall not exceed 250°F (121°C).

4-1.8.2 A flammable or combustible heat transfer fluid from a solar energy system shall not be used in a heat exchanger located in a duct system.

4-2 Electric Wiring and Equipment. Electric wiring and equipment shall be adequate for safe operation and shall be installed in accordance with NFPA 70, *National Electrical Code*.[®] In addition, a disconnecting means shall be installed within sight and easy reach in the ungrounded leads of each power circuit to electrically operated components that are in unprotected locations and in other locations not readily accessible for service.

4-3 Controls.

4-3.1 Temperature Limit Controls. Temperature limit controls shall be of a listed type and shall be such that they cannot be set higher than the specified temperature setting and shall be located no more than 2 ft (0.61 m) downstream from the heat exchanger.

4-3.2 Fan Control for Stoker-Fired Furnaces. Where a warm air furnace equipped with a fan to circulate the air is stoker-fired it shall also be equipped with an automatic

over-run control to start the fan when the air in the furnace bonnet or at the beginning of the main supply duct at a point not affected by radiated heat reaches a temperature not higher than 200°F (93°C) after the stoker and fan (in its normal operation) have been shut down as a result of a satisfied thermostat. If a manual disconnect is installed in the air circulating fan electrical circuit, it shall be so installed as to deenergize simultaneously both the fan and the stoker.

4-3-3 Air for Combustion and Ventilation. Heating appliances shall be installed in a location in which the facilities for ventilation permit satisfactory combustion and proper ventilation under normal conditions of operation and use. (See NFPA 31, *Standard for the Installation of Oil-Burning Equipment*, and NFPA 54, *National Fuel Gas Code*.)

4-3-4 Thermostatically Controlled Hand-Fired Solid Fuel Burning Furnaces. Hand-fired solid fuel burning furnaces on which the furnace draft is controlled by a thermostat shall be equipped with (1) a fail-safe 250°F (121°C) limit control installed not more than 10 in. (254 mm) above the top surface of the heat exchanger in a supply plenum that extends at least 12 in. (305 mm) above the top surface of the heat exchanger, and (2) a barometric draft control operated by draft intensity and permanently set to limit the draft to a maximum intensity of 0.13 in. (32.4 Pa) of water gage. By a fail safe limit control is meant one that will automatically check the furnace in the event of power failure or shut off or that will automatically check the furnace when 250°F (121°C) temperature is reached whether or not power is then available.

4-3-5 Air Circulating Fan Controls. Where a hand-fired solid fuel burning furnace is equipped with a fan to circulate the air, it shall be equipped with fan controls as required for stoker-fired furnaces by 4-3-2.

4-3-6 Accessory Equipment. Material used in the construction of accessory equipment attached to or installed in a supply or return system shall comply with the requirements for the materials of that portion of the system to which it is attached. This shall not preclude the attachment to a plenum or duct of small devices, such as humidifiers, specifically listed for such use. Motors and electrical wiring and equipment shall comply with Section 4-2.

Chapter 5 Referenced Publications

5-1 The following documents or portions thereof are referenced within this standard and shall be considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

5-1-1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 31, *Standard for the Installation of Oil-Burning Equipment*, 1992 edition

NFPA 54, *National Fuel Gas Code*, 1992 edition

NFPA 70, *National Electrical Code*, 1993 edition

NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*, 1990 edition

NFPA 701, *Standard Methods of Fire Tests for Flame-Resistant Textiles and Films*, 1989 edition

5-1.2 Other Publications.

5-1.2.1 ANSI/ASHRAE Publication. American National Standards Institute, 1430 Broadway, New York, NY 10018.

ANSI/ASHRAE 15-1978, *Safety Code for Mechanical Refrigeration*

5-1.2.2 ASTM Publications. American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.

ASTM C411-1982, *Test for Hot-Surface Performance of High-Temperature Thermal Insulation*

ASTM D93-1985, *Test for Flashpoint by Pensky-Martens Closed Tester*

ASTM E136-1982, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*

5-1.2.3 SMACNA Publications. Sheet Metal and Air Conditioning Contractors' National Association, Inc., 4201 Lafayette Center Drive, Chantilly, VA 22021-1209.

Fibrous Glass Duct Construction Standards, Fifth Edition, 1979

HVAC Duct Construction Standards, First Edition, 1985

Installation Standards for Residential Heating and Air Conditioning Systems, Sixth Edition, 1985

5-1.2.4 UL Publications. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062.

UL 94-1980, *Tests for Flammability of Plastic Materials for Parts in Devices and Appliances*

UL 181-1981, *Standard for Factory-Made Air Ducts and Connectors*

UL 900-1987, *Standard for Test Performance of Air Filter Units*

Appendix A Referenced Publications

A-1 The following documents or portions thereof are referenced within this standard for informational purposes only and thus are not considered part of the requirements of this document. The edition indicated for each reference is the current edition as of the date of the NFPA issuance of this document.

A-1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 90A, Standard for the Installation of Air Conditioning and Ventilating Systems, 1993 edition

NFPA 91, Standard for the Installation of Blower and Exhaust Systems for Dust, Stock, and Vapor Removal or Conveying, 1992 edition

NFPA 96, Standard for the Installation of Equipment for the Removal of Smoke and Grease-Laden Vapors from Commercial Cooking Equipment, 1991 edition

A-1.2 Other Publication.

Building Materials Directory, Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062

Index

©1993 National Fire Protection Association, All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document which it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

-A-

Air connectors	2-1.2
Air cooling equipment	4-1.4
Air filters	4-1.3
Definition	1-3

-B-

Boilers	
Clearance from	3-1.4
Used with cooling units	4-1.6
Boots	
Clearance from	3-1.4
Used with cooling units	4-1.6
Building construction, fire integrity of	3-1

-C-

Central warm air heating system	
Definition	1-3
Clearances to combustible materials	3-1, Table 3-1.3
Furnaces, boilers, heat exchangers, heat pumps, and cooling units	3-1.4, Figs. 3-1.4(a) thru (c), Table 3-1.4
Horizontal supply ducts	3-1.4, Figs. 3-1.4(a) and (b)
Masonry, reduction system	Fig. 3-1.4(c)
Reduction of, with specified forms of protection	Table 3-1.4
Vertical ducts, risers, boots, and register boxes	3-1.3
Combustible materials	
Clearances to	3-1, Table 3-1.3
Definition	1-3
Combustion, air for	4-3.3
Construction	
Building	3-1
Equipment	4-1.1.3
Controls	4-3
Accessory equipment	4-3.6
Air for combustion and ventilation	4-3.3
Fan	4-3.2, 4-3.5
Temperature limit	4-3.1
Cooling units	
Boilers used with	4-1.6
Clearance from	3-1.4
Furnaces used with	4-1.5
Corridors, public	2-2.4

-D-

Down-flow systems	4-1.2
Duct coverings	2-3.1
Definition	1-3
Duct hangers	2-3.3
Duct linings	2-3.1
Definition	1-3
Duct materials	
Return systems	2-2
Supply systems	2-1.1
Duct openings	2-2.2
Ducts	
Continuous (return system)	2-2.3
Horizontal supply, clearances from	3-1.2
Registers for	2-3.5
Return	2-2
Sheet metal, thickness of	Table 2-1.1
Supply	2-1.1.1, 2-1.1.2
Horizontal, clearance from	3-1.2
Vertical	
Clearances from	3-1.3
Protection of	2-2.2, 2-3.4

-E-

Electric wiring and equipment	4-2
Equipment	4-1
Accessory	4-3.6
Electric	4-2

-F-

Fans, circulating	
Controls	4-3.5
Negative pressure from	2-2.5
Filters, air	see Air filters
Fire integrity of building construction	Chap. 3
Firestopping	3-2
Forced air system	
Definition	1-3
Furnaces	
Clearances from	3-1.4
Stoker-fired, fan control for	4-3.2
Thermostatically controlled hand-fired solid fuel burning	4-3.4
Used with cooling units	4-1.5

Gravity systems	-G-	Purpose of standard 1-2
Definition		1-3
Heat exchangers	-H-	
Clearance from		3-1.4
Definition		1-3
Heat pump systems		4-1.7
Heat pumps		
Clearances from		3-1.4
Definition		1-3
Systems		4-1.7
Heating panels		4-1.1
Connection of		4-1.1.2
Construction of		4-1.1.3
Joints 2-3.2, Fig. 2-3.2	-J-	
Noncombustible material	-N-	
Definition		1-3
Plenums	-P-	
Definition		1-3
Registers for		2-3.5
Return, use of concealed ceiling space as		2-3.7
Supply		2-1.3
Use of concealed ceiling space for		2-3.7
Use of under floor space as		2-1.4, 2-2.3.2
Pumps, heat see Heat pumps		
Registers	-R-	
Clearance from		3-1.3
Ducts and plenums		2-3.5
Pipeless furnace		2-3.6
Return systems		
Common requirements		2-3
Components		2-2
Definition		1-3
Risers, clearance from 3-1.3		
Rooms, large in comparison with the size of the appliance		
Definition		1-3
Scope of standard 1-1	-S-	
Solar systems 4-1.8		
Supply systems		
Components		2-1
Definition		1-3
System components Chap. 2		
Temperature limit controls see Controls, temperature limit	-T-	
Ventilation, air for 4-3.3	-V-	
Wiring see Electric wiring	-W-	

Sequence of Events Leading to Publication of an NFPA Committee Document

Call for proposals to amend existing document or for recommendations on new document.



Committee meets to act on proposals, to develop its own proposals, and to prepare its report.



Committee votes on proposals by letter ballot. If two-thirds approve, report goes forward. Lacking two-thirds approval, report returns to committee.



Report is published for public review and comment. (Report on Proposals - ROP)



Committee meets to act on each public comment received.



Committee votes on comments by letter ballot. If two-thirds approve, supplementary report goes forward. Lacking two-thirds approval, supplementary report returns to committee.



Supplementary report is published for public review. (Report on Comments - ROC).



NFPA membership meets (Annual or Fall Meeting) and acts on committee report (ROP and ROC).



Committee votes on any amendments to report approved at NFPA Annual or Fall Meeting.



Complaints to Standards Council on Association action must be filed within 20 days of the NFPA Annual or Fall Meeting.



Standards Council decides, based on all evidence, whether or not to issue standard or to take other action, including hearing any complaints.



Appeals to Board of Directors on Standards Council action must be filed within 20 days of Council action.

FORM FOR PROPOSALS ON NFPA TECHNICAL COMMITTEE DOCUMENTS

Mail to: Secretary, Standards Council

National Fire Protection Association, 1 Batterymarch Park, Quincy, Massachusetts 02269-9101

Fax No. 617-770-3500

Note: All proposals must be received by 5:00 p.m. EST/EDST on the published proposal-closing date.

If you need further information on the standards-making process, please contact the Standards Administration Department at 617-984-7249.

Date 9/18/93 Name John B. Smith Tel. No. 617-555-1212

Company _____

Street Address 9 Seattle St., Seattle, WA 02255

Please Indicate Organization Represented (if any) Fire Marshals Assn. of North America

1. a) NFPA Document Title National Fire Alarm Code NFPA No. & Year NFPA 72, 1993 ed.

b) Section/Paragraph 1-5.8.1 (Exception No.1)

2. Proposal recommends: (Check one) new text
 revised text
 deleted text

FOR OFFICE USE ONLY

Log # _____

Date Rec'd _____

3. Proposal (include proposed new or revised wording, or identification of wording to be deleted):

Delete exception.

SAMPLE

4. Statement of Problem and Substantiation for Proposal: (Note: State the problem that will be resolved by your recommendation; give the specific reason for your proposal including copies of tests, research papers, fire experience, etc. If more than 200 words, it may be abstracted for publication.)

A properly installed and maintained system should be free of ground faults. The occurrence of one or more ground faults should be required to cause a "trouble" signal because it indicates a condition that could contribute to future malfunction of the system. Ground fault protection has been widely available on these systems for years and its cost is negligible. Requiring it on all systems will promote better installations, maintenance and reliability.

5. This Proposal is original material. (Note: Original material is considered to be the submitter's own idea based on or as a result of his/her own experience, thought, or research and, to the best of his/her knowledge, is not copied from another source.)

This Proposal is not original material; its source (if known) is as follows: _____

Note 1: Type or print legibly in black ink.

Note 2: If supplementary material (photographs, diagrams, reports, etc.) is included, you may be required to submit sufficient copies for all members and alternates of the technical committee.

I hereby grant NFPA the non-exclusive, royalty-free rights, including non-exclusive, royalty-free rights in copyright, in this proposal and I understand that I acquire no rights in any publication of NFPA in which this proposal is used or another similar analogous form is used.


John B. Smith
Signature (Required)

PLEASE USE SEPARATE FORM FOR EACH PROPOSAL