



UL 2586B

STANDARD FOR SAFETY

Hose Nozzle Valves for Diesel Fuel, Biodiesel Fuel, Diesel/Biodiesel Blends with Nominal Biodiesel Concentrations up to 20 Percent (B20), Kerosene, and Fuel Oil

ULNORM.COM : Click to view the full PDF of UL 2586B 2020

ULNORM.COM : Click to view the full PDF of UL 2586B 2020

UL Standard for Safety for Hose Nozzle Valves for Diesel Fuel, Biodiesel Fuel, Diesel/Biodiesel Blends with Nominal Biodiesel Concentrations up to 20 Percent (B20), Kerosene, and Fuel Oil, UL 2586B

First Edition, Dated February 20, 2015

Summary of Topics

This revision of ANSI/UL 2586B dated June 3, 2020 adds renewable diesel to the scope of the standard; [1.2](#)

Text that has been changed in any manner or impacted by UL's electronic publishing system is marked with a vertical line in the margin.

The revised requirements are substantially in accordance with Proposal(s) on this subject dated January 31, 2020.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 2586B 2020

FEBRUARY 20, 2015
(Title Page Reprinted: June 3, 2020)



ANSI/UL 2586B-2020

1

UL 2586B

**Standard for Hose Nozzle Valves for Diesel Fuel, Biodiesel Fuel,
Diesel/Biodiesel Blends with Nominal Biodiesel Concentrations up to 20
Percent (B20), Kerosene, and Fuel Oil**

Prior to the first edition, the requirements for the products covered by this standard were included in the Outline of Investigation for Hose Nozzle Valves for Diesel Fuel, Biodiesel Fuel, Diesel/Biodiesel Blends with Nominal Biodiesel Concentrations up to 20 Percent (B20), Kerosene, and Fuel Oil, UL 2586B.

First Edition

February 20, 2015

This ANSI/UL Standard for Safety consists of the First Edition including revisions through June 3, 2020.

The most recent designation of ANSI/UL 2586B as an American National Standard (ANSI) occurred on June 3, 2020. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, and Title Page.

Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL's On-Line Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

UL's Standards for Safety are copyrighted by UL. Neither a printed nor electronic copy of a Standard should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

COPYRIGHT © 2020 UNDERWRITERS LABORATORIES INC.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 2586B 2020

CONTENTS

INTRODUCTION

| | | |
|-----|----------------------------|---|
| 1 | Scope | 5 |
| 2 | General | 6 |
| 2.1 | Components | 6 |
| 2.2 | Units of measurement | 6 |
| 2.3 | Undated references | 6 |
| 3 | Glossary | 6 |

CONSTRUCTION

| | | |
|-----|--------------------------------------|----|
| 4 | Assembly | 7 |
| 4.1 | General | 7 |
| 4.2 | Hose nozzle valves | 7 |
| 5 | Materials | 8 |
| 5.1 | Metallic materials | 8 |
| 5.2 | Nonmetallic materials | 9 |
| 5.3 | Casting impregnation materials | 12 |
| 5.4 | Internal parts | 12 |
| 6 | Bodies and Covers | 12 |
| 7 | Diaphragms | 14 |
| 8 | Springs | 14 |
| 9 | Operating Mechanisms | 14 |

PERFORMANCE

| | | |
|------|---|----|
| 10 | General | 14 |
| 11 | Deformation Test | 15 |
| 12 | Long Term Exposure Test | 16 |
| 12.1 | General | 16 |
| 12.2 | Samples | 16 |
| 12.3 | Method | 16 |
| 12.4 | Results | 17 |
| 13 | External Leakage Test | 17 |
| 14 | Hose Nozzle Valve Guard Strength Test | 18 |
| 15 | Operation Test | 19 |
| 15.1 | Automatic hose nozzle valve | 19 |
| 15.2 | Bellows secondary shut off operation | 20 |
| 16 | Pull Test | 20 |
| 17 | Sensitivity Test | 20 |
| 18 | Hose Nozzle Endurance Test | 21 |
| 19 | Bellows Secondary Shut Off Operation Test | 21 |
| 20 | Visible Discharge Indicator Tests | 21 |
| 20.1 | Thermal shock test | 21 |
| 20.2 | Drop test | 21 |
| 21 | Hydrostatic Strength Test | 22 |
| 22 | Electrical Continuity Test | 22 |
| 23 | Salt Spray Test | 22 |
| 24 | Moist Ammonia-Air Stress Cracking Test | 23 |
| 25 | Marking Adhesion Test | 23 |

MANUFACTURING AND PRODUCTION

| | | |
|----|---------------|----|
| 26 | General | 24 |
|----|---------------|----|

INSTALLATION INSTRUCTIONS

| | | |
|----|---------------|----|
| 27 | General | 24 |
|----|---------------|----|

MARKING

| | | |
|----|---------------|----|
| 28 | General | 24 |
|----|---------------|----|

SUPPLEMENT SA – Test Fluids

| | | |
|------|---|----|
| SA.1 | Representative aggressive combustible test fuel mixtures..... | 27 |
|------|---|----|

ULNORM.COM : Click to view the full PDF of UL 2586B 2020

INTRODUCTION

1 Scope

1.1 These requirements cover hose nozzle valves that are intended to be used for the control of motor fuels as indicated in 1.2. They are of the type used in motor fuel dispensing equipment. Hose nozzle valves covered by this standard are for use with motor fuels which are handled at temperatures within the range of minus 29°C (minus 20°F) to 52°C (125°F) and an operating pressure of minimum 50 psi (350 kPa).

1.2 Hose nozzle valves covered by these requirements are intended for use with one or more of the following as applicable:

- a) Diesel fuel, which includes renewable diesel, and diesel/biodiesel blends with nominal biodiesel concentrations up to 5 percent (B0 – B5) formulated in accordance with the Standard Specification for Diesel Fuel Oils, ASTM D975;
- b) Diesel /biodiesel and renewable diesel/biodiesel blends with nominal biodiesel concentrations from 5 percent up to 20 percent (B6 – B20) formulated in accordance with the Standard Specification for Diesel Fuel Oil, Biodiesel Blends (B6 – B20), ASTM D7467;
- c) Biodiesel (B99.9/B100) formulated in accordance with the Standard Specification for Biodiesel Fuel Blend Stock (B100) for Middle Distillate Fuels, ASTM D6751;
- d) Kerosene formulated in accordance with the Standard Specification for Kerosine, ANSI/ASTM D3699; or
- e) Fuel oil (heating oil) formulated in accordance with the Standard Specification for Fuel Oils, ASTM D396.

1.3 These requirements cover hose nozzle valves of the manually operated and automatic pressure operated type. When they form a part of an assembly which provides for additional functions or service, the requirements are outside the scope of these requirements.

1.4 When they form a part of an assembly which provides for additional functions or service, the requirements are outside the scope of these requirements.

1.5 These requirements do not cover the following:

- a) Hose nozzle valves for handling liquids under cryogenic conditions.
- b) Hose nozzle valves for general refinery service, offshore and pipe line terminals, natural gas processing plants, gas distribution systems, petrochemical processing facilities, or the like.
- c) Hose nozzle valves operated wholly or partially by electricity or battery.

1.6 This standard does not cover hose nozzle valves for use with gasoline or gasoline/ethanol blends which are covered under the Standard for Hose Nozzle Valves for Gasoline and Gasoline/Ethanol Blends with Nominal Ethanol Concentrations up to 85 Percent (E0 – E85), UL 2586A.

1.7 This standard does not cover hose nozzle valves for use with liquefied petroleum gas (LP-Gas), which are covered under the Standard for Flow Control Valves for Anhydrous Ammonia and LP-Gas, UL 125.

1.8 Requirements for the installation and use of these dispensing devices are included in the Code for Motor Fuel Dispensing Facilities and Repair Garages, ANSI/NFPA 30A.

2 General

2.1 Components

2.1.1 Except as indicated in [2.1.2](#), a component of a product covered by this standard shall comply with the requirements for that component.

2.1.2 A component is not required to comply with a specific requirement that:

a) Involves a feature or characteristic not required in the application of the component in the product covered by this standard, or

b) Is superseded by a requirement in this standard.

2.1.3 A component shall be used in accordance with its rating established for the intended conditions of use.

2.1.4 Specific components are incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions.

2.1.5 A hose nozzle valve with an integral swivel shall be additionally evaluated to the Electrical-Continuity and Operation Tests in the Standard for Emergency Breakaway Fittings, Swivel Connectors and Pipe-Connection Fittings for Diesel Fuel, Biodiesel Fuel, Diesel/Biodiesel Blends with Nominal Biodiesel Concentrations up to 20 Percent (B20), Kerosene, and Fuel Oil, UL 567B. The force is to be applied at the point on the swivel farthest from the joint. When necessitated by the swivel construction, this test is to be conducted on additional samples of the swivel with the load applied on the opposite side of the plane of rotation. See UL 567B, Figures 16.1 – 16.3 for examples.

2.2 Units of measurement

2.2.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information.

2.3 Undated references

2.3.1 Any undated reference to a code or standard appearing in the requirements of this standard shall be interpreted as referring to the latest edition of that code or standard.

3 Glossary

3.1 For the purpose of this standard, the following definitions apply.

3.2 DIESEL/BIODIESEL BLENDS – Blended fuels composed of a diesel component and a biodiesel component. The numerical value corresponding to the biodiesel component determines the blend rating (such as B20 for 20% biodiesel, 80% diesel).

3.3 HOSE NOZZLE VALVE, AUTOMATIC – A hose nozzle valve which is held open during the entire filling operation. It may be held open by manual force or by an integral hold-open or latching device. It incorporates a mechanism that shuts off the flow of liquid during refueling operations to prevent overflow from the fill opening when liquid reaches a predetermined point on the spout.

3.4 HOSE NOZZLE VALVES – A self-closing device designed to control the flow of flammable and combustible liquids at an operating pressure of minimum 50 psi (345 kPa). It is intended for use at the outlet end of a hose for dispensing flammable liquids.

3.5 HOSE NOZZLE VALVE, MANUALLY OPERATED – A hose nozzle valve that is manually held open during the entire filling operation and closes only upon release of the manual force.

3.6 HOSE NOZZLE VALVE, VAPOR RECOVERY – A system constructed to capture vapors displaced during filling operations. The vapors are not processed during the course of this activity.

a) Assist Nozzle – A vacuum or pump is used to draw the vapors back to tank.

b) Balance Nozzle – Displacement of vapors from tank being fill forces the vapor back into the storage tank.

3.7 SEALS, DYNAMIC – A seal that is subject to mechanical movement or other applied forces that result in movement or flexing of the seal under normal use conditions.

3.8 SEALS, STATIC – A seal that is not subject to mechanical movement or other applied forces other than compressing forces that are applied during installation, after which, the seal is held in place during normal use conditions.

CONSTRUCTION

4 Assembly

4.1 General

4.1.1 A hose nozzle valve shall include all of the components required for its intended function and installation.

4.1.2 A seat disc shall be attached to its poppet or holder or otherwise assembled so as to prevent it from becoming dislocated under service conditions as determined by the Hose Nozzle Endurance Test, Section [18](#). The means to secure the disc shall not rely upon cement or adhesive.

4.1.3 A brazing material used for joining liquid confining parts of a valve shall have a melting point (solidus temperature) of minimum 538°C (1000°F).

4.2 Hose nozzle valves

4.2.1 A hose nozzle valve shall be of the manually-operated or of the automatic type. A manually-operated valve requires the valve to be manually held open during the entire filling operation without the aid of hold-open devices or latches, but is capable of closing automatically. An automatic valve requires the valve to:

a) Be manually opened, but is capable of being held open during the filling operation by a latch or other device and

b) Is provided with automatic closing features.

Exception: A hose nozzle valve for use in salt water or boat yard environments shall be of the automatic closing type without a latch-open device.

4.2.2 Automatic hose nozzle valves equipped with an integral hold open or latching device shall be so designed that, if left in the latched position after the flow has been stopped by means other than the automatic feature of the hose nozzle, it shall automatically unlatch when it is returned to the dispenser, See Automatic hose nozzle valve, [15.1.2](#).

NOTE: This includes hose nozzle valves that close with a no pressure/no flow mechanism, as well as interlock hose nozzles valves that unlatch when removed from car fill pipe or when hung on the dispenser.

4.2.3 A hose nozzle valve shall be of the normally closed type. It shall be self-closing upon the manual or automatic release of the operating lever.

4.2.4 A guard shall be provided to guide or protect the free end of an operating lever and to prevent opening of the valve or damage to an operating part if the valve is dropped. A guard shall be of such strength as to permit operation of the valve subsequent to its being subjected to mechanical strength tests. See the Hose Nozzle Valve Guard Strength Test, Section [14](#).

4.2.5 An operating lever shall possess the strength required to resist bending or breaking when tested in accordance with these requirements. See the Hose Nozzle Endurance Test, Section [18](#).

4.2.6 The closing action of a hose nozzle valve shall be in the direction of fluid flow. A seat seal or valve disc shall consist of resilient material and shall provide proper seating of a disc.

4.2.7 A hose nozzle valve shall be equipped with a spout not exceeding 12 inches (305 mm) in length. Nozzles shall be of corrosion resistant material, such as brass, aluminum, or stainless steel.

4.2.8 A sand casting employed as a pressure confining part of a hose nozzle valve shall have a wall thickness of minimum 0.094 inch (2.38 mm).

4.2.9 The means for attaching a spout to an automatic valve body shall permit ready replacement of a spout with the use of ordinary hand tools.

4.2.10 A hose nozzle valve shall be constructed so as to provide electrical continuity from end to end across all joints so that when in use, continuity is provided for grounding of static charges. Such continuity shall be inherent in the construction and shall not be accomplished by a jumper wire. See the Electrical Continuity Test, Section [22](#).

4.2.11 A hose nozzle valve intended for use in salt water marine or boat yard environments shall be constructed so as to comply with the applicable construction and performance requirements except that the tests specified in Sections [14](#), [15](#), [17](#), [21](#), and [22](#) are to be conducted following exposure to a salt enriched atmosphere as described in [23.2](#) – [23.6](#).

Exception: A hose nozzle valve is not required to operate in accordance with the requirements of Section [15](#) when, due to accumulation of salt in the sensing port, the hose nozzle valve does not operate to deliver fluid.

5 Materials

5.1 Metallic materials

5.1.1 General

5.1.1.1 A metallic part, in contact with the fuels anticipated by these requirements, shall be resistant to the action of the fuel if degradation of the material will result in leakage of the fuel or if it will impair the function of the device. See the Long Term Exposure Test, Section [12](#).

5.1.1.2 The exposed surfaces of metallic parts shall be resistant to atmospheric corrosion if this corrosion will lead to leakage of the fluid or if it will impair the function of the device. The material shall comply with the requirements in Atmospheric corrosion, [5.1.2](#). A hose nozzle valve intended for use in salt water marine or boat yard environments shall be resistant to corrosion so as to comply with the requirements of the Salt Spray Test, Section [23](#).

5.1.1.3 Metallic parts in contact with the fuels anticipated by these requirements shall not be constructed of lead, or materials that are substantially lead. In addition, no coatings or platings containing lead shall be used, such as terne plated steel.

5.1.1.4 With reference to the above requirements, metallic parts include metallic materials used to form fluid confining parts as well as metallic coatings or plating that may be applied to a base material.

5.1.2 Atmospheric corrosion

5.1.2.1 Metallic materials used for fluid confining parts shall be resistant to atmospheric corrosion. In addition, metallic materials that are required to operate to address safety shall be resistant to atmospheric corrosion. Ferrous materials of the thickness specified in the following items are acceptable for the preceding when uncoated:

- a) A casting having a wall thickness of not less than 1/4 inch (6.4 mm) if shown by production test to be free from leakage;
- b) Standard pipe and fittings conforming to the Standard for Welded and Seamless Wrought Steel Pipe, ANSI/ASME B36.10M; and
- c) Fabricated sheet steel parts having a minimum wall thickness of 0.093 inch (2.36 mm).

5.1.2.2 A protective coating shall provide resistance against atmospheric corrosion to a degree not less than that provided by the protective coatings specified in [5.1.2.3](#).

5.1.2.3 Cadmium plating shall not be less than 0.0003 inch (0.008 mm) thick, and zinc plating shall not be less than 0.0005 inch (0.013 mm) thick, except on parts where threads constitute the major portion of the area in which case the cadmium or zinc plating shall not be less than 0.00015 inch (0.0038 mm) thick. Metallic parts are considered to comply with [5.1.2.1](#) when they are protected against atmospheric corrosion by:

- a) Hot dipped, mill galvanized sheet steel complying with the coating designation G90 in Table I of the Specification for Sheet Steel, Zinc Coated (Galvanized) or Zinc-Iron-Alloy Coated (Galvannealed) by the Hot Dip Process, ASTM A653/A653M, or
- b) Coatings which have been determined to be equivalent to G90 under the requirements of the Standard for Organic Coatings for Steel Enclosures for Outdoor Use Electrical Equipment, UL 1332.

5.1.2.4 A metallic material other than as described in [5.1.2.1](#) – [5.1.2.3](#) shall be painted or protected in a manner that has been determined to be equivalent.

5.2 Nonmetallic materials

5.2.1 General

5.2.1.1 A nonmetallic part in contact with the fuels anticipated by these requirements shall be resistant to the action of the fuel if degradation of the material will result in leakage of the fuel, or if it will impair the function of the device.

5.2.1.2 Gaskets or seals shall be designated as dynamic and/or static seals. See [3.7](#) and [3.8](#) respectively. If the type of seal cannot be determined, then the material shall be treated as both a static and a dynamic seal.

5.2.1.3 Gaskets and seals shall comply with the requirements as outlined in Nonmetallic materials – material level, [5.2.2](#), and Nonmetallic materials – system level, [5.2.3](#).

5.2.1.4 Nonmetallic materials in contact with the fuels anticipated by these requirements shall not be constructed of the following:

- a) Polysulfide rubber;
- b) Ethylene propylene diene monomer (EPDM) rubber;
- c) Methyl-Methacrylate;
- d) Polyvinyl Chloride (PVC);
- e) Nylon 6/6; or
- f) Polyurethane.

5.2.2 Nonmetallic materials – material level

5.2.2.1 Static seals

5.2.2.1.1 Static seals shall be evaluated in accordance with the Standard for Gaskets and Seals, UL 157, modified as indicated in [5.2.2.1.2](#) – [5.2.2.1.4](#). If a specific material complies with these requirements, the material can be considered to be qualified for system testing.

5.2.2.1.2 A static seal shall be constructed of a material that is acceptable in accordance with the scope of the Standard for Gaskets and Seals, UL 157.

5.2.2.1.3 Static seals shall be subjected to the Volume Change and Extraction Test in accordance with the Standard for Gaskets and Seals, UL 157, except for the following modifications:

- a) The test duration shall be 1000 hours;
- b) The applicable test fluids shall be as described in Supplement [SA](#); and
- c) For all materials, the average volume change shall not exceed 40% swell (increase in volume) or 1% shrinkage (decrease in volume). In addition, the weight loss shall not exceed 10%. For coated fabrics, alternate limits can be used with the average volume change not exceeding 60% swell or 5% shrinkage, and the weight loss shall not exceed 20%. There shall be no visual evidence of cracking or other degradation as a result of the exposure for any material including coated fabrics.

5.2.2.1.4 Static seals shall be subjected to the Compression Set Test in accordance with the Standard for Gaskets and Seals, UL 157, except for the following modifications:

- a) The test duration shall be 1000 hours.
- b) The samples shall be immersed, at room temperature, in the test fluids (see item c) while compressed for the entire test duration. No oven conditioning is required.
- c) The applicable test fluids shall be as described in Supplement [SA](#).

d) The recovery period shall consist of removing the sample from the compression device and immersing it in the applicable test fluid for 30 minutes at room temperature. The sample shall not be allowed to dry out due to exposure to air. The 30-minute immersion should use the same fluid as the test fluid for each sample.

e) For all materials, the average compressions set is calculated and shall not exceed 35 percent. For coated fabrics, alternate limits can be used with the average compression set not exceeding 70%.

Exception: This requirement does not apply to composite gasket materials as defined in accordance with the Standard for Gaskets and Seals, UL 157.

5.2.2.2 Dynamic seals

5.2.2.2.1 Dynamic seals shall be evaluated in accordance with the Standard for Gaskets and Seals, UL 157 modified as indicated in [5.2.2.2.2](#) – [5.2.2.2.4](#). If a specific material complies with these requirements, the material can be considered to be qualified for system testing.

5.2.2.2.2 A dynamic seal shall be constructed of a material that is acceptable in accordance with the scope of the Standard for Gaskets and Seals, UL 157.

5.2.2.2.3 Dynamic seals shall be subjected to the Volume Change and Extraction Test in accordance with the Standard for Gaskets and Seals, UL 157, except for the following modifications:

- a) The test duration shall be 1000 hours;
- b) The applicable test fluids shall be as described in Supplement [SA](#); and
- c) For all materials, the average volume change for a gasket or seal material shall not exceed 40% swell (increase in volume) or 1% shrinkage (decrease in volume). In addition, the weight loss shall not exceed 10%. For coated fabrics, alternate limits can be used with the average volume change not exceeding 60% swell or 5% shrinkage, and the weight loss shall not exceed 20%. There shall be no visual evidence of cracking or other degradation as a result of the exposure for any material including coated fabrics.

5.2.2.2.4 Dynamic seals shall be subjected to the Tensile Strength and Elongation Test in accordance with the Standard for Gaskets and Seals, UL 157, except for the following modifications:

- a) The test duration shall be 1000 hours;
- b) The applicable test fluids shall be as described in Supplement [SA](#); and
- c) For all materials, the average tensile strength and the average elongation of materials shall not be less than 60 percent of the as-received values. For coated fabrics, alternate limits can be used with the average tensile strength and the average elongation not less than 30% of the as-received values.

5.2.3 Nonmetallic materials – system level

5.2.3.1 For all materials, gaskets and seals that have been shown to comply with the applicable requirements for static seals in the Standard for Gaskets and Seals, UL 157, or with the requirements under material level tests shall be subjected to the system level tests after the Long Term Exposure Test, Section [12](#). Static seals shall be provided in accordance with [12.2.4](#).

5.3 Casting impregnation materials

5.3.1 Material level

5.3.1.1 Casting impregnation materials shall be evaluated at the material level in accordance with the requirements in the Standard for Power Operated Dispensing Devices for Diesel Fuel, Biodiesel Fuel, Diesel/Biodiesel Blends with Nominal Biodiesel Concentrations up to 20 Percent (B20), Kerosene, and Fuel Oil, UL 87B.

5.3.2 System level

5.3.2.1 The casting impregnation material, applied as intended to a casting, shall comply with the Long Term Exposure Test, Section [12](#). The casting shall not show indications of porosity leakage at any point during or after this test.

5.4 Internal parts

5.4.1 Nonmetallic parts located internally to a fluid confining part, degradation of which would not directly result in leakage, is not required to comply with Nonmetallic materials, [5.2](#). The part shall be tested in accordance with [5.4.2](#).

5.4.2 Internal nonmetallic parts shall be tested during the Long Term Exposure Test, Section [12](#). During this test, the part shall not degrade to the extent that visible particles can be observed in the fluid.

6 Bodies and Covers


6.1 A threaded section of a body intended for the connection of pipe shall have a section to serve as a wrench grip.

6.2 Pipe threads shall be in accordance with the Standard for Pipe Threads, General Purpose (Inch), ANSI/ASME B1.20.1.

Exception: Hose nozzle valves intended for use in installations where pipe fittings incorporate other than NPT type threads shall be permitted to be provided with pipe threads complying with a national pipe thread standard compatible with those fittings. The pipe thread type shall be identified in accordance with [28.5](#).

6.3 The couplings provided on coaxial type vapor recovery hose assemblies shall have male 1-7/8 – 12- SAE straight threads when the inner hose is intended to dispense the liquid fuel into the vehicle and 1-1/4 inch – 18 SAE Straight, M34 by 1.5 metric thread or 1 inch – 11-1/2 NPT threads, as required when the outer hose is intended to dispense the liquid fuel into the vehicle. All fittings are to be designed to fit the accessories connected to the hose couplings to form a leak tight connection. Coaxial type connections shall also have the dimensions as indicated in [Figure 6.1](#).

Figure 6.1
Coaxial type connection

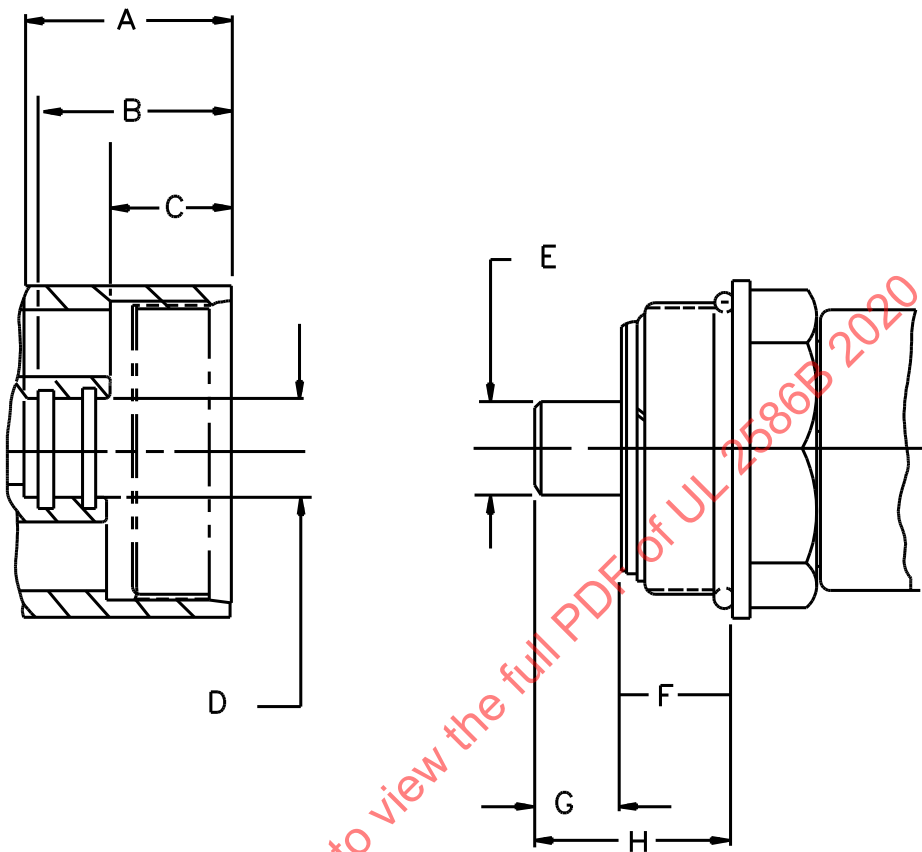

SM398

| Item | Inch | (mm) |
|------|---------------|---------------|
| A | 1.45 min | (36.8 min) |
| B | 1.26 max | (32.0 max) |
| C | 0.78 min | (19.8 min) |
| D | 0.668 – 0.672 | (17.0 – 17.1) |
| E | 0.660 – 0.664 | (16.8 – 16.9) |
| F | 0.78 max | (19.8 max) |
| G | 0.56 min | (14.2 min) |
| H | 1.31 – 1.45 | (33.3– 36.8) |

6.4 If the end connections of a vapor recovery fitting do not conform to the requirements specified in (above), the installation instructions which accompany each fitting shall indicate the specific equipment which is to be connected to the fitting.

6.5 Joints in a body formed of two or more parts shall be prevented from loosening as the result of the turning effort exerted by connecting or disconnecting piping. See the Deformation Test, Section [11](#).

6.6 Openings for bolts or screws used for assembly shall not extend through the outer walls of a body into a liquid-handling section.

7 Diaphragms

7.1 A diaphragm shall be protected from damage.

7.2 Metal parts coming in contact with a diaphragm shall have no sharp edges, burrs, projections, or the like which cause chafing or abrasion of the diaphragm.

8 Springs

8.1 A spring employed in a dispensing device assembly to reduce the risk of leakage, or in a safety mechanism, such as is employed in an operating handle, shall:

- a) Be protected against abrasion and corrosion and
- b) Demonstrate no loss in strength following subjection to a compression force of three times that exerted by the spring in any position of its intended function.

8.2 In reference to [8.1\(a\)](#), springs that are exposed to the fuels anticipated by these requirements shall comply with the applicable material requirements from Section [5](#). Springs not exposed to fuels, but exposed to the environment, shall comply with the atmospheric corrosion requirements in [5.1.2](#).

9 Operating Mechanisms

9.1 Screws and nuts used to attach operating parts to movable members shall be upset or otherwise locked to prevent loosening.

9.2 A manually-operated mechanism of a hose nozzle valve shall provide free movement of all parts.

PERFORMANCE

10 General

10.1 Except as otherwise indicated, representative samples of each type of hose nozzle valve are to be subjected to the tests described in these requirements. The order of tests, as far as applicable, is to be as indicated in Sections [11](#) – [25](#) with the exception of the specific test sequence shown in [10.3](#). Additional samples of parts constructed of nonmetallic materials, such as seal materials and valve seat discs, shall be provided as required for physical and chemical tests.

10.2 All tests shall be performed using the test fluids specified for that test. No substitution of test fluids is allowed. When the test indicates that FB25a or B100a are to be used, the test fluid shall be prepared as described in Supplement [SA](#).

10.3 The tests in following sequence are to be performed on one sample of a hose nozzle valve for each applicable test fluid as described in the Long Term Exposure Test, Section 12. The remaining tests in this standard may be performed in any order on the same samples or on additional samples as needed.

- a) Long Term Exposure Test, Section 12;
- b) External Leakage Test, Section 13;
- c) Electrical Continuity Test, Section 22;
- d) Hose Nozzle Endurance Test, Section 18;
- e) External Leakage Test, Section 13;
- f) Electrical Continuity Test, Section 22;
- g) Hydrostatic Strength Test, Section 21.

10.4 To reduce the effects of seal dry out due to removal of the test fluid after specific tests, the tests in the given sequence in 10.3 shall be started within 4 hours of removal of the previous test fluid. If necessary to coordinate testing, the sample may be left filled with the most recent test fluid at room temperature until the next test is initiated. If the previous test used an aerostatic or hydrostatic source, the sample shall be filled with kerosene.

10.5 Leakage tests for the portions of liquid handling hose nozzle valves are to be conducted using a source of aerostatic pressure. When leakage is observed, the tests shall be repeated with kerosene or Soltrol 170.

10.6 Water shall be used for developing the required pressure in a hydrostatic pressure strength test.

11 Deformation Test

11.1 Joints in a hose nozzle valve shall not leak, nor shall there be evidence of loosening of joints, distortion, or other damage resulting from the stress imposed on pipe-threaded sections when tested in accordance with these requirements.

11.2 The sample hose nozzle valve used in this test is to be rigidly anchored or otherwise supported. A length of Schedule 80 pipe is to be connected to a female pipe threaded section of the body, the male threads having first been lubricated with SAE No. 10 machine oil. Each pipe is then to be tightened to the torque specified in Table 11.1.

Table 11.1
Torque requirements for pipe connections

| Pipe size, nominal inches | Outside diameter, | | Torque, | |
|------------------------------|-------------------|---------|--------------|-----|
| | inches | (mm) | pound-inches | N·m |
| 1/2 | 0.840 | (21.34) | 800 | 90 |
| 3/4 | 1.050 | (26.67) | 1000 | 113 |
| 1 | 1.315 | (33.40) | 1200 | 137 |
| 1-1/4 | 1.660 | (42.16) | 1450 | 164 |
| 1-1/2 | 1.900 | (48.26) | 1550 | 175 |

11.3 After the torque force has been applied to each connected pipe, the test sample is to be subjected to the External Leakage Test, Section [12](#).

11.4 Upon removal of the pipe from the test sample, the assembly is to be examined for loosening of body joints.

11.5 If external leakage is noted at the thread joint between the pipe and body, the joint is to be remade using a pipe joint sealing material and retested for leakage.

12 Long Term Exposure Test

12.1 General

12.1.1 The test outlined in [12.2](#) – [12.4](#) is to be performed on one or two samples of the device. If the product is rated for use with diesel fuel (B0 – B5), a diesel/biodiesel blend above 5 percent but not greater than 20 percent biodiesel (B6 – B20), kerosene or fuel oil, then the test shall be performed using the FB25a test fluid. If the product is rated for use with biodiesel (B99.9/B100), then the test shall be performed using the B100a test fluid. See Supplement [SA](#).

12.2 Samples

12.2.1 Samples of complete device are to be tested. All inlet and outlet openings of the samples shall be sealed in accordance with [12.2.3](#).

12.2.2 If platings or coatings are used internal to the device, additional samples may be used. See [12.4.2](#).

12.2.3 Closures shall be provided to seal off inlet and outlet openings of all samples in accordance with [12.2.1](#). These closures shall be fabricated of suitable materials. The closures shall be provided with a 1/4 inch NPT opening for connection to the test apparatus. All closures shall be installed by the manufacturer and provided with a torque rating. There will be no other adjustment to connections for the duration of the test.

12.2.4 Any o-rings, gaskets, or other sealing materials, shall be provided and installed by the manufacturer. The dynamic sealing devices or materials shall be the same as those that will be used in the final product installation. Static seals shall be representative of the seals being used in the final product installation. If the sealing device or material is not considered part of the device under test, but will be provided in the end product at the time of installation, a representative seal shall be provided for the test.

12.3 Method

12.3.1 The sample is to be exposed to the applicable test fluid in accordance with [12.1.1](#). The test fluids shall be prepared using the instructions in Supplement [SA](#).

12.3.2 A quick connect device is connected to the 1/4 inch NPT connection at the inlet, and is used to fill the samples with the applicable test fluids. A source of pressure may be used to assist in filling or draining the samples, however, the pressure shall not exceed the rated pressure of the device under test. Once the samples are filled to exclude all air, they are closed off and sealed. The samples are then placed in the test chamber.

12.3.3 The chamber temperature is increased to $60 \pm 2^{\circ}\text{C}$ ($140 \pm 4^{\circ}\text{F}$). When the chamber reaches this temperature, the exposure period begins. The samples are exposed to the applicable test fluid at $60 \pm 2^{\circ}\text{C}$ for approximately 168 hours. At the end of this duration, the exposure period is halted and the chamber is

allowed to cool. The samples are subjected to rated pressure, but not less than 50 psi (340 kPa), for one minute. The fluid is then drained from the samples and observed. After this observation, the fluid is discarded. The samples are then immediately refilled with new test fluid and the chamber temperature is allowed to increase to $60 \pm 2^\circ\text{C}$ again. The total duration of the test shall equal 1,008 hours of exposure at $60 \pm 2^\circ\text{C}$.

12.3.4 At the end of the total exposure duration, the test fluid is left in the samples and the samples are removed from the chamber. The samples are then subjected to the test sequence as outlined in [10.3](#) and in accordance with [10.4](#). Prior to the initiation of the test sequence, the Long Term Exposure test fluid is to be drained and discarded.

12.3.5 If the device contains any parts or surfaces that are plated or coated, if the device uses casting impregnation materials to eliminate porosity leakage, or if the device contains internal nonmetallic parts, the plating, coating, impregnation, or internal parts are tested both during and after this exposure. See [12.4.2](#) and [12.4.4](#).

12.4 Results

12.4.1 There shall be no leakage during this test. If leakage is observed at any point during the test, the test is to be stopped.

12.4.2 For platings or coatings, there shall be no softening of the plating or coating material. Compliance is checked by observance of the drained test fluid. There shall be no evidence of visible flaking or material. In addition, there shall be no substantial discoloration of the test fluid when observing the drained fluid. Discoloration is an indication of chemical attack on the plating or coating internal to the device. In order to determine that the base metal is not exposed, visual inspections shall be made. If the visual inspection requires examination of internal surfaces, the samples shall be cut open to determine compliance. If this is necessary, additional samples can be used to determine compliance with this requirement, such that the remaining test sequence will not be disturbed by cutting open samples. However, both the samples to be cut open and the samples to be used for the test sequence are required to complete the Long Term Exposure Test.

12.4.3 For casting impregnation materials, the sample shall not show evidence of porosity leakage during or after the fluid exposure duration.

12.4.4 For internal nonmetallic parts, there shall be no visible evidence of this material in the drained test fluid.

13 External Leakage Test

13.1 All hose nozzle valves subjected to this test shall be subjected to a test pressure as indicated in [13.4](#). Test pressures shall be developed from a hydrostatic or aerostatic source.

13.2 With reference to [13.1](#), hose nozzle valves may be subjected to an aerostatic or hydrostatic pressure source. For tests performed using an aerostatic pressure source, the hose nozzle shall be submerged in water to a depth of approximately 25.4 mm (1 inch) while under test pressure, for a duration of 1 minute. There shall be no bubbles observed in the water, indicating leakage observed, during the duration. For tests performed using a hydrostatic pressure source, the test duration is to be 5 minutes.

13.3 For all hose nozzle valves, there shall be no leakage outside of fluid confining areas and there shall be no evidence of casting porosity leakage during this test.

13.4 For all tests, the inlet of the device is to be connected to the source of pressure of 25 psi (173 kPa) with the valve open and the outlet blocked. The test is repeated with a test pressure of 75 psi (518 kPa) with the valve closed and the outlet open.

13.5 A positive shutoff valve and a calibrated pressure indicating device shall be installed in the pressure supply piping. The pressure indicating device is to be installed in the piping between the shutoff valve and the device under test.

13.6 In accordance with [13.5](#), the pressure indicating device shall comply with one of the following:

- a) An analog gauge having a pressure range such that the test pressure is between 30 and 70 percent of the maximum scale reading of the gauge;
- b) A digital pressure transducer, or other digital gauge, that is calibrated over a range of pressure that includes the test pressure; or
- c) Other devices that are equivalent to the devices in (a) and (b).

13.7 If a hose nozzle valve is provided with a vapor return portion, the valve shall also be checked for leakage as indicated in [13.2](#) at 3/4 psig.

14 Hose Nozzle Valve Guard Strength Test

14.1 An operating lever guard of a hose nozzle valve shall protect the lever and valve operating parts from damage when tested as described below.

14.2 Prior to the beginning of this test, a hose nozzle valve is to be found in compliance with the requirements for external leakage, Section [13](#).

Exception: When alternate non-metallic materials are used for the hose nozzle valve guard, the prior and after leakage tests are not required.

14.3 The test valve is to be attached to a 10 foot (3.1 m) length of appropriate diameter size gasoline hose. The valve is to be dropped from a height of 4 feet (1.2 m) onto a concrete floor, employing the hose in a manner which tends to make the operating lever guard strike the floor first as specified in [14.4](#).

14.4 For all hose nozzle valves, the test sample is to be dropped ten times. For hose nozzle valves that have a nonmetallic operating lever guard assembly and/or a nonmetallic vacuum cap the test sample is to be dropped ten times on the guard and ten times on the vacuum cap. The spout of the test sample need not incorporate a shear groove or machined weak section, even though such is normally provided in the assembly. When the spout breaks off during the test, it shall be replaced and the test continued. At the completion of this test, the operating lever guard is to remain intact. The test nozzle valve is to function as intended when operated as specified in [15.1.1](#).

Exception: A hose nozzle valve that uses the same material for the operating lever guard and the plastic vacuum cap only needs the drop test conducted on both parts after conditions a and b. The remaining conditions (c, d, e, and f) and drop tests only need to be conducted on the lever guard. Refer to [14.6](#) for the different conditions.

14.5 Following completion of the tests in [14.3](#) and [14.4](#), the test valve is to conform to the requirements for external leakage, Section [13](#).

14.6 For all hose nozzle valves that have a nonmetallic lever guard assembly and/or a nonmetallic vacuum cap shall be conditioned at the following temperatures and fluids;

- a) 24 hours at minus 40°C;
- b) 60 days at 100°C;
- c) 168 hour exposure to vapors of ASTM Reference Fuels C and H;
- d) 720 h UV and water, or 1000 h Xenon;
- e) After three cycles of:
 - 1) 24 hours at 80°C, 96 ±4 percent RH;
 - 2) 24 h at minus 40°C;
 - 3) 24 h at 80°C; and
 - 4) 24 h at minus 40°C.

Exception No. 1: Acetal polymers are not subjected to the fluid in (c).

Exception No. 2: The 720 h UV (d) is not required if the material has a UL 746C outdoor use rating and the exposure to UV light, water exposure and immersions tests have been conducted.

14.7 A different sample shall be used for each conditioning and after each conditioning the nonmetallic lever guard assembly and/or a nonmetallic vacuum cap shall be dropped as described in [14.3](#).

14.8 After the ten drops the guard assembly and/or a nonmetallic vacuum cap shall not break or crack.

15 Operation Test

15.1 Automatic hose nozzle valve

15.1.1 An automatic hose nozzle valve shall function as intended when operated at least ten times at each notch setting. The inlet flow pressure is to be limited to a gauge pressure of 8 psi (55 kPa) using an acceptable pumping unit, flow regulator, and pressure regulator. The resultant flow is to be measured. When the flow rate exceeds 5 gallons per minute at an inlet pressure of 8 psig, the test is to be conducted at a flow rate of 5 gallons (19 L) per minute at any resulting inlet flow pressure.

Exception: The valve is not prohibited from being operated at a flow rate of 5 gallons per minute at any resulting inlet flow pressure when this is followed by operating the valve at an inlet flow pressure of 8 psi at any resulting flow rate.

15.1.2 Automatic hose nozzle valves equipped with an integral hold open or latching device shall shut off or cease the flow of liquid when tested as described below.

15.1.3 A sample of the hose nozzle valve shall be connected to a pump with a control valve in the piping to limit the pressure and flow of kerosene or Soltrol 170.

15.1.4 For nozzles with a "no pressure-no flow" feature the nozzle was latched open at the flow rates indicated below. With the nozzle held or latched open, the supply pump was shut down and the pressure was allowed to drop to zero. The supply was then turned on again to determine if the nozzle automatically closed. This was repeated 10 times at each flow rate.

15.1.5 For nozzles with an "Interlock" feature the nozzle was latched open at the flow rates as indicated below while the operator manually pulls the interlock device to activate the nozzle mechanism. While the

liquid was flowing and the nozzle held or latched open, the operator released the interlock to determine if the nozzle automatically closed. This is repeated 10 times in each flow rate.

Flow Rates

- a) High latch (high flow) position with inlet flow pressure at 150 kPa (21.75 psig); and
- b) Low latch (low flow) with inlet flow pressure at 55 kPa (8 psig).

15.2 Bellows secondary shut off operation

15.2.1 Hose nozzles valves designed with a bellows secondary shut off feature shall shutoff operation to the nozzle when operated as intended. This test shall be repeated after the Bellows Secondary Shut Off Operation Test, Section [19](#).

16 Pull Test

16.1 An automatic hose nozzle valve shall shear or break off so as to separate the valve body from the spout when subjected to a right angle pull force of not more than:

- a) 150 pounds (668 N) for a nozzle with a spout diameter less than 1 inch (25.4 mm) or
- b) 180 pounds (801 N) for a nozzle with a spout diameter of 1 inch to 1-1/4 inch.

16.2 Compliance with [16.1](#) is capable of being obtained by a weak section groove in the spout located not more than 1 inch (25.4 mm) from the end of the valve body or body adapter and designed to fracture upon application of the specified right angle pull force or less. To determine conformance with the requirement, tests are to be conducted with the spout portion of the valve fixed at the designed break or shear point, and the specified right angle pull force applied using a length of gasoline hose of the same size as the inlet of the nozzle attached to the test sample at the inlet end of the valve body.

16.3 Following the test specified in [16.1](#) and [16.2](#), the spout shall be replaced and the valve shall be in compliance with the requirements for external leakage, Section [13](#).

17 Sensitivity Test

17.1 An automatic hose nozzle valve latch shall stop the flow of liquid or unlatch when the valve is released from a fill opening or upon impact with the driveway.

17.2 Compliance with [17.1](#) is to be determined by a series of tests in which a sample valve is inserted into a simulated fill opening having its bottom edge located 22 inches (559 mm) above a concrete floor. Prior to the test, the sample is to be attached to a 10 foot (3.05 m) length of gasoline hose of the same size as the inlet of the nozzle. The test is conducted by pulling the sample from the opening at both slow and fast rates in a manner such that the valve strikes the concrete before the hose. Five trials are to be made at each rate with the valve latched in each of its hold-open positions.

17.3 With reference to the test sequence specified in [17.2](#), "slow" is considered to be just fast enough to cause release from the fill opening, and "fast" is considered to be a rapid motion as could result from a fast-accelerating automobile driving away from a dispensing device.

17.4 Following the test specified in [17.1](#) and [17.2](#), the valve shall be in compliance with the requirements for external leakage, Section [13](#).

18 Hose Nozzle Endurance Test

18.1 A hose nozzle valve shall perform in the intended manner during the test described in [18.2](#) – [18.6](#). During this test, there shall be no external leakage, no sticking of the valve in the open position, nor shall the valve become inoperative such that external leakage of the test fluid is observed. Required corrosion protection shall not be impaired.

18.2 All samples of the hose nozzle valve subjected to the Long Term Exposure Test, Section [12](#), are to be operated for 100,000 cycles of operation while handling the test fluid indicated in [18.5](#) with rated pressure on the valve seat.

18.3 Prior to the beginning of this test, an automatic hose nozzle valve is to function as intended, described as not allowing fluid flow when the valve is closed and that the valve shall be able to close when the actuator is released.

18.4 This test is to be conducted in a manner that subjects the discharge side of a valve to the pressures and flow of 10 GPM \pm 1 GPM fluid. A hose nozzle valve is to be operated during this test at its maximum rated pressure with the valve in the closed position.

18.5 This test is to be conducted at a rate not faster than 10 times per minute using kerosene or Soltrol 170 as the test fluid. A strainer having a straining element with screening openings not smaller than those of a 50-mesh screen is to be installed in the supply line near the inlet to the valve.

18.6 Following the completion of the test, the hose nozzle valve shall not leak externally. For an automatic hose nozzle valve, the automatic shut off feature shall still function as intended.

18.7 The endurance test is to be conducted with the air ambient at 70 \pm 10°F (21 \pm 5.5°C) when the specified temperature rating is within the range of minus 20°F (minus 29°C) to 125°F (52°C).

19 Bellows Secondary Shut Off Operation Test

19.1 A hose nozzle valve with a bellows secondary shut off that has a feature shall perform as intended for 6,000 cycle of operation. The sample shall be pressurized at its rated pressure with the valve in the closed position. The hose nozzle valve shall then be operated as intended to start the flow of the fluid and then the shut off mechanism shall be activated. The flow of test fluid shall shut off.

20 Visible Discharge Indicator Tests

20.1 Thermal shock test

20.1.1 A visible discharge indicator shall withstand without evidence of cracking or breakage a sudden temperature reduction from an initial temperature 212 \pm 2°F (100 \pm 1°C) to 32 \pm 2°F (0 \pm 0.2°C).

20.1.2 Three samples of the indicator are to be condition in water for 15 minutes at 212 \pm 2°F (100 \pm 1°C). Immediately after the 15 minutes the samples shall be plunged into water maintained at 32 \pm 2°F (0 \pm 0.2°C) and then checked for cracking or breakage.

20.2 Drop test

20.2.1 A hose nozzle valve shall protect the visible discharge indicator from damage when tested as described below.